City of Beaumont



550 E. 6th Street Beaumont, CA 92223 (951) 769-8520 www.beaumontca.gov

Case No. PW2024-0111
Receipt No. R01594325
Fee \$ 3,915.00
Date Paid 9/19/2024

BOND EXONERATION APPLICATION

Bon	d Type: ☐Performance ▼Maintenance ☐Final Monumen	t Inspection Other:			
1.	Contact's Name Bruce McDonald	Phone 949-655-8227			
2.	Contact's Address 1140 N. Coast Highway, Laguna Beach,				
5.	Contact's E-mail bruce@mcdonaldpropertygroup.com	City/State/Zip			
3.	Developer Name McDonald Property Group (If corporation or partnership application must include names of pri	Phone 949-655-8227 ncipal officers or partners)			
4.	Developer Address 1140 N. Coast Highway, Laguna Beach				
5.	City/St/Zip Description of Bonds (including Bond Number, Tract Map/Application number, Lot number, and description of improvements covered): Maintenance Bond #800086182 for Parcel Map No. 36426 for 4th Street Sewer Lift Station				
6.	CERTIFICATION OF ACCURACY AND COMPLE to the best of my knowledge the information in this apple and exhibits are true, complete, and correct.				
	Bruce McDonald Bruch Name and Sign Contact/Applicant	9/5/2024			
7.	Print Name and Sign – Contact/Applicant Contractor shall indemnify, defend, and hold harmless the employees and volunteers from and against any and all l costs (including without limitation costs and fees of litig of or in connection with contractor's performance of work comply with any of its obligations for which this Bond e for such loss or damage which was caused by the active	iability, loss, damage, expense, ation) of every nature arising out rk hereunder or its failure to xoneration is requested, except			
	Bruce McDonald Record Applicant	9/5/2024			
	Print Name and Sign – Contact/Applicant	Date			

- 8. Developer/Contractor has completed all the following items prior to requesting release or has included them in the application.
 - Remove and replace concrete and AC as needed where lifting.
 - Provide AC crack fill as needed. Crack fill/seal shall be hot asphaltic emulsion.
 - Provide Type II slurry coat for all road surfaces.
 - Restore/Verify pavement striping/markings.
 - Restore/Verify blue dots and signage as needed.
 - Clean and camera sewer. Provide report and video copy of camera survey.
 - Provide all final geotechnical reports.
 - Provide Engineers' certification for line and grade within Right-of-Way.
 - Provide Landscape Architects Certification as required.

Bruce McDonald	mululy	9/5/2024
Print Name and Sign	- Contact/Applicant	Date



Punch List

Project Name: 4th Street Sewer Lift Station **Tract No.** Parcel Map #36426

#36426						
Maint	enance	PW2024-0111	Bond No. 800086182	Sewer Lift Station		
Inspect	ed By: Public Worl	ks & Wastewater	Page: 1	Date: 9-27-24/11-21-24/ 1-21-25		
Item No.	C	Description	Completed by Construction (Sign/Date)	Accepted by (Sign/Date)		
1	Land dedication	for SLS and driveway.	Alex Stanko 9/27/24	Omitted by Kenyon Potter (separate item) 11/21/24		
2	Provide AQMD	paperwork	Alex Stanko	Alex Stanko 1-21-25		
3	Provide generat	or maintenance	9/27/24 Alex Stanko	Alex Stanko		
_			9/27/24	1-21-25		
4	Verify plug cross	s-connect	Alex Stanko 9/27/24	Alex Stanko 11/21/24		
5	Provide new VFI) information	Alex Stanko 9/27/24	Alex Stanko 11/21/24		
6	Provide specification security system	ations for lift station	Alex Stanko	Alex Stanko		
7	Address delamin	nation of wet well	9/27/24 Alex Stanko	11/21/24 Alex Stanko		
8			9/27/24	11/21/24		
9						
10						
11						

Bond No. 800086182

MAINTENANCE BOND

WHEREAS, the City of Beaumont ("City"), a municipal corporation, and MPLD II Inland Empire, LL
(hereinafter "Principal"), have entered into an agreement by which Principal agrees to install and complete
certain designated public improvements and to guarantee and warrant the work for the period of one year
following its completion and acceptance, which said agreement, dated, and
identified as Tract Map PP2018-0134 is hereby referred to and made a part hereof; and:
Beaumont Crossroads II Sewer Lift Station
WHEREAS, Principal is required under the terms of the agreement to furnish a bond to guarantee and
warrant the work for a period of one year following its completion and acceptance against any defective
work or labor done, or defective materials furnished, to comply with the terms of the agreement.
Atlantic Specialty
NOW, THEREFORE, we, the Principal and <u>Insurance Company</u> ("Surety") admitted and duly
authorized to transact business under the laws of the State of California as surety, are held and firmly
bound unto the City of Beaumont as obligee, in the penal sum of <u>Four Hundred Ninety Two and 30/100</u> dollars
(\$298,492.30) lawful money of the United States, for the payment of which sum well and truly to be
made, we bind ourselves, our heirs, successors, executors, and administrators, jointly and severally, firmly
by these presents.

The condition of this obligation is such that if the above bounded Principal, his or its heirs, executors, administrators, successors or assigns, shall in all things stand to and abide by, provisions in the agreement and any alteration thereof made as therein provided, on his or its part to be kept and performed at the time and in the manner therein specified, and in all respects according to their true intent and meaning, and shall indemnify and save harmless the City of Beaumont, its officers, agents and employees, as therein stipulated, then this obligation shall become null and void; otherwise it shall be and remain in full force and effect.

As a condition precedent to the satisfactory completion of the agreement, the obligation of the Principal and surety under this bond shall remain in effect for a period of one (1) year after the completion and acceptance of the work. During that time, if the Principal or his or its heirs, executors, administrators, successors or assigns, fails to make full, complete and satisfactory repair and replacement or totally protect the City from any loss or damage made evident during that year which results from or is caused by either defective materials or faulty workmanship in the prosecution of the work, then the obligation shall remain in full force and effect. However, anything in this paragraph to the contrary notwithstanding, the obligation of the Surety shall continue so long as any obligation of the Principal remains.

As a part of the obligation secured hereby and in addition to the face amount specified therefor, there shall be included costs and reasonable expenses and fees, including reasonable attorney's fees, incurred by the City of Beaumont in successfully enforcing such obligation, all to be taxed as costs and included in any judgment rendered.

The Surety hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the agreement or to the work to be performed thereunder or the specifications accompanying the same shall in anywise affect its obligations under this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the agreement or to the work or to the specifications. The Surety waives all rights of subrogation against the City or any person employed by the City.

SIGNED AND SEALED THIS 24th DAY OF _	July
Miles Some	
Atlantic Specialty Insurance Company SURETY By: Jeremy Polk, Attorney-in-Fact	(Seal) MPLD II Inland Empire, LLC, a Delaware limited liability company By: MPLD II REIT A, a Texas real estate investment trust, its sole member PRINCIPAL By:
(Name)	LANGE ALLEN (Name) Executive Managing Director
(Address)	(Title)
605 Highway 169 North, Suite 800	(Address) 9830 Colonnade Blvd, Suite 600
Plymouth, MN 55441	San Antonio, TX 78230-2239 By:
	(Name)
	(Title)
	(Address)

ALL SIGNATURES MUST BE ACKNOWLEDGED BY A NOTARY PUBLIC

Acknowledgement Form

State of Texas

instrument.

State of Texas	_)
)ss.:
County of Bexar	
On the <u>as</u> day of <u>July</u>	in the year 2023, before me, the undersigned notary
public, personally appeared Lar	nge Allen, personally known to me or proved
to me on the basis of satisfactor	y evidence to be the individual(s) whose name(s) is (are)

subscribed to the within instrument and acknowledged to me that he/she/they executed the same

in his/her/their capacity(ies), and that by his/her/their signature(s) on the instrument, the

individual(s), or the person upon behalf of which the individual(s) acted, executed the

ACKNOWLEDGEMENT

State of Arizona

County of Maricopa

On 7/24/2023 before me personally appeared <u>Jeremy Polk</u> whose identity was proven to me on the basis of satisfactory evidence to be the person who he or she claims to be, and acknowledged that he or she signed the attached document.

(Seal)



Notary Signature

Matthew Stanton Erra Commission Expires March 9th, 2026



Power of Attorney

KNOW ALL MEN BY THESE PRESENTS, that ATLANTIC SPECIALTY INSURANCE COMPANY, a New York corporation with its principal office in Plymouth, Minnesota, does hereby constitute and appoint: **Jeremy Polk, Jorge Mendez, Matthew Erra**, each individually if there be more than one named, its true and lawful Attorney-in-Fact, to make, execute, seal and deliver, for and on its behalf as surety, any and all bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof; provided that no bond or undertaking executed under this authority shall exceed in amount the sum of: **unlimited** and the execution of such bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof in pursuance of these presents, shall be as binding upon said Company as if they had been fully signed by an authorized officer of the Company and sealed with the Company seal. This Power of Attorney is made and executed by authority of the following resolutions adopted by the Board of Directors of ATLANTIC SPECIALTY INSURANCE COMPANY on the twenty-fifth day of September, 2012:

Resolved: That the President, any Senior Vice President or Vice-President (each an "Authorized Officer") may execute for and in behalf of the Company any and all bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof, and affix the seal of the Company thereto; and that the Authorized Officer may appoint and authorize an Attorney-in-Fact to execute on behalf of the Company any and all such instruments and to affix the Company seal thereto; and that the Authorized Officer may at any time remove any such Attorney-in-Fact and revoke all power and authority given to any such Attorney-in-Fact.

Resolved: That the Attorney-in-Fact may be given full power and authority to execute for and in the name and on behalf of the Company any and all bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof, and any such instrument executed by any such Attorney-in-Fact shall be as binding upon the Company as if signed and sealed by an Authorized Officer and, further, the Attorney-in-Fact is hereby authorized to verify any affidavit required to be attached to bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof.

This power of attorney is signed and sealed by facsimile under the authority of the following Resolution adopted by the Board of Directors of ATLANTIC SPECIALTY INSURANCE COMPANY on the twenty-fifth day of September, 2012:

Resolved: That the signature of an Authorized Officer, the signature of the Secretary or the Assistant Secretary, and the Company seal may be affixed by facsimile to any power of attorney or to any certificate relating thereto appointing an Attorney-in-Fact for purposes only of executing and sealing any bond, undertaking, recognizance or other written obligation in the nature thereof, and any such signature and seal where so used, being hereby adopted by the Company as the original signature of such officer and the original seal of the Company, to be valid and binding upon the Company with the same force and effect as though manually affixed.


IN WITNESS WHEREOF, ATLANTIC SPECIALTY INSURANCE COMPANY has caused these presents to be signed by an Authorized Officer and the seal of the Company to be affixed this first day of January, 2023.

1986

STATE OF MINNESOTA HENNEPIN COUNTY

Sarah A. Kolar, Vice President and General Counsel

On this first day of January, 2023, before me personally came Sarah A. Kolar, Vice President and General Counsel of ATLANTIC SPECIALTY INSURANCE COMPANY, to me personally known to be the individual and officer described in and who executed the preceding instrument, and she acknowledged the execution of the same, and being by me duly sworn, that she is the said officer of the Company aforesaid, and that the seal affixed to the preceding instrument is the seal of said Company and that the said seal and the signature as such officer was duly affixed and subscribed to the said instrument by the authority and at the direction of the Company.



Notary Public

I, the undersigned, Secretary of ATLANTIC SPECIALTY INSURANCE COMPANY, a New York Corporation, do hereby certify that the foregoing power of attorney is in full force and has not been revoked, and the resolutions set forth above are now in force.

Signed and sealed. Dated 24th day of July 2023

This Power of Attorney expires January 31, 2025 ORPORATE E COMMUNICIPAL DE LA COMMUNICACIÓN DE LA COMPONICION DEL COMPONICION DE LA COMPONICION DE LA COMPONICION DE LA COMPONICION DEL COMPONICION DE LA CO

Kara L.B. Barrow, Secretary

- 1. THIS PLAN SUPERSEDES ALL OTHER PLANS PREVIOUSLY APPROVED BY THE CITY OF
- BEAUMONT REGARDING IMPROVEMENTS SHOWN ON THIS SET OF PLANS. 2. APPROVAL OF THIS PLAN DOES NOT LESSEN OR WAIVE ANY PORTION OF THE BEAUMONT MUNICIPAL CODE, RESOLUTION OF CONDITIONAL APPROVAL, CITY STANDARDS OR OTHER ADDITIONAL DOCUMENTS LISTED HEREIN AS THEY MAY PERTAIN TO THIS PROJECT. THE ENGINEER IN RESPONSIBLE CHARGE SHALL REVISE THESE PLANS WHEN NON-CONFORMANCE IS DISCOVERED
- 3. CITY APPROVAL OF PLANS DOES NOT RELIEVE THE DEVELOPER OR ENGINEER-OF-WORK FROM RESPONSIBILITY FOR THE CORRECTION OF ERRORS AND OMISSIONS DISCOVERED DURING CONSTRUCTION. ALL PLAN REVISIONS SHALL BE PROMPTLY SUBMITTED TO THE CITY ENGINEER FOR APPROVAL
- 4. A RIGHT-OF-WAY PERMIT FROM THE BUILDING & SAFETY DEPARTMENT WILL BE REQUIRED FOR ANY WORK IN THE PUBLIC RIGHT OF WAY. PRIOR TO PERMIT ISSUANCE, A CERTIFICATE OF INSURANCE MUST BE FILED NAMING THE CITY OF BEAUMONT AS AN ADDITIONAL INSURED ON THE PERMITTEE'S POLICY IN THE MINIMUM AMOUNT OF \$1,000,000.00 FOR EACH OCCURRENCE OF LIABILITY. THE INSURANCE COMPANY WRITING THE POLICY MUST HAVE A RATING OF "A-" OR BETTER AND A SIZE CATEGORY OF CLASS VII OR BETTER AS ESTABLISHED BY "BESTS" KEY RATING GUIDE.
- 5. NO WORK SHALL BE COMMENCED UNTIL ALL PERMITS HAVE BEEN OBTAINED FROM THE CITY AND OTHER APPROPRIATE AGENCIES.
- 6. REVISION OF THESE PLANS MAY BE REQUIRED IF THE PROPOSED IMPROVEMENTS ARE NOT CONSTRUCTED PRIOR TO THE DEADLINE DATE OF THE IMPROVEMENT
- 7. NO REVISIONS WILL BE MADE TO THESE PLANS WITHOUT THE WRITTEN APPROVAL OF THE CITY ENGINEER, NOTED WITHIN THE REVISION BLOCK, ON THE APPROPRIATE SHEET OF THE PLANS AND TITLE SHEET.
- 8. ORIGINAL DRAWINGS SHALL BECOME THE PROPERTY OF THE CITY UPON BEING SIGNED BY THE CITY ENGINEER. 9. THE ORIGINAL DRAWING SHALL BE REVISED TO REFLECT AS-BUILT CONDITIONS
- BY THE ENGINEER-OF-WORK PRIOR TO FINAL ACCEPTANCE OF THE WORK BY THE
- 10. ACCESS FOR FIRE AND OTHER EMERGENCY VEHICLES SHALL BE MAINTAINED TO THE PROJECT SITE AT ALL TIMES DURING CONSTRUCTION. 11. WHERE TRENCHES ARE WITHIN CITY EASEMENTS, A SOILS REPORT COMPRISED OF: A. SUMMARY SHEET
 - B. LABORATORY WORK SHEETS C. COMPACTION CURVES, SHALL BE SUBMITTED BY A PROFESSIONAL ENGINEER OF THE STATE OF CALIFORNIA, PRINCIPALLY DOING BUSINESS IN THE FIELD OF APPLIED SOILS MECHANICS. THE SOILS REPORT WILL BE SUBMITTED TO THE CITY ENGINEERING INSPECTOR WITHIN TWO WORKING DAYS OF COMPLETION OF FIELD TESTS. THE WRITTEN FIELD COMPACTION REPORT(S) SHALL BE IMMEDIATELY SUBMITTED TO THE CITY ENGINEERING INSPECTOR UPON COMPLETION OF THE FIELD TESTS
- 12. A PRECONSTRUCTION MEETING SHALL BE HELD AT THE SITE PRIOR TO THE BEGINNING OF WORK AND SHALL BE ATTENDED BY ALL REPRESENTATIVES RESPONSIBLE FOR CONSTRUCTION, INSPECTION, SUPERVISION, TESTING AND ALL OTHER ASPECTS OF THE WORK. THE CONTRACTOR SHALL SCHEDULE THE MEETING BY CALLING THE INSPECTION LINE AT (951) 572-3224 AT LEAST FIVE (5) WORKING DAYS PRIOR TO STARTING CONSTRUCTION. APPROVED DRAWINGS MUST BE AVAILABLE PRIOR TO SCHEDULING.
- 13. ALL INSPECTION REQUESTS OTHER THAN FOR THE PRECONSTRUCTION MEETING WILL BE MADE BY CALLING THE BUILDING AND SAFETY INSPECTION REQUEST LINE AT (951) 572-3224. INSPECTION REQUESTS MUST BE RECEIVED PRIOR TO 2:00 P.M. ON THE DAY BEFORE THE INSPECTION IS NEEDED. INSPECTIONS WILL BE MADE THE NEXT WORK DAY UNLESS YOU REQUEST OTHERWISE. REQUESTS MADE AFTER 2:00 P.M. WILL BE SCHEDULED FOR TWO FULL WORK DAYS LATER.
- 14. THE OWNER AND/OR APPLICANT THROUGH THE DEVELOPER AND/OR CONTRACTOR SHALL DESIGN, CONSTRUCT AND MAINTAIN ALL SAFETY DEVICES, INCLUDING SHORING, AND SHALL BE SOLELY RESPONSIBLE FOR CONFORMING TO ALL LOCAL STATE AND FEDERAL SAFETY AND HEALTH STANDARDS, LAWS AND REGULATIONS.
- 15. THE CONTRACTOR SHALL CONFORM TO LABOR CODE SECTION 6705 BY SUBMITTING A DETAILED PLAN TO THE CITY ENGINEER AND/OR CONCERNED AGENCY SHOWING THE DESIGN OF SHORING, BRACING SLOPE OR OTHER PROVISIONS TO BE MADE FOR WORKER PROTECTION FROM THE HAZARD OF CAVING GROUND DURING THE EXCAVATION OF SUCH TRENCH OR TRENCHES OR DURING THE PIPE INSTALLATION THEREIN. THIS PLAN MUST BE PREPARED FOR ALL TRENCHES FIVE FEET (5') OR MORE IN DEPTH AND APPROVED BY THE CITY ENGINEER AND/OR CONCERNED AGENCY PRIOR TO EXCAVATION. IF THE PLAN VARIES FROM THE SHORING SYSTEM STANDARDS ESTABLISHED BY THE CONSTRUCTION SAFETY ORDERS, TITLE 8 OF THE CALIFORNIA ADMINISTRATIVE CODE, THE PLAN SHALL BE PREPARED BY A REGISTERED ENGINEER AT THE CONTRACTOR'S EXPENSE. A COPY OF THE OSHA
- EXCAVATION PERMIT MUST BE SUBMITTED TO THE INSPECTOR PRIOR TO EXCAVATION. 16. IF ANY ARCHAEOLOGICAL RESOURCES ARE DISCOVERED WITHIN ANY WORK ZONE DURING CONSTRUCTION. OPERATIONS WILL CEASE IMMEDIATELY. AND THE PERMITTEE WILL NOTIFY THE CITY ENGINEER. OPERATIONS WILL NOT RESTART UNTIL THE
- PERMITTEE HAS RECEIVED WRITTEN AUTHORITY FROM THE CITY ENGINEER TO DO SO. 17. ALL OPERATIONS CONDUCTED ON THE SITE OR ADJACENT THERETO SHALL ADHERE TO THE NOISE ORDINANCE SET FORTH BY THE CITY MUNICIPAL CODE. ALL OPERATIONS SHALL BE LIMITED BY THE NOISE ORDINANCE TO THE LEVEL OF DECIBELS SPECIFIED FOR THE AREA AND TIME PERIOD. CONSTRUCTION ACTIVITIES WILL BE LIMITED TO THE PERIOD BETWEEN 7:00 A.M. AND 6:00 P.M. EACH DAY MONDAY THROUGH FRIDAY, UNLESS OTHERWISE PERMITTED
- 18. ALL OFF-SITE HAUL ROUTES SHALL BE SUBMITTED BY THE CONTRACTOR TO THE CITY ENGINEER FOR APPROVAL TWO FULL WORKING DAYS PRIOR TO BEGINNING OF WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DEBRIS OR DAMAGE OCCURRING ALONG THE HAUL ROUTE OR ADJACENT STREETS AS A RESULT OF THE
- 19. NO BLASTING SHALL BE COMMENCED WITHOUT A CITY ENGINEER APPROVED BLASTING PROGRAM AND BLASTING PERMIT.
- 20. THE EXISTENCE AND LOCATION OF UTILITY STRUCTURES AND FACILITIES SHOWN ON THE CONSTRUCTION PLANS WERE OBTAINED BY A SEARCH OF THE AVAILABLE RECORDS. ATTENTION IS CALLED TO THE POSSIBLE EXISTENCE OF OTHER UTILITY FACILITIES OR STRUCTURES NOT SHOWN OR IN A LOCATION DIFFERENT FROM THAT SHOWN ON THE PLANS. THE CONTRACTOR IS REQUIRED TO TAKE DUE PRECAUTIONARY MEASURES TO PROTECT THE UTILITIES SHOWN ON THE PLANS AND ANY OTHER EXISTING FACILITIES OR STRUCTURES NOT SHOWN.
- 21. THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING FACILITIES (ABOVEGROUND AND UNDERGROUND) WITHIN THE PROJECT SITE SUFFICIENTLY AHEAD OF THE CONSTRUCTION TO PERMIT THE REVISIONS OF THE CONSTRUCTION PLANS IF IT IS FOUND THAT THE ACTUAL LOCATIONS ARE IN CONFLICT WITH THE
- 22. THE CONTRACTOR SHALL NOTIFY AFFECTED UTILITY COMPANIES (SEE BELOW) AT LEAST TWO FULL WORKING DAYS PRIOR TO STARTING CONSTRUCTION NEAR THEIR

FACILITIES AND SHALL COORDINATE WORK WITH A COMPANY REPRESENTATIVE. UNDERGROUND SERVICE ALERT (800) 422-4133 SOUTHERN CALIFORNIA EDISON (800) 409 - 2365(800) 892-0123

(888) 423-3913 COX COMMUNICATIONS 23. IN ACCORDANCE WITH THE CITY STORM WATER STANDARDS ALL STORM DRAIN INLETS CONSTRUCTED BY THIS PLAN SHALL INCLUDE "STENCILS" BE ADDED TO PROHIBIT WASTE DISCHARGE DOWNSTREAM. STENCILS SHALL BE ADDED TO THE SATISFACTION OF THE CITY ENGINEER.

CITY OF BEAUMONT, CALIFORNIA BEAUMONT CROSSROADS LIFT STATION 100% SUBMITTAL

AS-BUILTS

Sheet Number	Sheet Title
	TITLE SHEET
2	INDEX MAP
3	OVERALL SITE PLAN
-	
4	LIFT STATION SITE PLAN
5	GRADING PLAN
6 	MECHANICAL PLAN
7	LIFT STATION SECTION A
8	LIFT STATION SECTION B
9	LIFT STATION SECTION C
10	DETAILS
11	DETAILS
12	DETAILS
13	DETAILS
14	GENERAL ELECTRICAL NOTES
15	ELECTRICAL SITE PLAN
16	ELECTRICAL BUILDING FLOORPLAN
17	ELECTRICAL SINGLE LINE AND SCHEDULES
18	ELECTRICAL DETAILS 1
19	ELECTRICAL DETAILS 2
20	MOTOR CONTROL
21	ELECTRICAL SCHEDULES
22	GENERAL STRUCTURAL NOTES I
23	GENERAL STRUCTURAL NOTES II
24	STRUCTURAL SITE PLAN
25	MCC BUILDING FOUNDATION PLAN
26	MCC BUILDING ROOF PLAN
27	MCC BUILDING ELEVATION I
28	MCC BUILDING ELEVATION II
29	MCC BUILDING ELEVATION III
30	MCC BUILDING ELEVATION IV
31	STRUCTURAL DETAILS I
32	STRUCTURAL DETAILS II
33	WET WELL SLAB
34	WET WELL SLAB II
35	MECHANICAL NOTES AND SCHEDULES
36	MECHANICAL FLOORPLAN
37	FINISHES AND DOORS
38	ROOF DETAILS

DECLARATION OF RESPONSIBLE CHARGE I HEREBY DECLARE THAT I AM THE ENGINEER OF WORK FOR THIS PROJECT. THAT I HAVE EXERCISED RESPONSIBLE CHARGE OVER THE DESIGN OF THE PROJECT AS DEFINED IN SECTION 6703 OF THE BUSINESS AND PROFESSIONS CODE, AND THAT THE DESIGN IS CONSISTENT WITH CURRENT STANDARDS. I UNDERSTAND THAT THE CHECK OF PROJECT DRAWINGS AND SPECIFICATIONS BY THE CITY OF BEAUMONT DOES NOT RELIEVE ME AS ENGINEER OF WORK OF MY

RESPONSIBILITIES FOR PROJECT DESIGN. FIRM. KIMLEY-HORN & ASSOCIATES ADDRESS: 401 B STREET CITY, ST.: SAN DIEGO, CA 92101 TELEPHONE: (619)234-9411 BY: SAM. L MCWHORTER, R.C.E. 61788 DATE: 8/30/21 (NAME OF ENGINEER & RCE)

ALL STANDARD DRAWINGS ARE COUNTY OF RIVERSIDE ROAD IMPROVEMENT STANDARDS & SPECIFICATIONS UNLESS NOTED OTHERWISE:

* RCFC&WCD STANDARD MANUAL

** EMWD SEWER STANDARD DRAWINGS *** STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

LEGAL DESCRIPTION:

THAT PORTION OF PARCEL 1 OF PARCEL MAP NO. 36426, IN THE CITY OF BEAUMONT, COUNTY OF RIVERSIDE, STATE OF CALIFORNIA, AS PER MAP FILED IN BOOK 242, PAGES 24 THROUGH 29, INCLUSIVE, OF PARCEL MAPS, IN THE OFFICE OF THE COUNTY RECORDER OF SAID COUNTY, DESCRIBED AS FOLLOWS:

BEGINNING AT THE NORTHEAST CORNER OF SAID PARCEL 1;

THENCE WESTERLY ALONG THE NORTHERLY LINE OF SAID PARCEL 1, SOUTH 87° 44' 33" WEST 182.70 FEET TO A LINE PARALLEL WITH AND DISTANT WESTERLY 182.62 FEET MEASURED AT RIGHT ANGLES FROM THE EASTERLY LINE OF SAID PARCEL 1;

THENCE SOUTHERLY ALONG SAID PARALLEL LINE, SOUTH 00° 37' 01" EAST 65.03 FEET TO A LINE PARALLEL WITH AND DISTANT SOUTHERLY 65.00 FEET MEASURED AT RIGHT ANGLES FROM SAID NORTHERLY LINE;


THENCE EASTERLY ALONG LAST MENTIONED PARALLEL LINE, NORTH 87° 44' 33" EAST 182.70 FEET TO SAID EASTERLY LINE;

THENCE NORTHERLY ALONG SAID EASTERLY LINE, NORTH 00° 37' 01" WEST 65.03 FEET TO THE POINT OF BEGINNING

ASSESSOR'S PARCEL NO. 36426 BEING A SUBDIVISION OF A PORTION OF THE NORTH HALF OF SECTION 7 AND THE SOUTHWEST CORNER OF SECTION 6, BOTH OF TOWNSHIP 3 SOUTH, RANGE 1 WEST, SAN BERNARDINO MERIDIAN, AS RECORDED MARCH 16, 2017, AS DOCUMENTED NO. 2017-0108002, OF OFFICIAL RECORDS OF SAID COUNTY.

SITE ADDRESS: 36523 HWY 60 CITY OF BEAUMONT, CA 92223

OWNER/APPLICANT: MCDONALD PROPERTY GROUP 1140 N. COAST HIGHWAY LAGUNA BEACH, CA 92651 PHONE: (949) 999-2800 FAX: (949) 999-2839

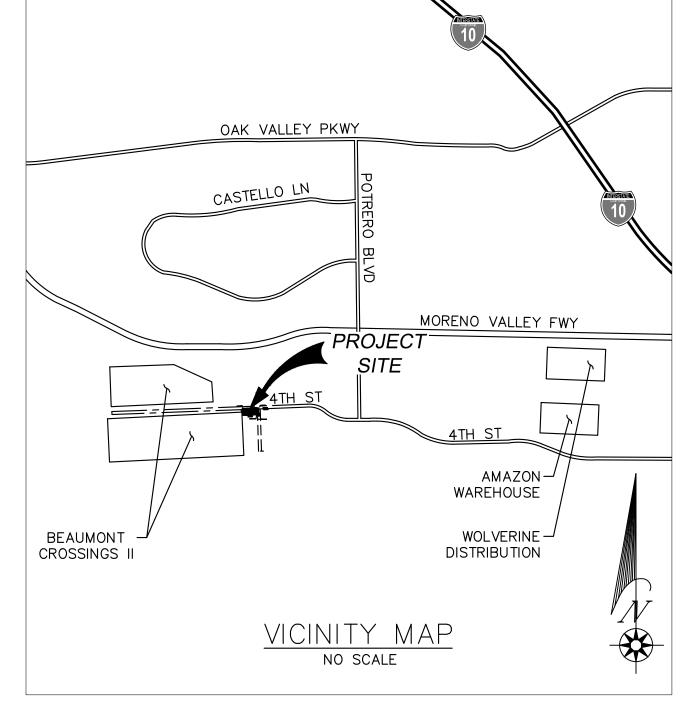

WORK TO BE DONE THE IMPROVEMENT WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE FOLLOWING DOCUMENTS, CURRENT AT THE TIME OF CONSTRUCTION, AS DIRECTED BY THE CITY ENGINEER.

- 2. FOR STREETS: RIVERSIDE COUNTY ORDINANCE NO. 461. FLOOD CONTROL FACILITIES: THE RIVERSIDE COUNTY FLOOD CONTROL AND WATER CONSERVATION DISTRICT'S STANDARDS FOR FLOOD CONTROL FACILITIES. SANITARY SEWER FACILITIES: THE EASTERN MUNICIPAL WATER DISTRICT'S STANDARDS FOR SANITARY SEWER FACILITIES. ALL OTHER PUBLIC WORKS: THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREEN BOOK).
- 3. THIS SET OF PLANS.

1. BEAUMONT MUNICIPAL CODE.

SOILS REPORT AND RECOMMENDATIONS BY KLING CONSULTING GROUP, DATED

Call 2 Working Days Before You Dig!

NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07), ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN HE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH BY MARK DATE A MEASURED ELEVATION = 2468.01', USED HEREON. DESCRIPTION ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978) REVISIONS

SEWER NOTES

SPECIFICATIONS.

STANDARD DRAWING SB-30.

THE BUILDING AND SAFETY DEPARTMENT.

PROJECTIONS TO THE MANHOLE CENTERLINE.

DAYS FOLLOWING ITS COMMENCEMENT.

TO BE PER STANDARD DRAWING SB-176.

DRAWING SB-157, SB-158, AND SB-159.

ADMINISTRATIVE CODE

UNIFORM PLUMBING CODE.

TO BIDDING FOR CONSTRUCTION.

APPROVAL BY THE CITY.

CITY OF BEAUMONT.

WERE APPROVED.

1. SEWER SYSTEM CONSTRUCTION AND MATERIALS SHALL BE IN ACCORDANCE

WITH EASTERN MUNICIPAL WATER DISTRICT (EMWD'S) STANDARDS AND

GRAVITY SEWER PROFILE ELEVATIONS ARE TO FLOW LINE (CONDUIT INVERT).

CONTRACTOR HAS THE OPTION TO INSTALL PLASTIC OR VCP SEWERS EXCEPT

WHERE SPECIFICALLY DESIGNATED ON PLANS PER EMWD STANDARDS AND

DRAWINGS SB-53, SB-58, AND SB-61, AS APPLICABLE. SEWER MAINS MAY

BE LAID THROUGH THE MANHOLES AND USED AS A FORM FOR THE INVERT.

5. MANHOLES OF DEPTHS LESS THAN FIVE FEET FROM FINISH STREET GRADE TO

ALL LATERALS SHALL HAVE AN ON-SITE CLEANOUT IN ACCORDANCE WITH

AND/OR COMMERCIAL DEVELOPMENTS, THE REQUIREMENTS FOR SAMPLING

8. PRIOR TO CONSTRUCTION OF SEWER, CONTRACTOR SHALL EXPOSE EXISTING

CONNECTING TO EXISTING MANHOLES AND INLET STUB OF PROPER SIZE

STUB EXCEPT AS SPECIFICALLY AUTHORIZED BY THE CITY INSPECTOR.

9. ALL SEWER INLETS AT THE MANHOLE SHALL BE SUCH THAT ITS CROWN

10. RECONSTRUCTION OF EXISTING MANHOLES SHALL BE SCHEDULED AT THE

11. SEWER LATERALS SHALL BE CONSTRUCTED IN ACCORDANCE WITH SB-177.

LOCATIONS OF WYES AND LATERALS, WHERE NOT SHOWN ON THE PLANS,

ARE TO BE DETERMINED IN THE FIELD PRIOR TO CONSTRUCTION TO MISS

12. THE CONTRACTOR IS ADVISED THAT THE WORK ON THIS PROJECT MAY

14. BACKWATER VALVES SHALL BE INSTALLED PER SECTION 710.1 OF THE

PRIVATE ENGINEERS NOTICE TO CONTRACTOR(S)

1. THE EXISTENCE AND LOCATION OF ANY UNDERGROUND UTILITIES OR

EXISTING UTILITIES EXCEPT THOSE SHOWN ON THESE PLANS. THE

AND ANY DAMAGE TO, THESE LINES OR STRUCTURES

FOR ABSORPTION RESISTANCE PER EMWD'S SPECIFICATIONS.

INVOLVE WORKING IN A CONFINED AIR SPACE. CONTRACTOR SHALL BE

13. WHERE GROUNDWATER IS ENCOUNTERED, ALL VCP PIPE SHALL BE TREATED

15. ALL PIPE ZONE BEDDING AND TRENCH BACKFILL ARE TO BE PER STANDARD

STRUCTURES SHOWN ON THESE PLANS ARE OBTAINED BY A SEARCH OF

AVAILABLE RECORDS. TO THE BEST OF OUR KNOWLEDGE, THERE ARE NO

CONTRACTOR IS REQUIRED TO TAKE ALL PRECAUTIONARY MEASURES TO

SHOWN ON THESE PLANS AND IS RESPONSIBLE FOR THE PROTECTION OF.

2. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE OWNER OF

CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL QUANTITIES PRIOR

ASSURING THE ACCURACY AND ACCEPTABILITY OF THE DESIGN HEREON. IN

THE EVENT OF DISCREPANCIES ARISING AFTER CITY APPROVAL OR DURING

CONSTRUCTION, THE PRIVATE ENGINEER SHALL BE RESPONSIBLE FOR

DETERMINING AN ACCEPTABLE SOLUTION AND REVISING THE PLANS FOR

1. APPROVAL OF THESE PLANS APPLIES ONLY WITHIN THE JURISDICTION OF THE

COMPACTION REPORT IS SUBMITTED AND APPROVED BY THE PUBLIC WORKS

PLANS TO CONFORM WITH CURRENT STANDARDS AND TO POST A NEW BOND

IF CONSTRUCTION HAS NOT COMMENCED WITHIN TWO YEARS AFTER PLANS

4. SIDEWALK AND DRIVEWAY APPROACHES WILL BE POURED/CONSTRUCTED ONLY

TRENCHING FOR UTILITIES AND STRUCTURES IS NOT ALLOWED UNTIL SOIL

3. THE CITY RESERVES THE RIGHT TO REQUIRE REVISION OF THE APPROVED

AFTER DRIVEWAY LOCATIONS ARE DETERMINED.

ALL UTILITIES OR STRUCTURES CONCERNED BEFORE STARTING WORK.

4. THE PRIVATE ENGINEER SIGNING THESE PLANS IS RESPONSIBLE FOR

3. QUANTITIES SHOWN HEREON ARE PROVIDED FOR BIDDING PURPOSES ONLY.

PROTECT THE UTILITIES SHOWN, AND ANY OTHER LINES OR STRUCTURES NOT

DRIVEWAYS. ALL LATERALS ARE TO BE 4" IN DIAMETER UNLESS OTHERWISE

SHOWN ON PLANS. CONNECTIONS OF NEW LATERALS TO EXISTING SEWER ARE

RESPONSIBLE FOR "CONFINED AIR SPACE" ARTICLE 108, TITLE 8, CALIFORNIA

SHALL BE LEVEL WITH THE CROWN OF THE OUTLET PIPE, AT THEIR

EXISTS, NO ALTERATIONS SHALL BE MADE TO EXISTING MANHOLE BASE OR

CONVENIENCE OF THE CITY AND SHALL BE COMPLETED WITHIN FIVE WORKING

AND/OR PRETREATMENT FACILITIES SHALL BE DETERMINED BY CONTRACTING

STANDARD DRAWING SB-52. IN ADDITION, FOR LATERALS SERVING INDUSTRIAL

FORCE MAIN PROFILE ELEVATIONS ARE TO CENTIGRADE (CG).


4. MANHOLES SHALL BE CONSTRUCTED IN ACCORDANCE WITH STANDARD

SEWER PIPE SHELF ARE TO BE CONSTRUCTED IN ACCORDANCE WITH

7. MAINLINE CLEANOUTS, WHERE CALLED FOR ON THE PLANS, SHALL BE

CONSTRUCTED IN ACCORDANCE WITH STANDARD DRAWING SB-52.

SEWER AND VERIFY ITS EXISTING ELEVATION AND LOCATION. WHEN







Reviewed By: Recommended Date: 11/19/2021 for Approval By: Administrative Engineer Date: 11/23/2021 City Engineer/Director of Public Works

IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

CITY OF BEAUMONT, CALIFORNIA

SHEET

of <u>38</u> sheets

3387


TITLE SHEET

CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT ENGINEERING DIVISION TEL: (951) 769-8520 FAX: (951) 769-8526

AT&T TIME WARNER CABLE

(760) 340-2225

Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM Sam 8/23/2021

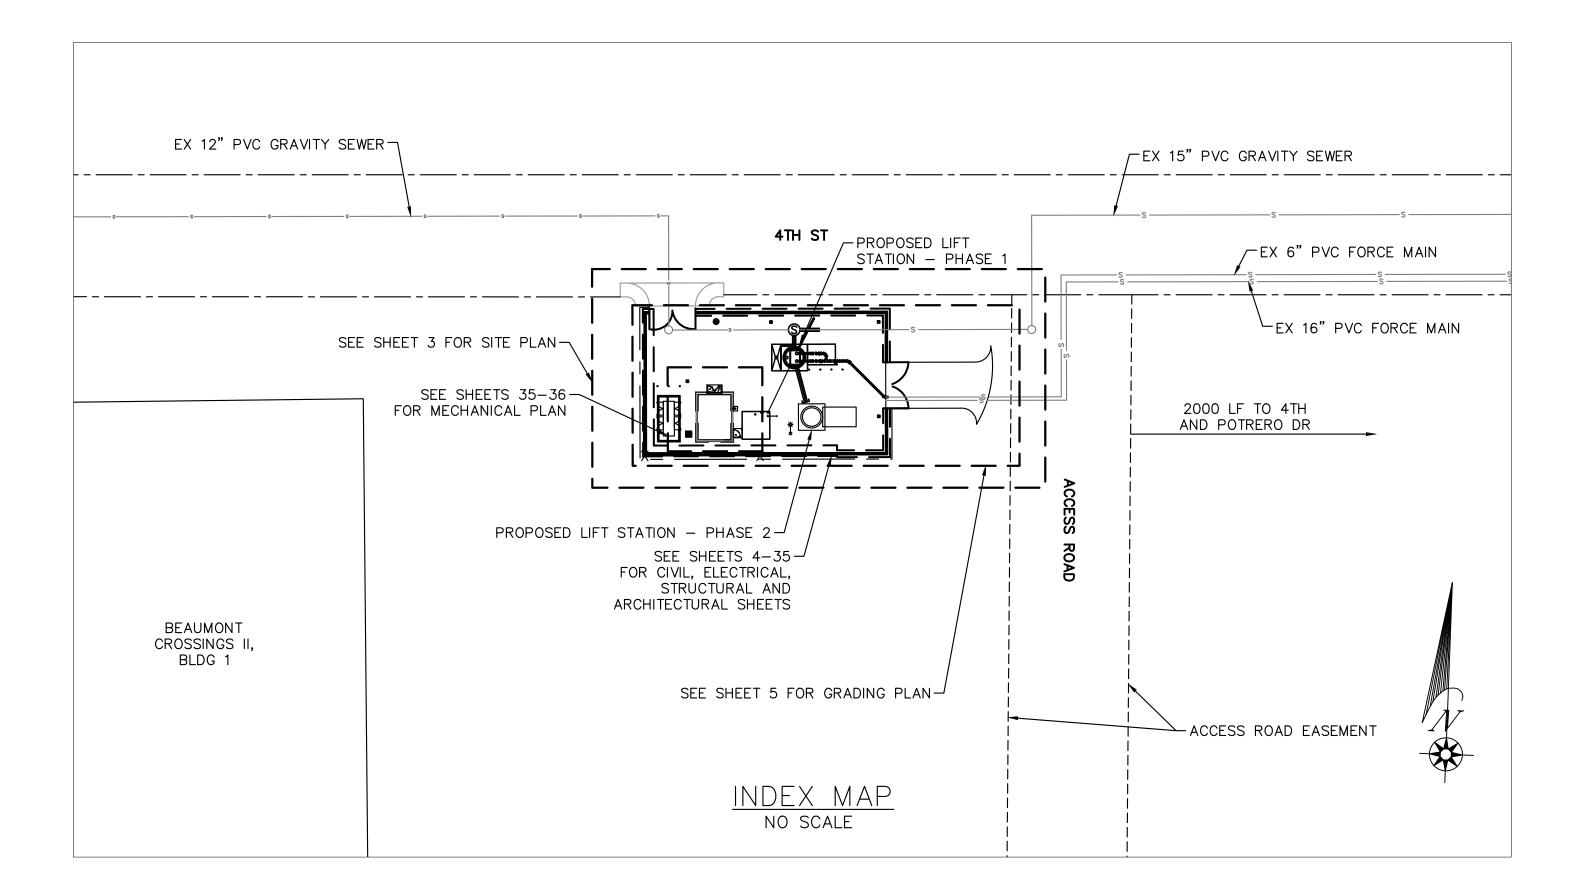

<u>LEGEND</u>

DESCRIPTION I	DWG. NO.	SYMBOL	QUANTITY
RIGHT-OF-WAY, R/W			
EASEMENT			
DAYLIGHT LINE			
PROP SEWER		s	
EXISTING SEWER		s	
PROP STORM DRAIN			
EXISTING STORM DRAIN			
PROP WATER		——————————————————————————————————————	
EXISTING WATER		w	
GAS		—— GAS ——— GAS ——	
SEWER MANHOLE		S	
PROP CONTOUR		53.0	
EXISTING CONTOUR		53.0	
PROPOSED WALL			
EXISTING WALL			
CURB & GUTTER			
CENTERLINE, CL			
CONCRETE			
AC PAVING			
ACCESS ROAD			
SITE LIGHT		•——————————————————————————————————————	
WATER METER		W	
BACKFLOW PREVENTION DEV	TICE	BW	
ELECTRICAL ANTENNA			
REMOVE EXISTING		$\cdot \times \cdot \times$	


ABBREVIATIONS


A.D.	ACCDECATE DACE
AB ASTM	AGGREGATE BASE AMERICAN SOCIETY FOR TESTING AND
	MATERIALS
AC BLDG	ASPHALTIC CONCRETE BUILDING
CF	CUBIC FEET
CMU	CONCRETE MASONRY UNIT
COMM CONC	COMMUNICATIONS CONCRETE
DI	DUCTILE IRON
DIP	DUCTILE IRON PIPE
DIA, D DR	DIAMETER DRIVE
DWG	DRAWING
DWY	DRIVEWAY
EG ELEC	EXISTING GRADE ELECTRIC/ELECTRICAL
ELEV	ELEVATION
EMWD	EASTERN MUNICIPAL WATER DISTRICT
EX FG	EXISTING FINISHED GRADE
FLG	FLANGE
FM	FORCE MAIN
GAL GPM	GALLONS GALLONS PER MINUTE
HORIZ	HORIZONTAL
HP	HORSEPOWER
HRS HWL	HOURS HIGH WATER LEVEL
ID	INNER DIAMETER
IE IBC	INVERT ELEVATION
IPS LF	IRON PIPE SIZE LINEAR FEET
LOL	LAYOUT LINE
LT LWL	LEFT LOW WATER LEVEL
MAX	MAXIMUM
MCC	MOTOR CONTROL CENTER
ME MH	MATCH EXISTING MANHOLE
MIN	MINIMUM
NO.	NUMBER
N.T.S. O.C.	NOT TO SCALE ON CENTER
PC	POINT OF CURVATURE
PE	PLAIN END
Pl P/L	POINT OF INTERSECTION PROPERTY LINE
PROP	PROPOSED
PSI	POUNDS PER SQUARE INCH
PVC R/W	POLYVINYL CHLORIDE RIGHT—OF—WAY
RCFC&WCD	RIVERSIDE COUNTY FLOOD CONTROL AND
	WATER CONSERVATION DISTRICT
RCP RPM	REINFORCED CONCRETE PIPE REVOLUTIONS PER MINUTE
RTU	REMOTE TELEMETRY UNIT
SCH	SCHEDULE
SDR SS	STANDARD DIMENSION RATIO STAINLESS STEEL
ST	STREET
STL	STEEL
STD SWR	STANDARD SEWER
TDH	TOTAL DYNAMIC HEAD
TF	TOP OF PURE
TP TW	TOP OF PIPE TOP OF WALL
TYP	TYPICAL
V	VOLT
VOL VERT	VOLUME VERTICAL
- - · · ·	<u>-</u>



	BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST)						Kimley» Horn	SEAL
/S	SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH						401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM	REG1S7FO
/3	SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH	ВУ	MADIC	DESCRIPTION.	APPR.	DATE	San Market	S. S.
	A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)		MARK INEER	DESCRIPTION REVISIONS		ITY	SAM L. MCWHORTER 8/23/2021 R.C.E. 61788	



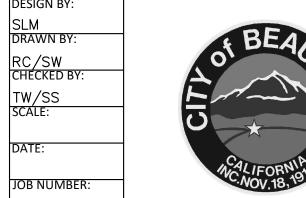


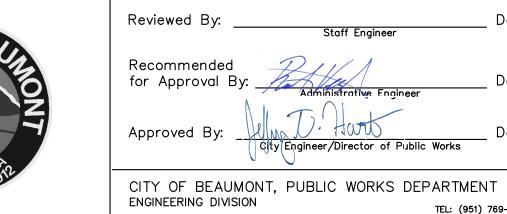



ewed By:	Date:	CITY OF BEAUMONT, CALIFORNIA
Staff Engineer		IMPROVEMENT PLANS FOR:
Approval By: Administrative Engineer oved By: City Engineer/Director of Public Works	Date: 11/19/2021 Date: 11/23/2021	BEAUMONT CROSSROAD LIFT STATION
OF BEAUMONT, PUBLIC WORKS DEPARTMEN EERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769–8520 FAX: (951) 769–8526	INDEX MAP


ROSSROADS ATION

of <u>38</u> sheets 3387

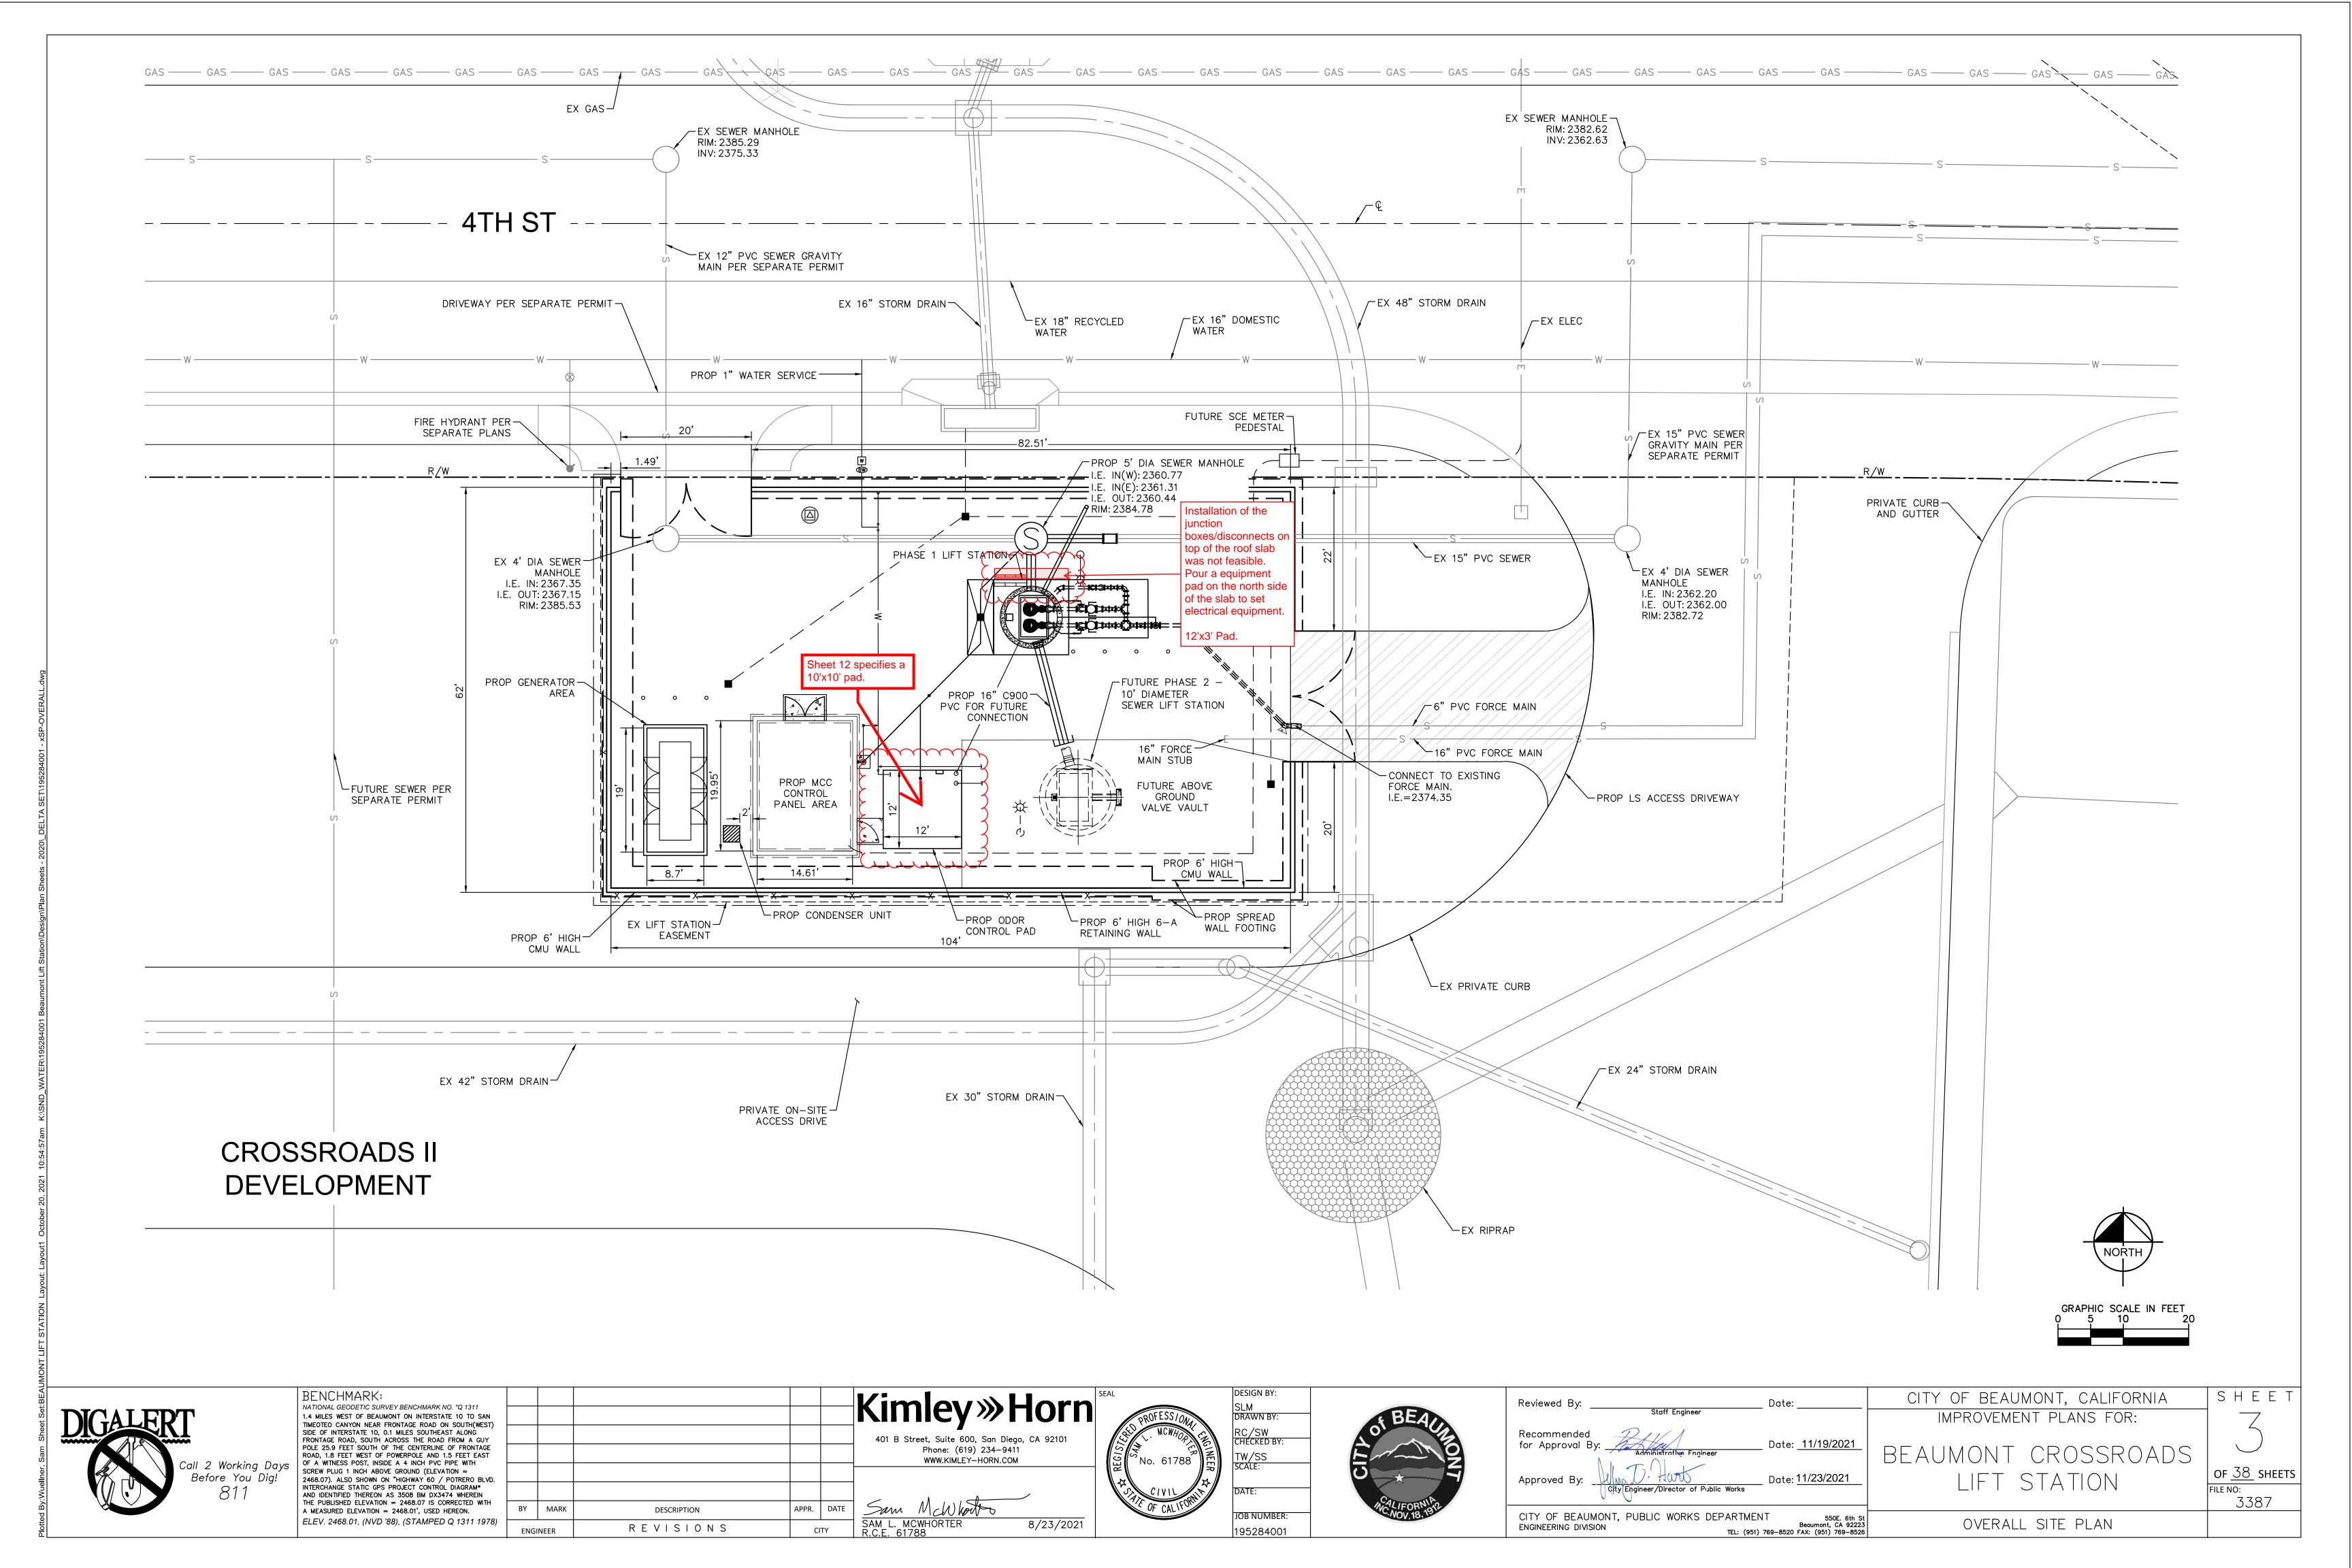

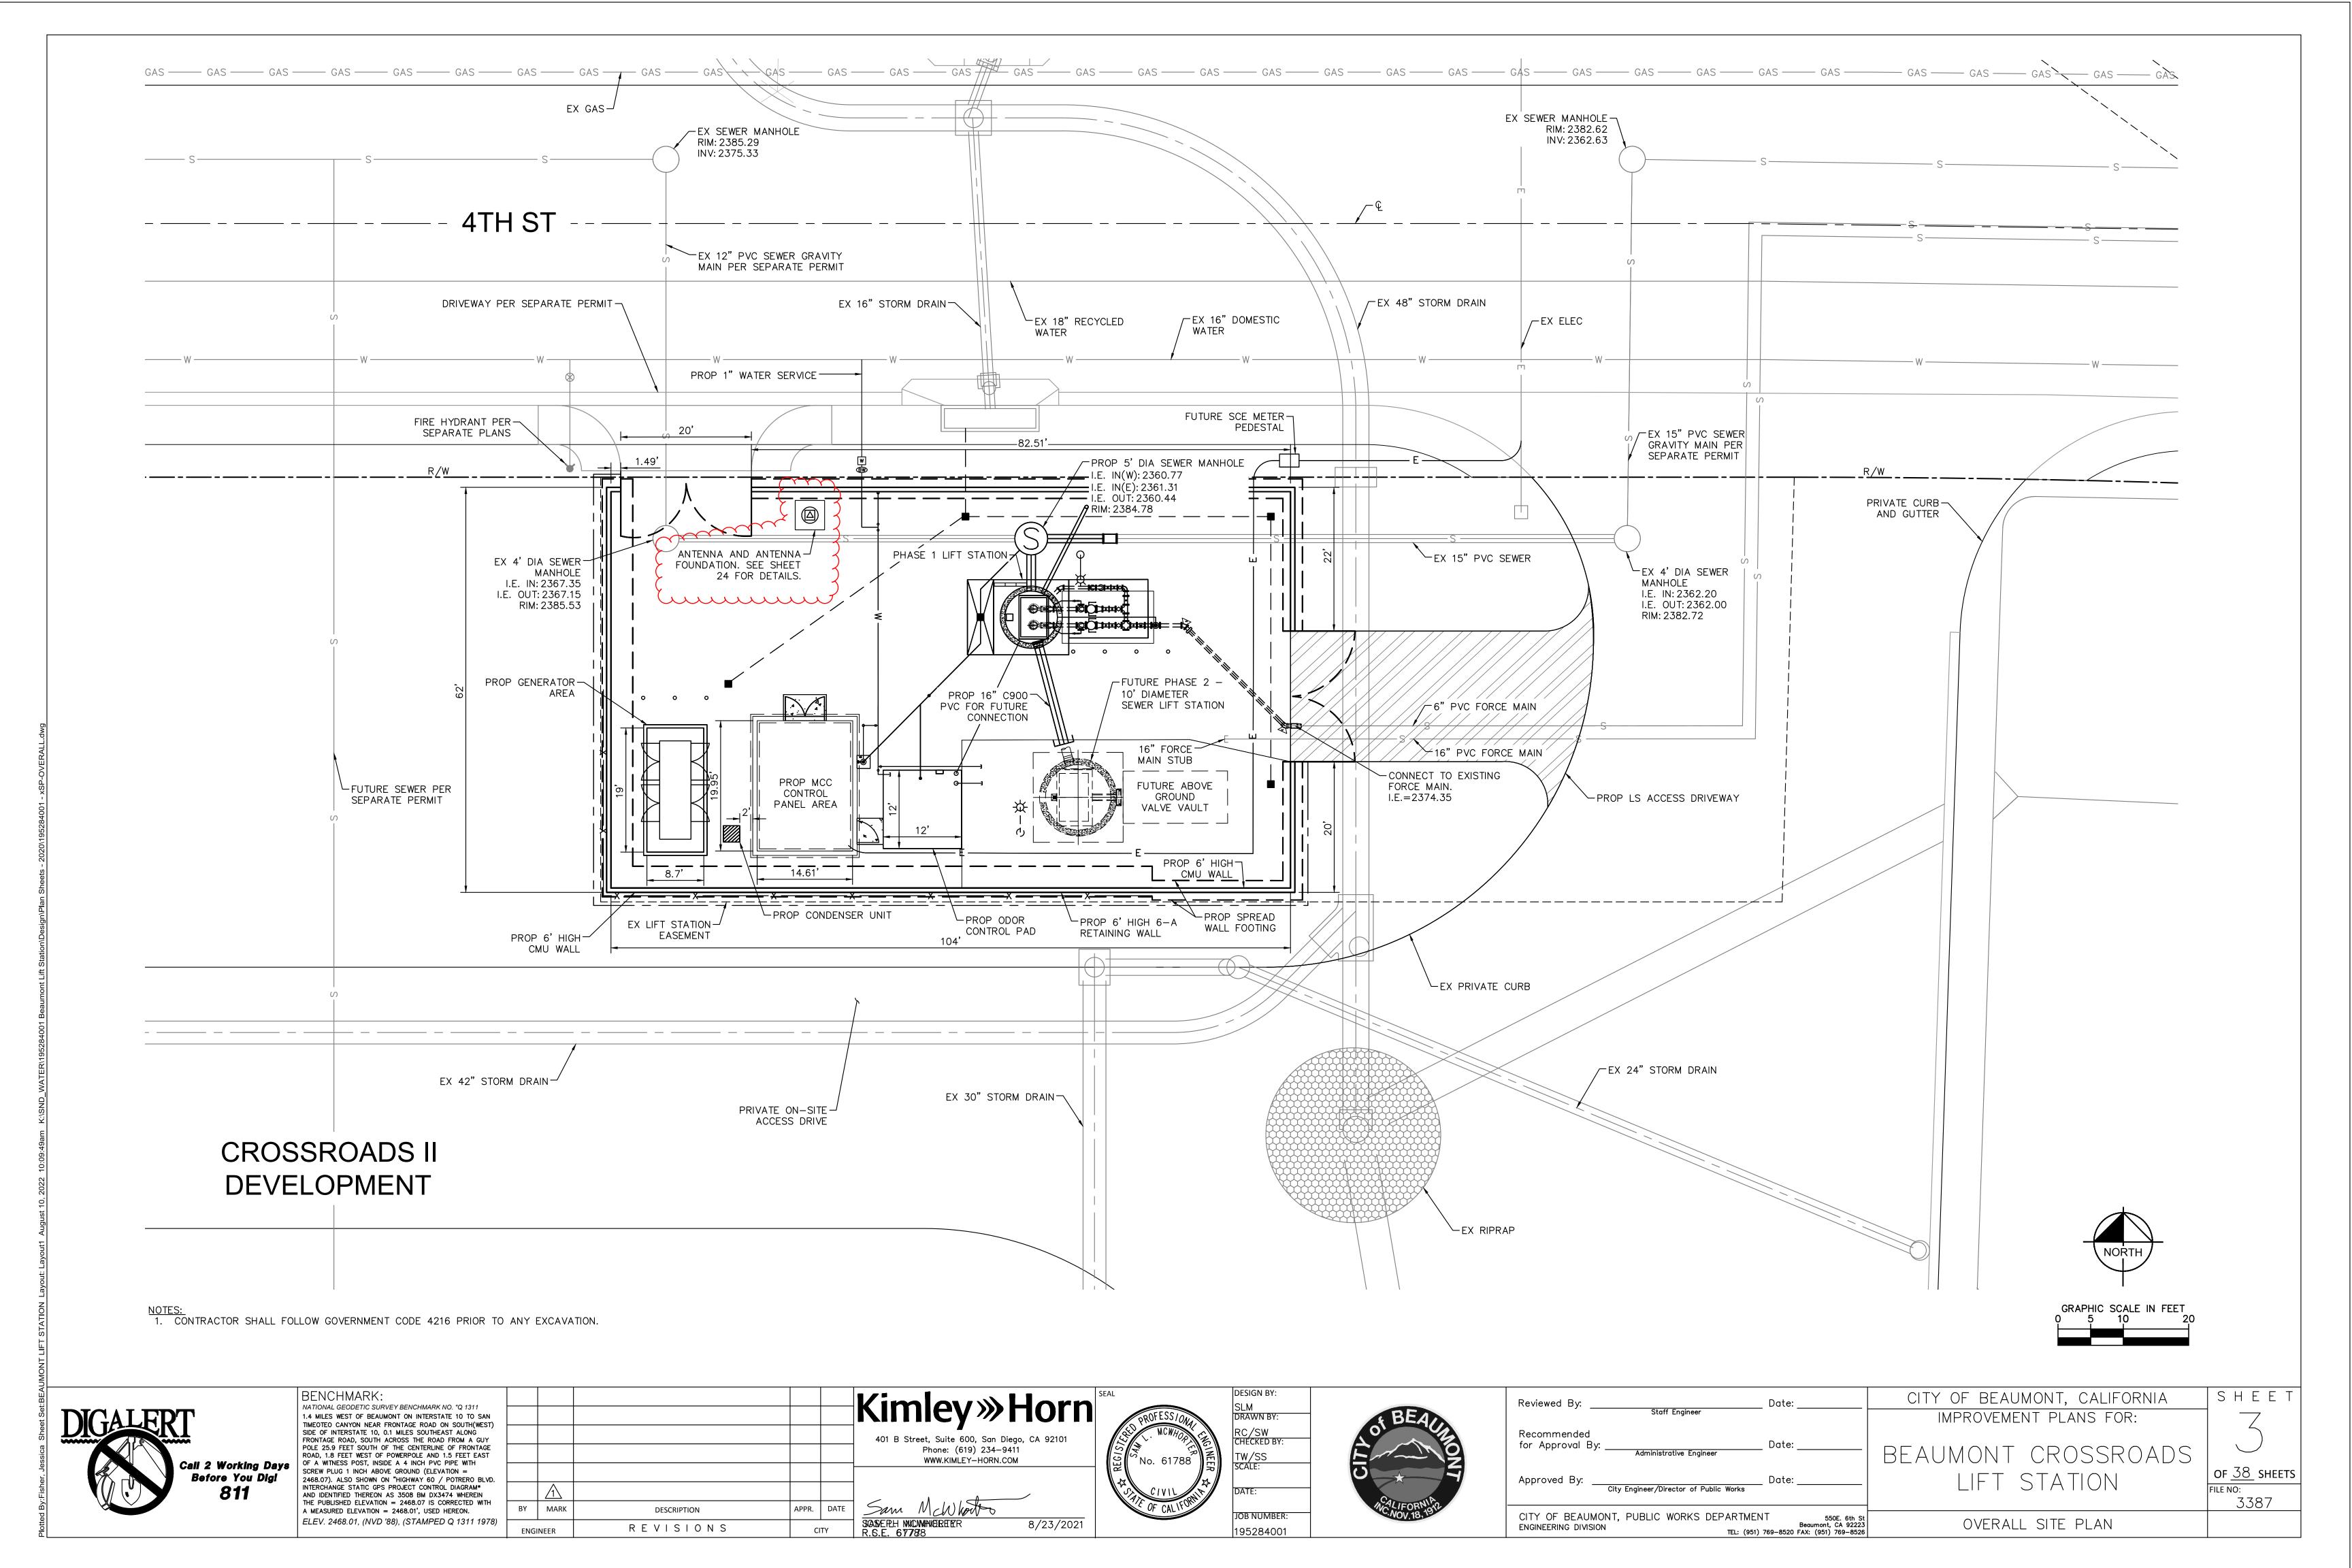

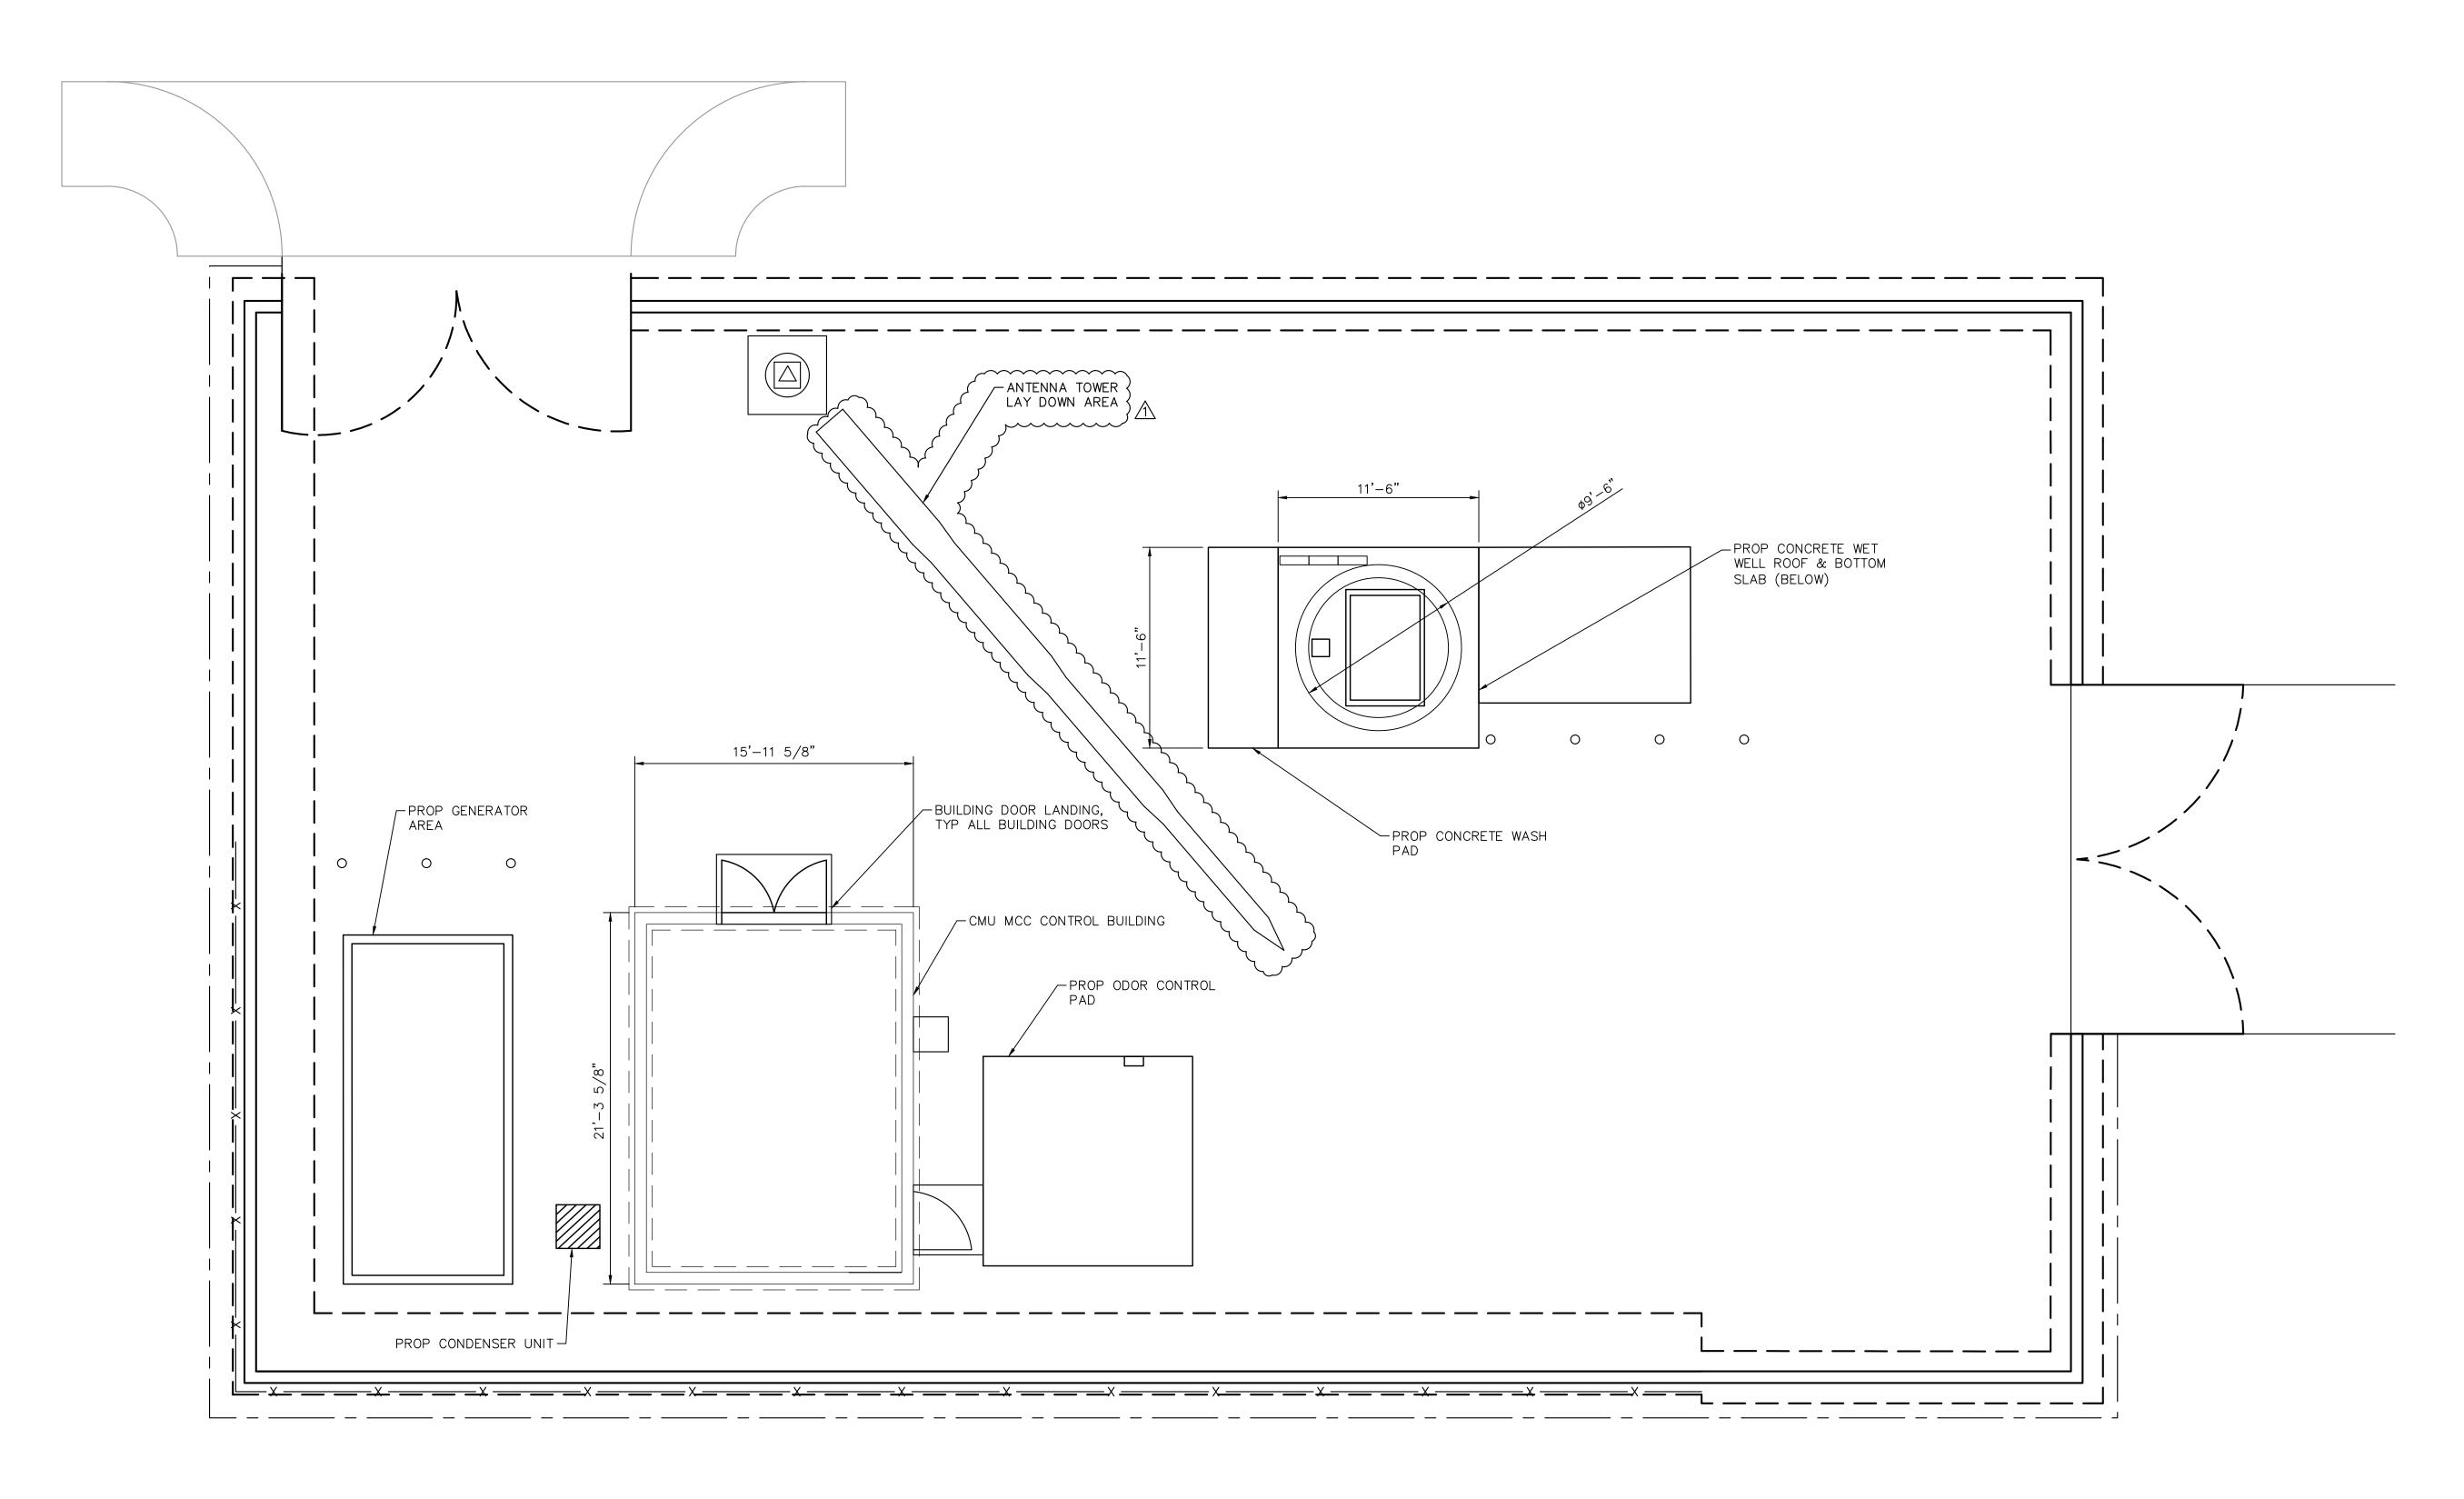





DICAI EDT	BE NA 1.4
DIGALCKI	TIM SID FRO
Call 2 Working Days	POI ROA OF
Before You Dig! 811	SCF 246 INT
	THE


BENCHMARK:


NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311

1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON. BY MARK DESCRIPTION CITY R.S.E. 6777 ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978) 08/09/2022

REVISIONS



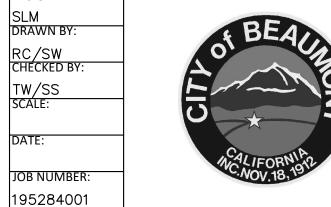

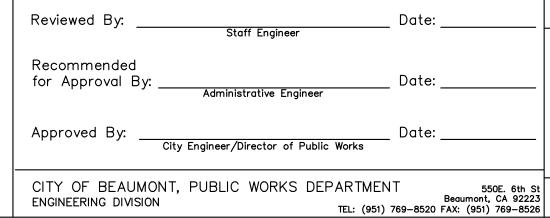

CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

STRUCTURAL SITE PLAN

of <u>38</u> sheets 3387

1.00 DOCUMENTS AND LIMITATIONS

- THESE STRUCTURAL DOCUMENTS. TOGETHER WITH THE CONCEPTS AND DESIGNS PRESENTED HEREIN. AS AN INSTRUMENT OF SERVICE, ARE INTENDED ONLY FOR THE SPECIFIC PURPOSE AND CLIENT FOR WHICH IT WAS PREPARED. REUSE OF AND IMPROPER RELIANCE ON THIS DOCUMENT WITHOUT WRITTEN AUTHORIZATION AND ADAPTATION BY KIMLEY-HORN AND ASSOCIATES, INC. SHALL BE WITHOUT LIABILITY TO KIMLEY-HORN AND ASSOCIATES, INC.
- 1.02 IT IS UNDERSTOOD THAT THE CONSULTANT MAKES NO WARRANTY, EITHER EXPRESSED OR IMPLIED, AS TO FINDINGS, DESIGNS, RECOMMENDATIONS, SPECIFICATIONS, OPINION, OR PROFESSIONAL ADVICE, EXCEPT THAT THESE INSTRUMENTS OF SERVICE HAVE BEEN PREPARED IN ACCORDANCE WITH THE CURRENT GENERALLY ACCEPTED PROFESSIONAL ENGINEER PRACTICES.
- 1.03 ALL NON-STRUCTURAL ELEMENTS INDICATED ON THE STRUCTURAL DRAWINGS HAVE BEEN SHOWN IN GENERAL TO THE RELATIONSHIP TO THE STRUCTURAL ELEMENTS ONLY. ACCORDINGLY, THEY SHALL NOT BE ASSUMED TO BE ACCURATE AND REFERENCE MUST BE MADE TO THE APPROPRIATE CONSULTANT(S), PLANS, AND SPECIFICATIONS.
- 1.04 NOTES ON THIS AND THE FOLLOWING SHEETS ARE PART OF THE PROJECT REQUIREMENTS BUT ARE NOT INTENDED TO REPLACE THE PROJECT SPECIFICATIONS. IN CASE OF CONFLICTS BETWEEN THE REQUIREMENTS OF THE SPECIFICATIONS AND THESE NOTES, THE MORE STRINGENT REQUIREMENT SHALL APPLY.

2.00 CONSTRUCTION SAFETY

- 2.01 IT IS UNDERSTOOD THAT THE CONTRACTOR IS SOLELY RESPONSIBLE FOR INITIATING, MAINTAINING. AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK ON THE PROJECT. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS FOR THE SAFETY OF THE PERSONS AND PROTECT THEM AGAINST INJURY. LIKEWISE, THE CONTRACTOR SHALL PROTECT ALL PROPERTY AGAINST DAMAGE
- THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE LAWS, ORDINANCES, RULES, REGULATIONS, AND ORDERS OF ANY PUBLIC BODY HAVING JURISDICTION FOR THE SAFETY OF PERSONS OF PROPERTY.
- THE CONTRACTOR'S DUTIES AND RESPONSIBILITIES FOR THE SAFETY AND PROTECTION OF THE WORK SHALL CONTINUE UNTIL SUCH TIME AS THE WORK IS SATISFACTORILY COMPLETED, AND THE ENGINEER OF RECORD HAS ISSUED A NOTICE TO THAT EFFECT TO THE OWNER AND THE CONTRACTOR.

3.00 REINFORCED CONCRETE (CAST-IN-PLACE)

- 3.01 DETAILING OF REBAR SHALL BE IN ACCORDANCE WITH THE LATEST REVISION OF THE ACI DETAILING MANUAL, AND CONCRETE REINFORCING INSTITUTE'S LATEST EDITION OF "MANUAL OF STANDARD PRACTICE". ALL SHOP DRAWINGS PERTAINING TO REBAR DETAILS SHALL BE SUBMITTED TO THE ENGINEER FOR HIS REVIEW.
- 3.02 CONCRETE COMPRESSIVE DESIGN STRENGTH IN 28 DAYS:
- 3.03 REINFORCING STEEL SHALL BE ASTM A615, GRADE 60 UNLESS NOTED OTHERWISE. IF REINFORCEMENT WELDING IS REQUIRED, ASTM A706, GRADE 60 SHALL BE REQUIRED UNLESS MILL TEST REPORTS VERIFY THAT THE ASTM A615 STEEL PROVIDED IS AN ACCEPTABLE A706 EQUIVALENT. WELDED WIRE FABRIC OR WIRE MESH SHALL BE ASTM A185.
- TOLERANCES FOR REINFORCEMENT FABRICATION, REINFORCEMENT PLACEMENT AND CONCRETE CONSTRUCTION SHALL CONFORM TO THE LATEST EDITION OF ACI 117 "SPECIFICATIONS FOR TOLERANCES FOR CONCRETE CONSTRUCTION AND MATERIALS."
- 3.05 BAR DETAILS AND SUPPORTS: ACI DETAILING MANUAL AND BUILDING CODE. LAP ALL SPLICES AS SHOWN ON THE STRUCTURAL DRAWINGS.
- 3.06 CLEAR DISTANCE FROM FACE OF CONCRETE TO MAIN STEEL SHALL BE AS SHOWN ON THE STRUCTURAL DRAWINGS. WHERE CLEAR DISTANCE IS NOT SHOWN, ACI 301 SHALL CONTROL.
- ALL REINFORCEMENT SHOWN IS INTENDED TO BE CONTINUOUS UNLESS NOTED OTHERWISE. REFER TO REINFORCEMENT STEEL CHART FOR TENSION LAP SPLICES.
- PROVIDE 3/4 INCH CHAMFERS AT ALL EXPOSED EDGES UNO.
- CORE DRILLING SHALL NOT BE ALLOWED THROUGH IN-PLACE CONCRETE ELEMENTS UNLESS SPECIFICALLY APPROVED BY THE ENGINEER. PENETRATIONS THROUGH CONCRETE ELEMENTS SHALL BE ILLUSTRATED ON SHOP DRAWINGS AND SHALL UTILIZE SCHEDULE 40 STEEL PIPE. CLEARANCE REQUIRED WITHIN PIPE SLEEVE SHALL BE CONFIRMED BY SUBCONTRACTOR RESPONSIBLE FOR THE MATERIAL PASSING THROUGH THE SLEEVE. REINFORCEMENT CLEAR COVER SHALL BE MAINTAINED AROUND THE SLEEVE PENETRATION
- EMBEDDED ITEMS THAT WILL SUPPORT STRUCTURAL STEEL CONSTRUCTION SHALL BE PLACED WITHIN THE TOLERANCES PRESCRIBED IN THE 3.10 LATEST EDITION OF THE AISC "CODE OF STANDARD PRACTICE". GENERAL CONTRACTOR SHALL FIELD VERIFY LOCATION OF EMBEDDED ITEMS PRIOR TO FABRICATION AND DELIVERY OF STRUCTURAL STEEL TO THE PROJECT SITE.

4.00 ALUMINUM

- 4.01 ALUMINUM CONSTRUCTION SHALL CONFORM TO THE LATEST EDITION OF THE ALUMINUM CONSTRUCTION MANUAL OF THE ALUMINUM
- 4.02 UNLESS OTHERWISE INDICATED, STRUCTURAL ALUMINUM SHALL BE ALLOY 6061-T6 AS SPECIFIED IN ASTM B308.
- 4.03 CONTACT SURFACES SHALL BE COATED WITH HEAVY ALKALI-RESISTANT BITUMINOUS PAINT.

5.00 STRUCTURAL STEEL

- 5.01 DESIGN, FABRICATION AND ERECTION SHALL BE IN ACCORDANCE WITH AISC 360-16 "SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS".
- 5.02 ALL STRUCTURAL STEEL SHOWN ON PLANS SHALL CONFORM TO ASTM A36 WITH THE EXCEPTION OF STRUCTURAL TUBING WHICH SHALL CONFORM TO ASTM
- A500 GRADE C (50 KSI). STEEL AND HARDWARE SHALL BE HOT-DIP GALVANIZED UNLESS NOTED OTHERWISE. 5.03 ALL WELDS SHALL BE PERFORMED BY CERTIFIED WELDERS AND SHALL CONFORM TO REQUIREMENTS OF AWS D1.2.
- 5.04 ALL EMBED PLATES SHALL BE OVER-SIZED TO ACCOUNT FOR PRECST AND STRUCTURAL STEEL FABRICATION AND ERECTION TOLERANCES. EMBEDS SHALL EXTEND A MINIMUM OF 3" BEYOND THE CONNECTION ELEMENT ON ALL SIDES, UNLESS EXPLICITLY DETAILED OTHERWISE.

MINNE MARKET PROBLEM P

6.00 DESIGN LOADS

- 6.01 2019 CALIFORNIA BUILDING CODE
- 6.02 BUILDING CATEGORY = II
- 6.03 ANTENNA TOWER LOADING:
- A. DEAD: SELF WEIGHT OF MEMBERS
- B. LIVE: N/A C. SNOW: N/A
- DESIGN LOAD BASED ON ASCE 7-16 CHAPTER 29 PART 4
 - WIND SPEED = 95 MPH (3 SEC GUST) EXPOSURE CATEGORY = C
- E. SEISMIC: DESIGN LOAD BASED ON ASCE 7-16 CHAPTER 15
 - SITE CLASS = D (DEFAULT) Sd1 = 0.756SEISMIC DESIGN CATEGORY = D NON-BUILDING STRUCTURE TYPE: TRUSSED TOWERS

ANALYSIS METHOD = EQUIVALENT LATERAL FORCE PROCEDURE

- BASE SHEAR: V = 0.054 KIPS
- ALLOWABLE SOIL BEARING PRESSURE = 1500 PSF F. SOIL:
- LATERAL BEARING PRESSURE = 100 PSF/FT COEFFICIENT OF SOIL FRICTION = 0.25

SCHEDULE OF SPECIAL INSPECTION SERVICES					
ITEM	QUALIFICATIONS	SCOPE			
1. WELDING	AWS-CWI ASNT	 CONTINUOUS INSPECTION WELDING IN ACCORDANCE WITH CBC TABLE 1704.3 COLLECT CERTIFICATION OF COMPLIANCE FOR WELD FILLER MATERIAL COLLECT CERTIFICATION OF WELDERS IDENTIFY USE OF APPROVED FILLED MATERIAL AND IN ACCORDANCE WITH AWS D1.1, AWS D1.3, OR AWS D1.4, AS REQUIRED BY NCSBC TABLE 1704.3 			
1. MIX DESIGN / MATERIAL CERTIFICATION	ACI-CCI ICC-RCSI / SER	PERIODIC INSPECTION, VERIFY USE OF REQUIRED DESIGN MIX			
2. REINFORCEMENT INSTALLATION	SER / ACI-CCI ICC-RCSI	 PERIODIC INSPECTION, PRIOR TO EACH POUR, OF REINFORCING STEEL AND WELDED WIRE FABRIC COLLECTION AND REVIEW OF CERTIFIED MILL TEST REPORTS 			
3. CONCRETE PLACEMENT/ MONITORING FRESH CONCRETE, SAMPLING & PREP OF TEST SAMPLES	ACI-CCI ICC-RCSI ACI-CFTT ACI-STT	 CONTINUOUS INSPECTION OF CAST-IN-PLACE CONCRETE PLACEMENT CONTINUOUS MONITORING OF SAMPLING OF FRESH CONCRETE, SLUMP TEST, AIR CONTENT TEST, AND CREATION OF STRENGTH TEST SPECIMENS PERIODIC INSPECTION OF MAINTAINING SPECIFIED CURING TEMPERATURE AND TECHNIQUES CONTINUOUS INSPECTION OF BOLTS AND EMBEDS TO BE INSTALLED IN CONCRETE PRIOR TO AND DURING PLACEMENT 			
4. EVALUATION OF CONCRETE STRENGTH	PE/ SER	COLLECT AND REVIEW CONCRETE STRENGTH TEST REPORTS AND NOTIFY SEOR OF FAILING TESTS			

90 DEG STD HOOKS

	f'c = 4 KSI	f'c = 5 KSI	f'c = 7 KSI	f'c = 9 KSI
BAR SIZE	(IN)	(IN)	(IN)	(IN)
#3	8	7	6	6
#4	10	9	8	7
#5	12	11	9	8
#6	15	13	11	10
#7	17	15	13	12
#8	19	17	15	13
#9	22	20	17	15
#10	25	22	19	17
#11	27	24	21	18

NOTES:

- 1. VALUES ASSUME NO EPOXY-COATING IS USED AND NORMAL WEIGHT AGGREGATE
- CONCRETE. NO REDUCTION FACTORS IN ACI 318, SECTION 12.5.3 ARE APPLIED TO THESE VALUES.
- THE HOOK DEVELOPMENT LENGTH SHALL NOT BE LESS THAN 8*BAR DIA. 4. 90° STD HOOK SHALL BE BEND PLUS 12*BAR DIA EXTENSION AT FREE END.

	T	T	$+$ \prec
ITEM	QUALIFICATIONS	SCOPE	
1. WELDING	AWS-CWI ASNT	 CONTINUOUS INSPECTION WELDING IN ACCORDANCE WITH CBC TABLE 1704.3 COLLECT CERTIFICATION OF COMPLIANCE FOR WELD FILLER MATERIAL COLLECT CERTIFICATION OF WELDERS IDENTIFY USE OF APPROVED FILLED MATERIAL AND IN ACCORDANCE WITH AWS D1.1, AWS D1.3, OR AWS D1.4, AS REQUIRED BY NCSBC TABLE 1704.3 	
1. MIX DESIGN / MATERIAL CERTIFICATION	ACI-CCI ICC-RCSI / SER	PERIODIC INSPECTION, VERIFY USE OF REQUIRED DESIGN MIX	
2. REINFORCEMENT INSTALLATION	SER / ACI-CCI ICC-RCSI	 PERIODIC INSPECTION, PRIOR TO EACH POUR, OF REINFORCING STEEL AND WELDED WIRE FABRIC COLLECTION AND REVIEW OF CERTIFIED MILL TEST REPORTS 	
3. CONCRETE PLACEMENT/ MONITORING FRESH CONCRETE, SAMPLING & PREP OF TEST SAMPLES	ACI-CCI ICC-RCSI ACI-CFTT ACI-STT	 CONTINUOUS INSPECTION OF CAST-IN-PLACE CONCRETE PLACEMENT CONTINUOUS MONITORING OF SAMPLING OF FRESH CONCRETE, SLUMP TEST, AIR CONTENT TEST, AND CREATION OF STRENGTH TEST SPECIMENS PERIODIC INSPECTION OF MAINTAINING SPECIFIED CURING TEMPERATURE AND TECHNIQUES CONTINUOUS INSPECTION OF BOLTS AND EMBEDS TO BE INSTALLED IN CONCRETE PRIOR TO AND DURING PLACEMENT 	
EVALUATION OF CONCRETE STRENGTH	PE/ SER	COLLECT AND REVIEW CONCRETE STRENGTH TEST REPORTS AND NOTIFY SEOR OF FAILING TESTS	

DL

EOR

EOS

GR BM

G	ABOVE FINISHED GRADE	L
S	ABOVE FINISHED SLAB	LBS
GR	AGGREGATE	LD
LOW	ALLOWANCE	LF
Т	ALTERNATE	LL
PROX	APPROXIMATE	LLH
CH	ARCHITECT, ARCHITECTURAL	LLV
	,	LN
·	BACK OF CURB	LTL
	BOTH FACES	
DG	BUILDING	M
1	BEAM; BENCHMARK	MAS
)T	BOTTOM	MATL
WN	BETWEEN	MAX
/	BOTH WAYS	MBR
		MEAS
ιG	CURB AND GUTTER	MECH
NTIL	CANTILEVER	MFR
:W	COUNTERCLOCKWISE	MIN
)	CONSTRUCTION DOCUMENTS	MISC
ΞM	CEMENT	MULT
SS	CENTER OF GRAVITY OF STRAND	
5	CAST-IN-PLACE	N
	CONSTRUCTION JOINT	NA
	CENTERLINE	NF
G	CEILING	NIC
L	COLUMN LINE	NO
R	CLEAR	NOM
1U	CONCRETE MASONRY UNIT	NORM
)L	COLUMN	NTS
NC	CONCRETE	
NN	CONNECTION	OC
NSTR	CONSTRUCTION	OD
NT	CONTINUE; CONTINUOUS	OF
ORD	COORDINATE	OPNG
V	COVER	OPP
C	CENTER TO CENTER	ОТО
R	CENTER	
RL JT	CONTROL JOINT	PAR
V	CLOCKWISE	PCC
		PCF
	DEPTH	PEMB
3	DESIGN-BUILD	PERP
FL	DEFLECTION	PL
:G	DEGREE	PRCST
:L	DELETE	PRELIM
MO	DEMOLITION	PRKG
:T	DETAIL	PROJ
_		

ARCHITECT/ENGINEER

ABOVE FINISHED FLOOR

AGGREGATE BASE COURSE

ANCHOR BOLT

ACCESSIBLE

ADDITIONAL

ADDENDUM

ADJACENT

DIAMETER DIAGONAL PS CONC DIMENSION DIRECTION DEAD LOAD PT CONC DRAIN; DRIVE DESIGN QUARTER DRAWING DOWEL(S) REINFORCED CONCRETE EAST RCB REINFORCED CONCRETE BOX EACH RCP REINFORCED CONCRETE PIPE EDGE OF CURB ROOF DRAIN EACH END REBAR REINFORCING STEEL BAR REF EACH FACE REFERENCE **EXPANSION JOINT** REINFORCEMENT EACH LAYER; ELEVATION REP REPAIR **ELEVATOR** REPL REPLACE **EMBED EMBEDMENT** REQD REQUIRED **ENGR ENGINEER** REV REVISION **ENTR ENTRANCE** REQUEST FOR INFORMATION RFP REQUEST FOR PROPOSAL ENGINEER OF RECORD RETAINING WALL EDGE OF SLAB RT/W **EQUAL** EQUALLY SPACED SOUTH **EQUIPMENT** SCHED SCHEDULE

EQL SP **EQUIP** ESP EXPANSION; EXPOSED EST **ESTIMATE** EW **EACH WAY** EX / EXIST **EXISTING EXPANSION BOLT** EXP BT EXP JT **EXPANSION JOINT** EXST GR **EXISTING GRADE** EXT **EXTERIOR** EXTN EXTENSION FD FLOOR DRAIN FDTN FOUNDATION FINISH FACE FF EL FINISH FLOOR ELEVATION FINISH FIN FLR FINISH FLOOR FIN GR FINISH GRADE FLR FLOOR FACE OF CONCRETE FACE OF MASONRY FACE OF WALL FRAME FRAMING FEET; FOOT FACE TO FACE FTG FOOTING **FWRK** FORMWORK GIRDER; GROUND GAGE GALV GALVANIZED GENERAL CONTRACTOR GEN GENERAL

GR FL **GROUND FLOOR** HDG HOT-DIP GALVANIZING HOOK HORIZ HORIZONTAL **HEADED STUD** HEIGHT INSIDE DIAMETER (DIMENSION) INSIDE FACE INFORMATION INTERIOR

ISOLATION JOINT

JOIST

GROUND LEVEL

GRADE BEAM

SHOP DRAWINGS; SCHEMATIC DESIGN; SHORT DIRECTION SD SEC SECTION SIMILAR SNOW LOAD **SLAB-ON-GRADE** SP EL SPOT ELEVATION SPA SPACES SPEC SPECIFICATION SQ SQUARE STD STANDARD STL STEEL STEEL JOIST STL JST STOR STORAGE STRUCT STRUCTURAL T&B TOP AND BOTTOM THROUGH BOLT TB TOP ELEVATION TEMP TEMPERATURE; TEMPORARY TFF TOP OF FINISH FLOOR THICKNESS THROUGH TOP OF TO FDN TOP OF FOUNDATION TOB TOP OF BEAM TOC TOP OF CONCRETE (CURB) TOC FTG TOP OF CONCRETE FOOTING TOC WALL TOP OF CONCRETE WALL TOF TOP OF FLOOR (FOOTING) TOM TOP OF MASONRY TOS TOP OF SLAB TOW TOP OF WALL TYP TYPICAL UNIFORM UNLESS NOTED OTHERWISE UNO SHEAR VAR VARIES **VEHICLE** VEH **VERT** VERTICAL **VERIFY IN FIELD** WEST WITH WITHOUT W/W WALL TO WALL WIDE FLANGE WIND LOAD WATERPROOFING WELDED WIRE FABRIC

JOINT THOUSAND POUNDS KIPS PER LINEAR FOOT KIPS PER SQUARE FOOT KIPS PER SQUARE INCH KWY **KEYWAY** ANGLE POUNDS LONG DIRECTION LINEAR FEET (FOOT) LIVE LOAD LONG LEG HORIZONTAI LONG LEG VERTICAL LINTEL MOMENT MASONRY MATERIAL MAXIMUM MEMBER MEASURE **MECHANICAL** MANUFACTURER MINIMUM MISCELLANEOUS MULTIPLE NORTH NOT APPLICABLE **NEAR FACE** NOT IN CONTRACT NUMBER NOMINAL NORMAL NOT TO SCALE ON CENTER **OUTSIDE DIAMETER (DIMENSION)** OUTSIDE FACE OPENING OPPOSITE OUT TO OUT PARALLEL PRECAST CONCRETE POUNDS PER CUBIC FOOT PRE-ENGINEERED METAL BUILDING PERPENDICULAR PLATE; PROPERTY LINE PRECAST PRELIMINARY PARKING PROJECT PROPERTY PRESTRESSED CONCRETE POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH POST TENSIONED POST TENSIONED CONCRETE

BEAUMONT

4637 CHABOT DR

SUITE 300

PLEASANTON, CA 94588

PHONE: 925.398.4840

This document is an instrument of service prepared solely for

Kimley-Horn's client and for a particular purpose. Any other

use or reliance is without liability to Kimley-Horn.

SEALS

OWNER/APPLICANT MCDONALD PROPERTY GROUP 1140 N. COAST HIGHWAY LAGUNA BEACH, CA 92651

	1		PLAN CHECK COMMENTS
	0	07/07/22	ISSUED FOR PERMIT
	NO:	DATE	DRAWING ISSUE DESCRIPT
	DES	IGNED BY	/: BC
	DRA	WN BY:_	ВС

CHECKED BY: BC

DATE: 07/07/2022


PROJECT NO: 123456

SCALE:


STRUCTURAL **GENERAL NOTES**

Project Status


S001

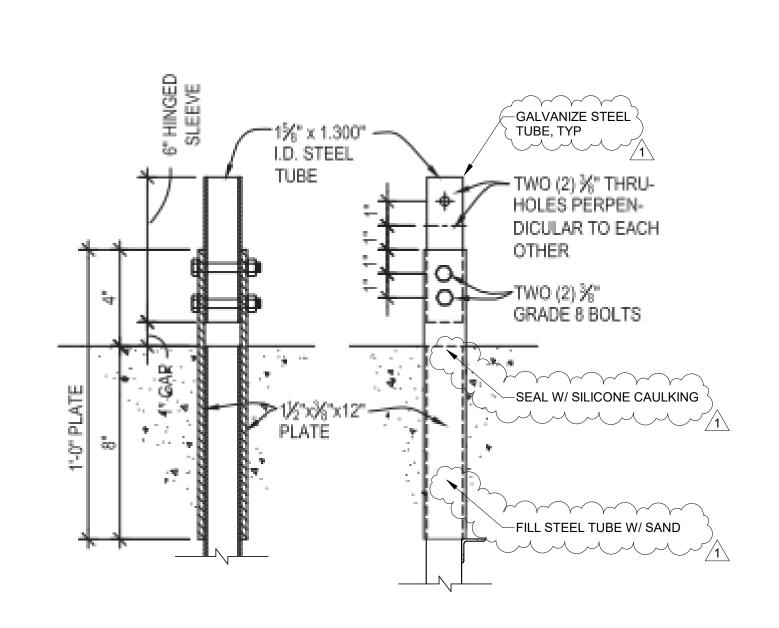


BASE CONNNECTION DETAIL SCALE: NTS

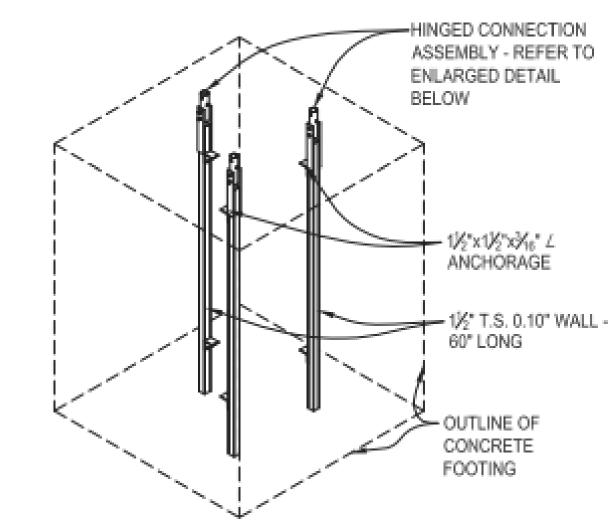


B ISOMETRIC

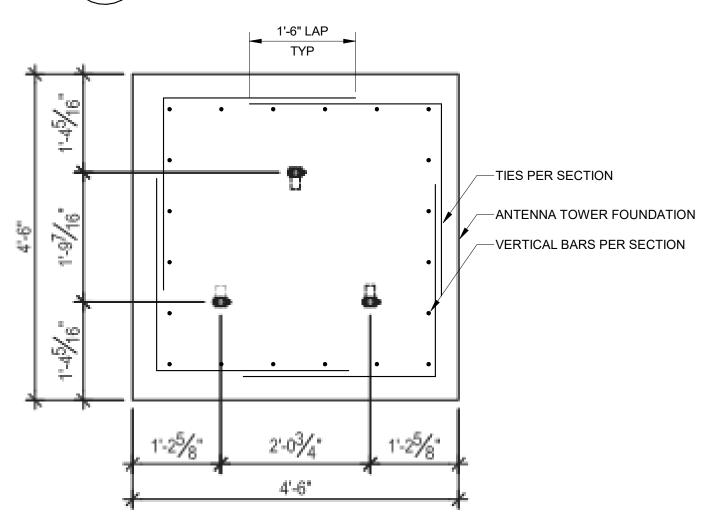


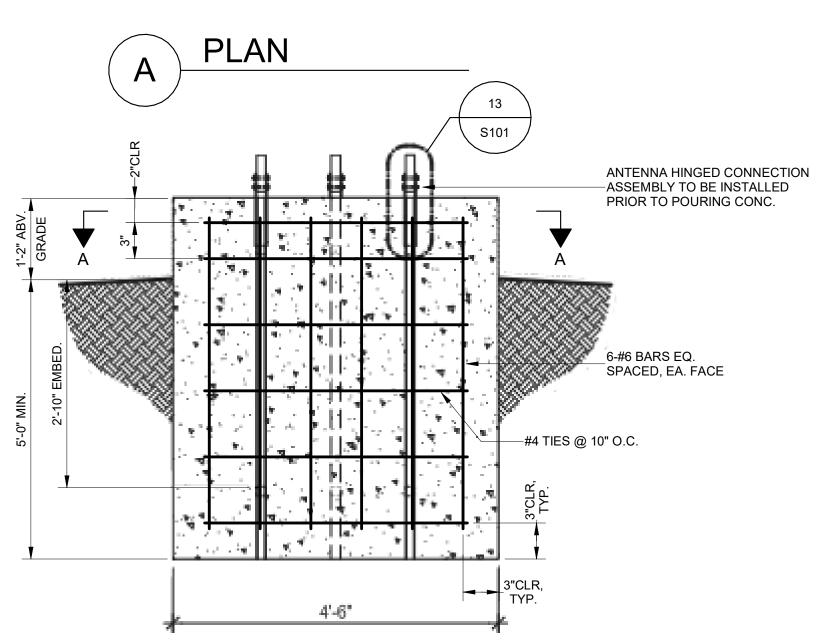

1 FOUNDATION DETAIL


S101 SCALE: NTS




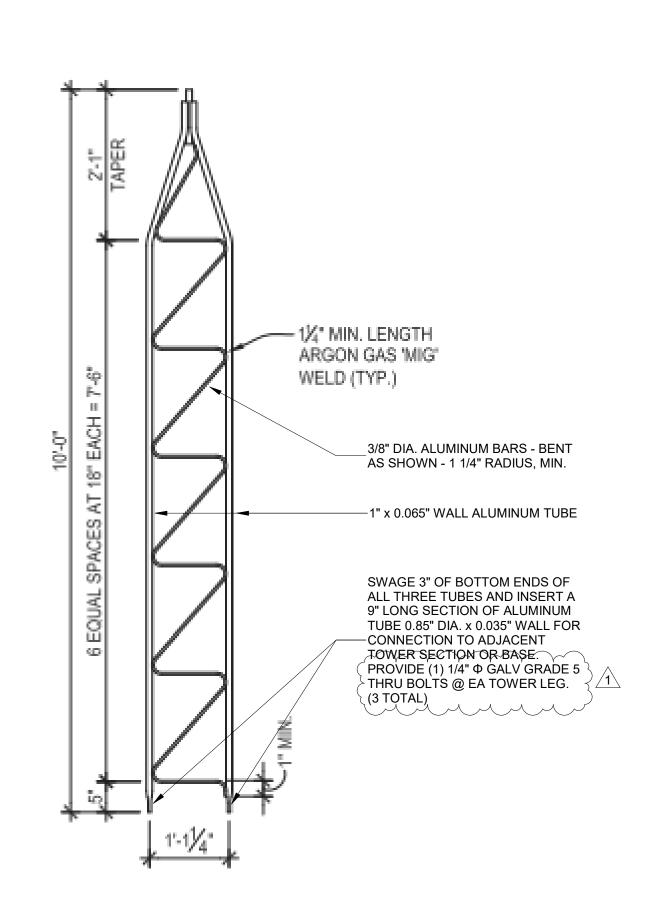


ENLARGED TOWER SECTION - LEVEL 4


SCALE: NTS



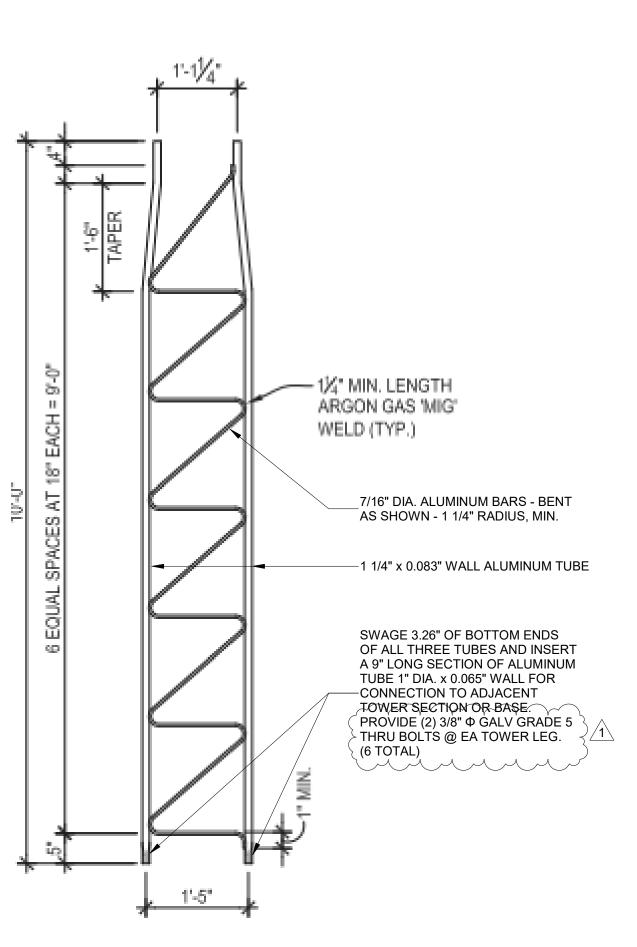


2 ENLARGED TOWER SECTION - LEVEL 3
SCALE: NTS




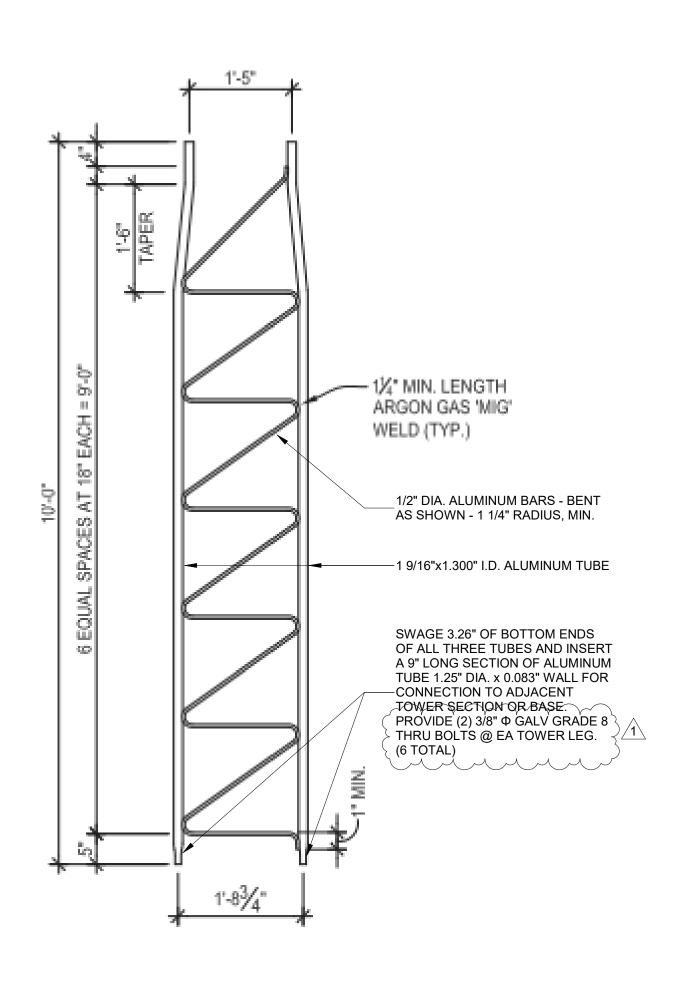


ENLARGED TOWER SECTION - LEVEL 2

S101 SCALE: NTS



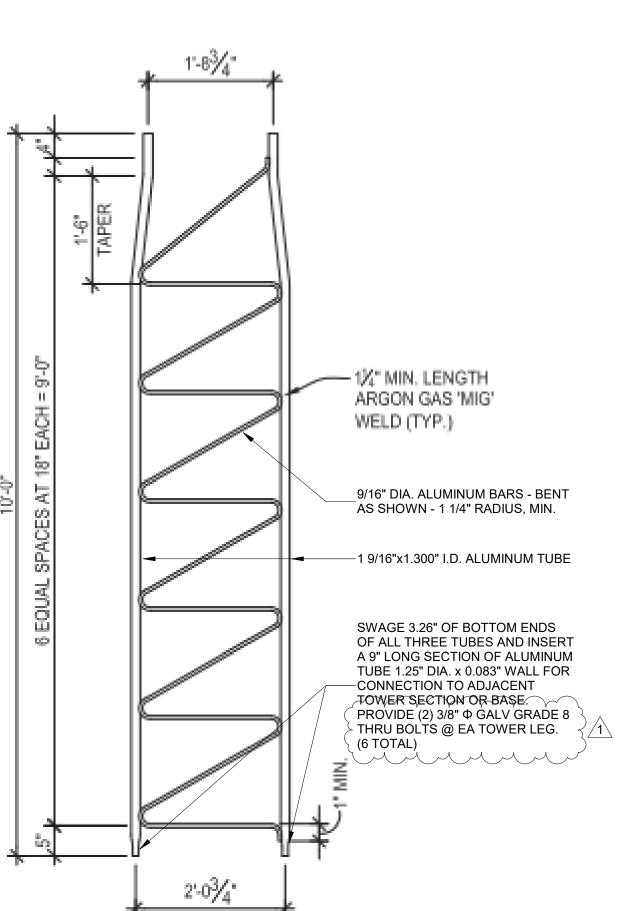

3 ENLARGED TOWER SECTION - LEVEL 1
S101 SCALE: NTS

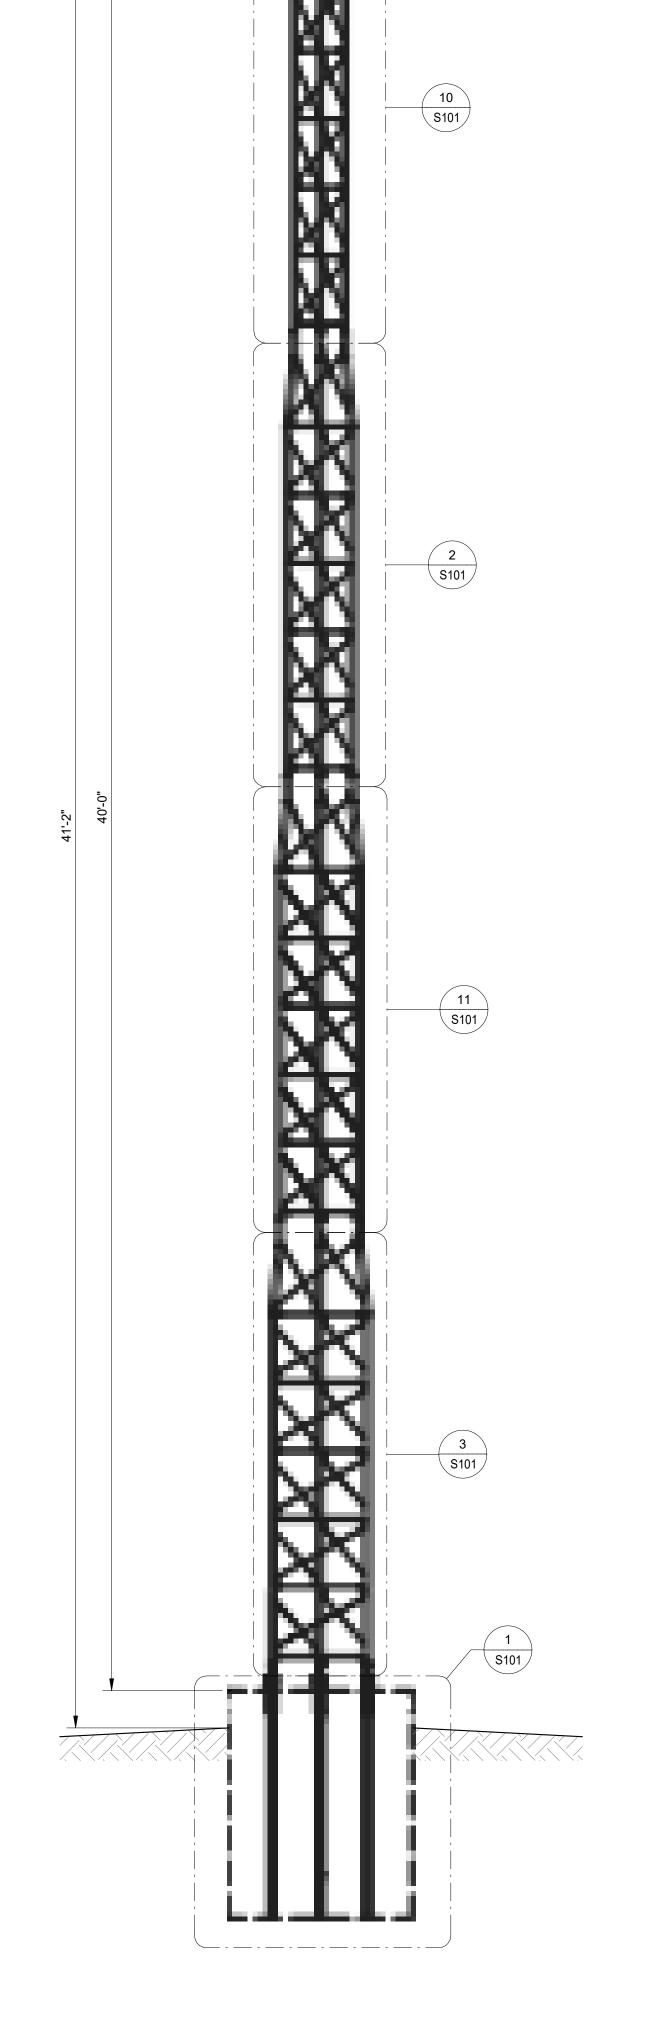

4 TOWER SECTION
STORES STATES

Kimley » Hoi

4637 CHABOT DR SUITE 300 PLEASANTON, CA 94588 PHONE: 925.398.4840


This document is an instrument of service prepared solely for Kimley-Horn's client and for a particular purpose. Any other use or reliance is without liability to Kimley-Horn.

SEALS



BEAUMONT LIFT STATION

OWNER/APPLICANT: MCDONALD PROPERTY GROUP 1140 N. COAST HIGHWAY LAGUNA BEACH, CA 92651

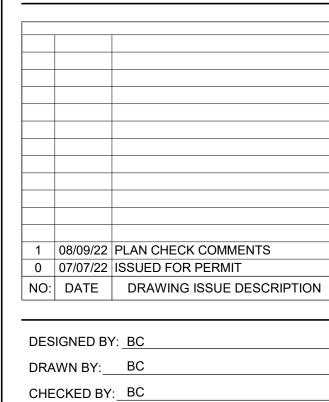

SCALE: NTS

DATE: 07/07/2022

PROJECT NO: 123456


FILENAME:


STRUCTURAL


SECTIONS, PLANS, AND DETAILS


Project Status


S101

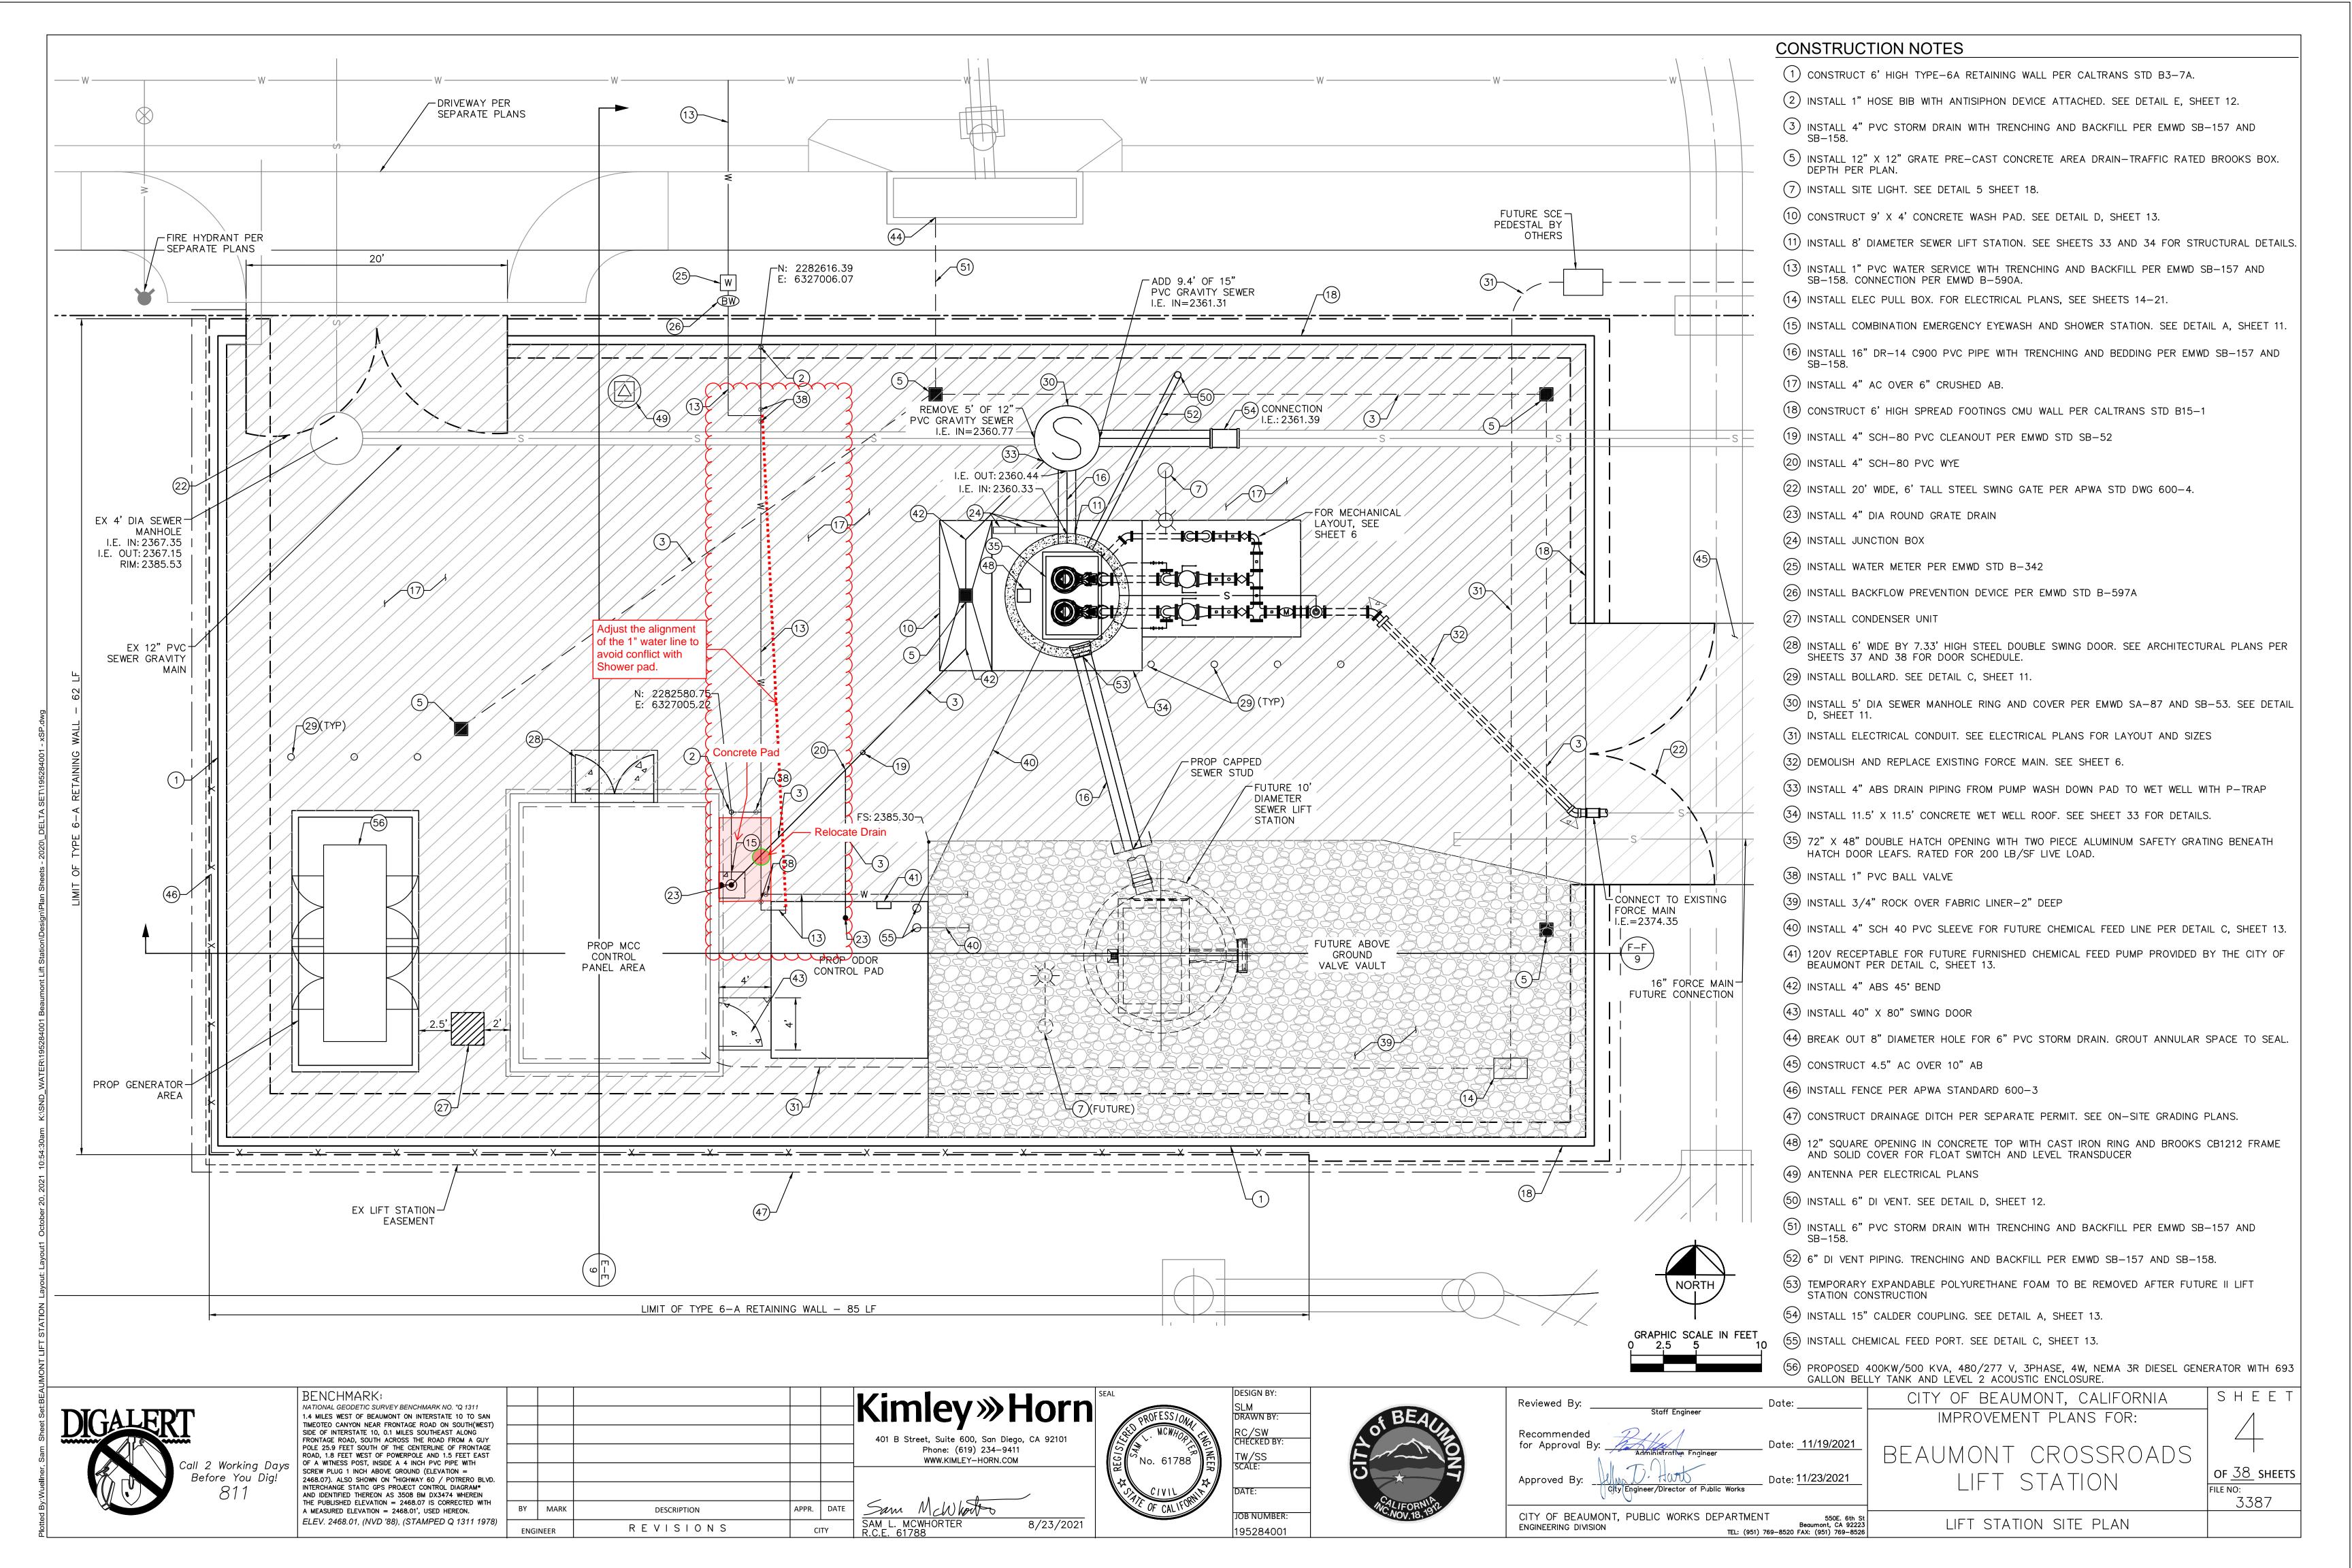

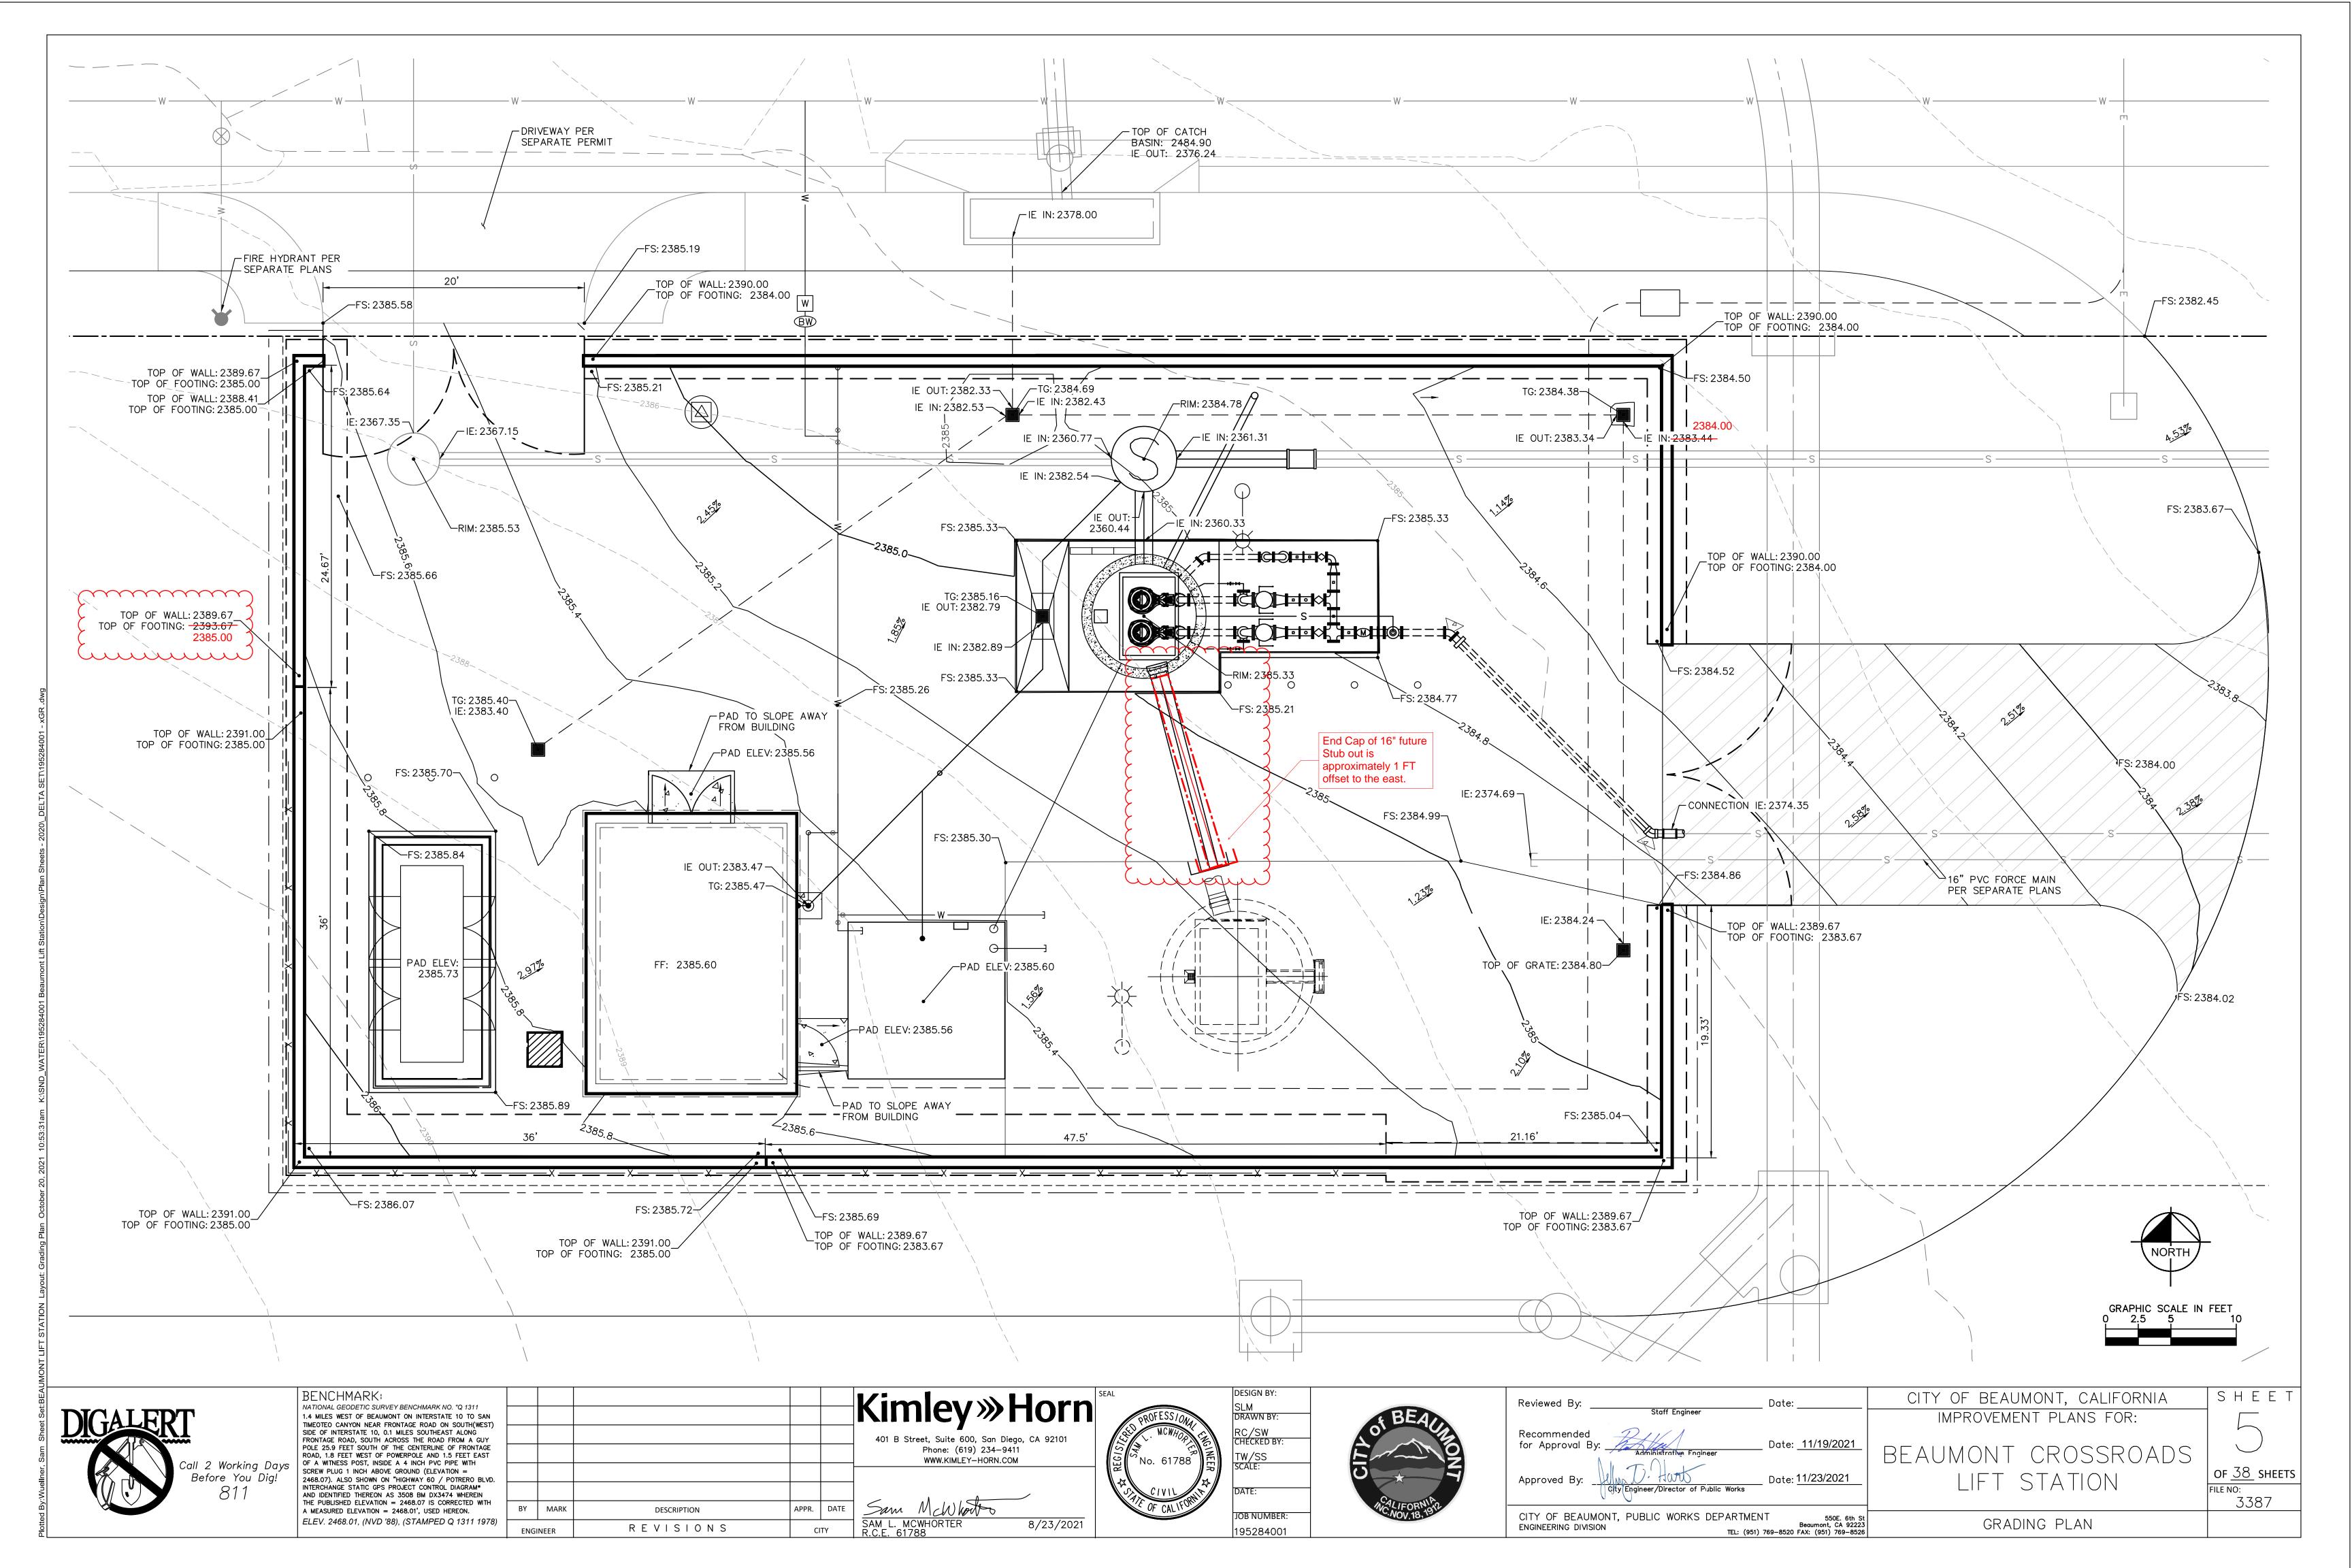

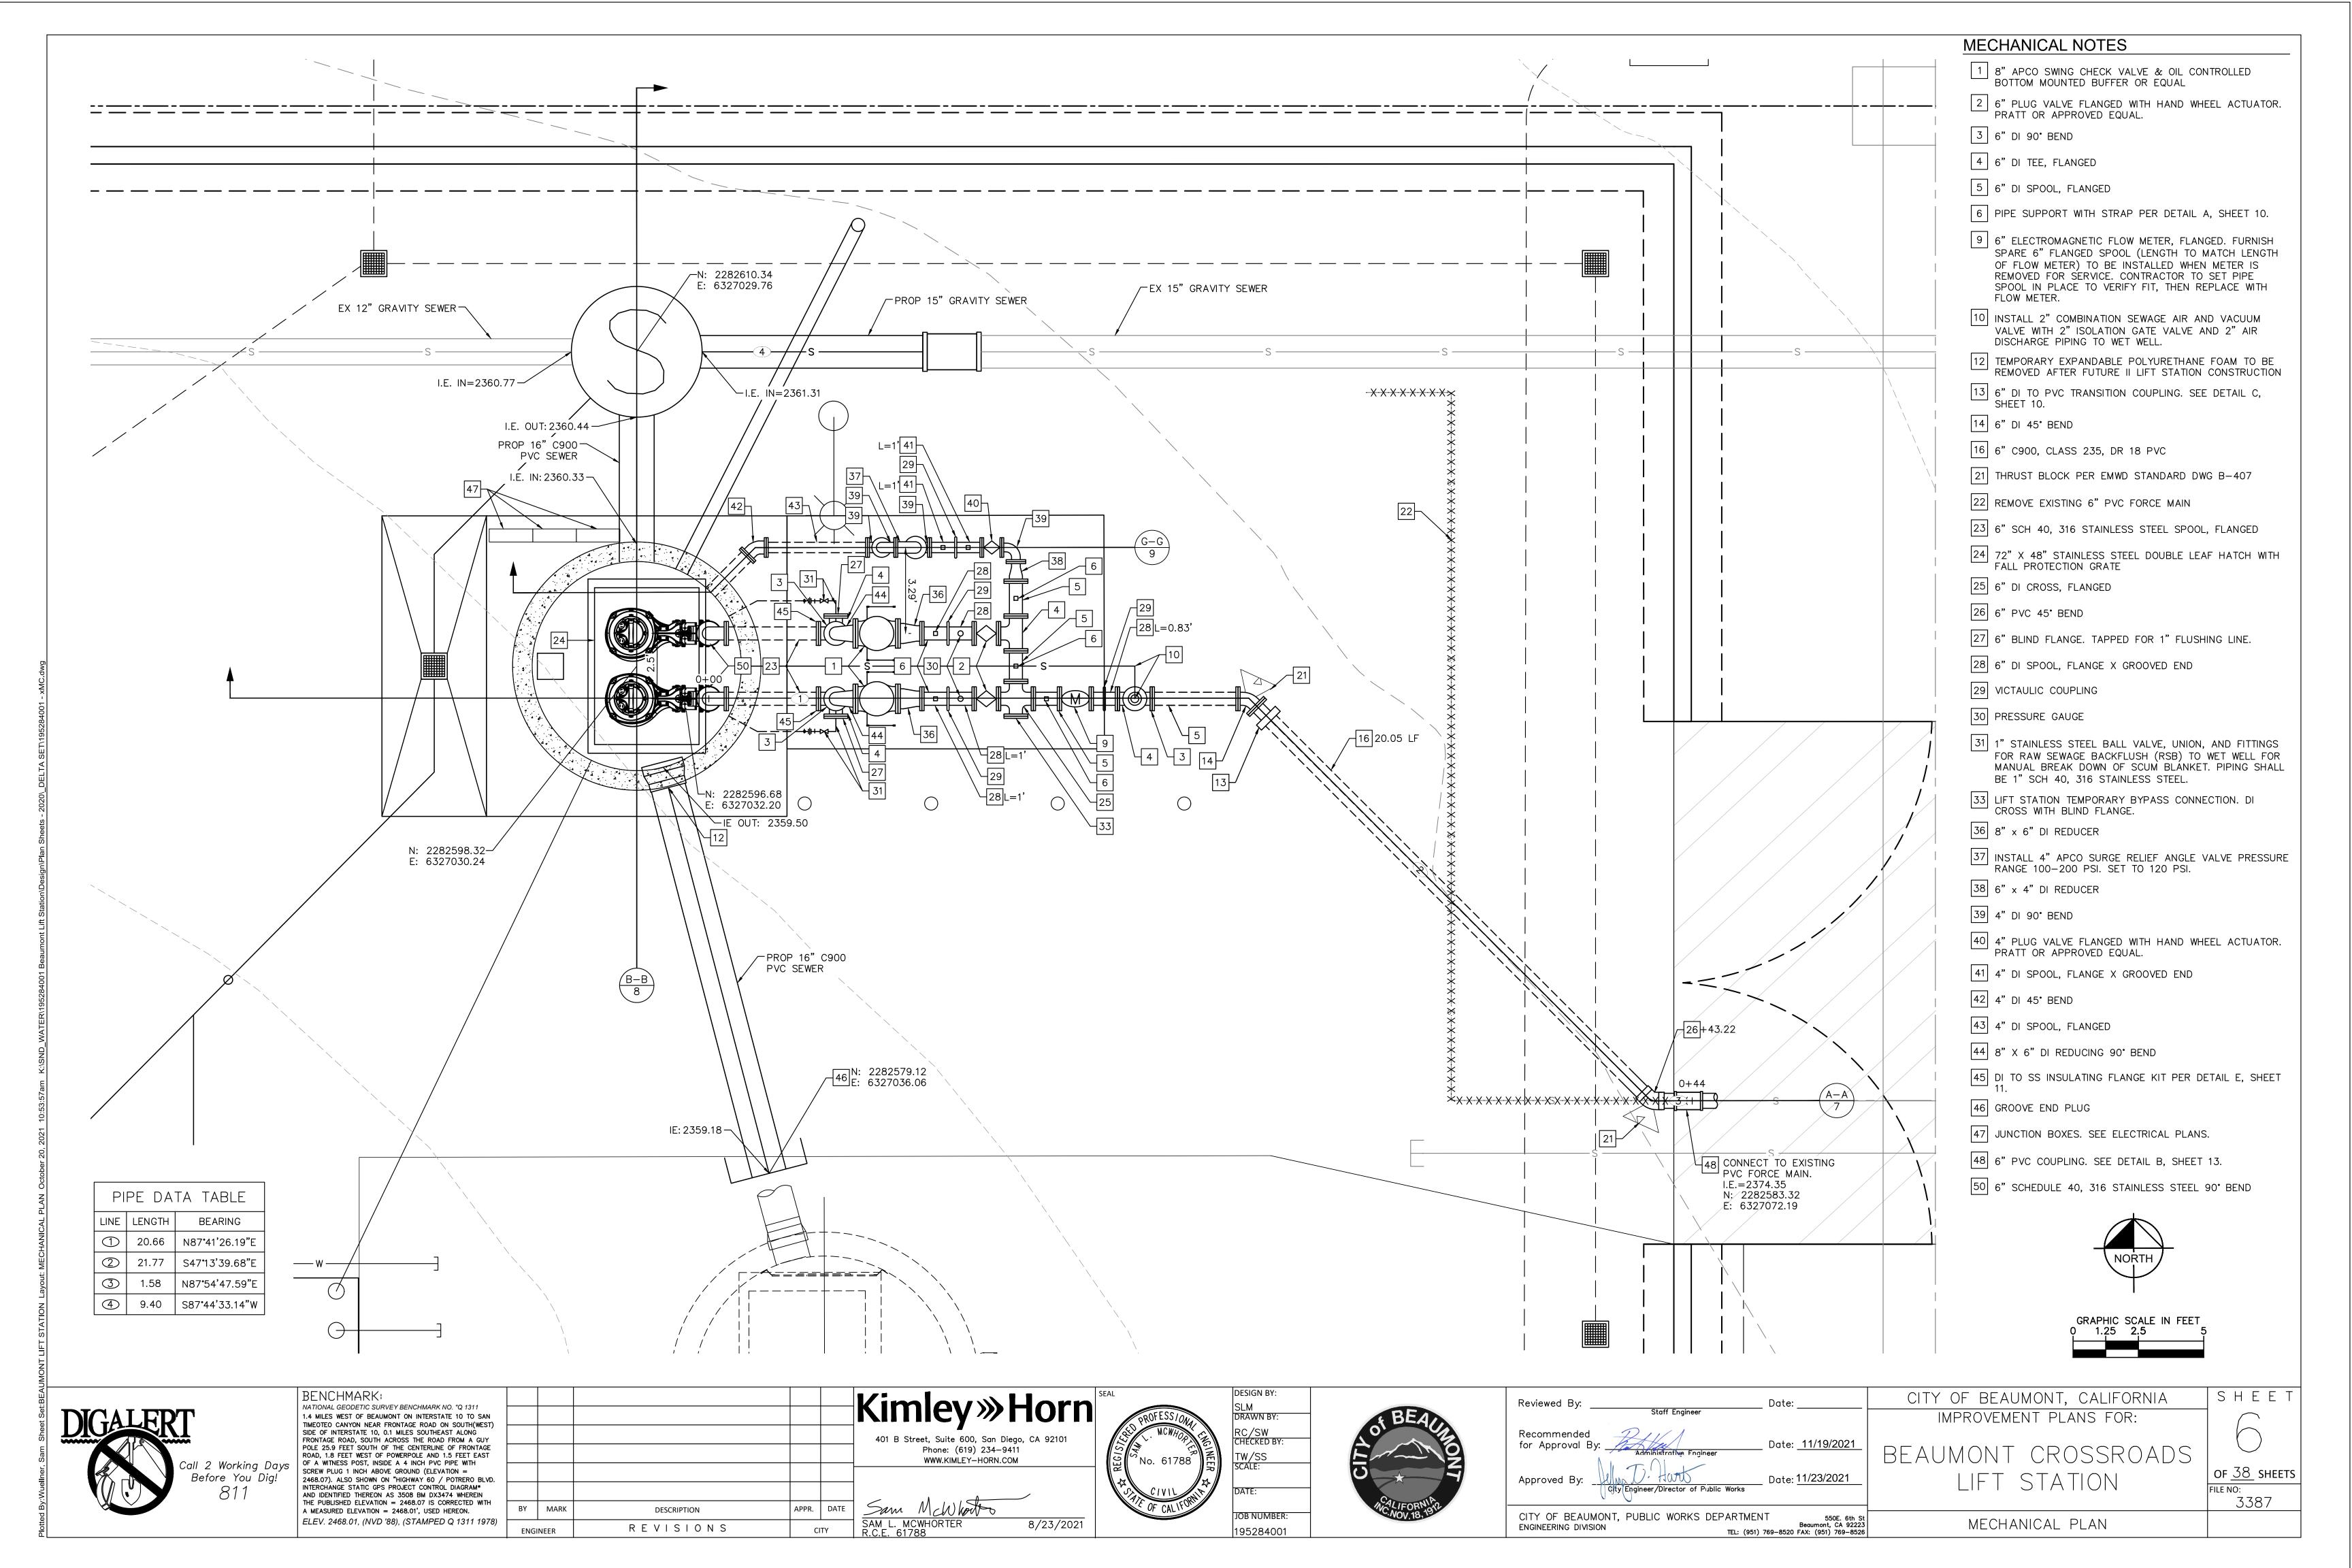

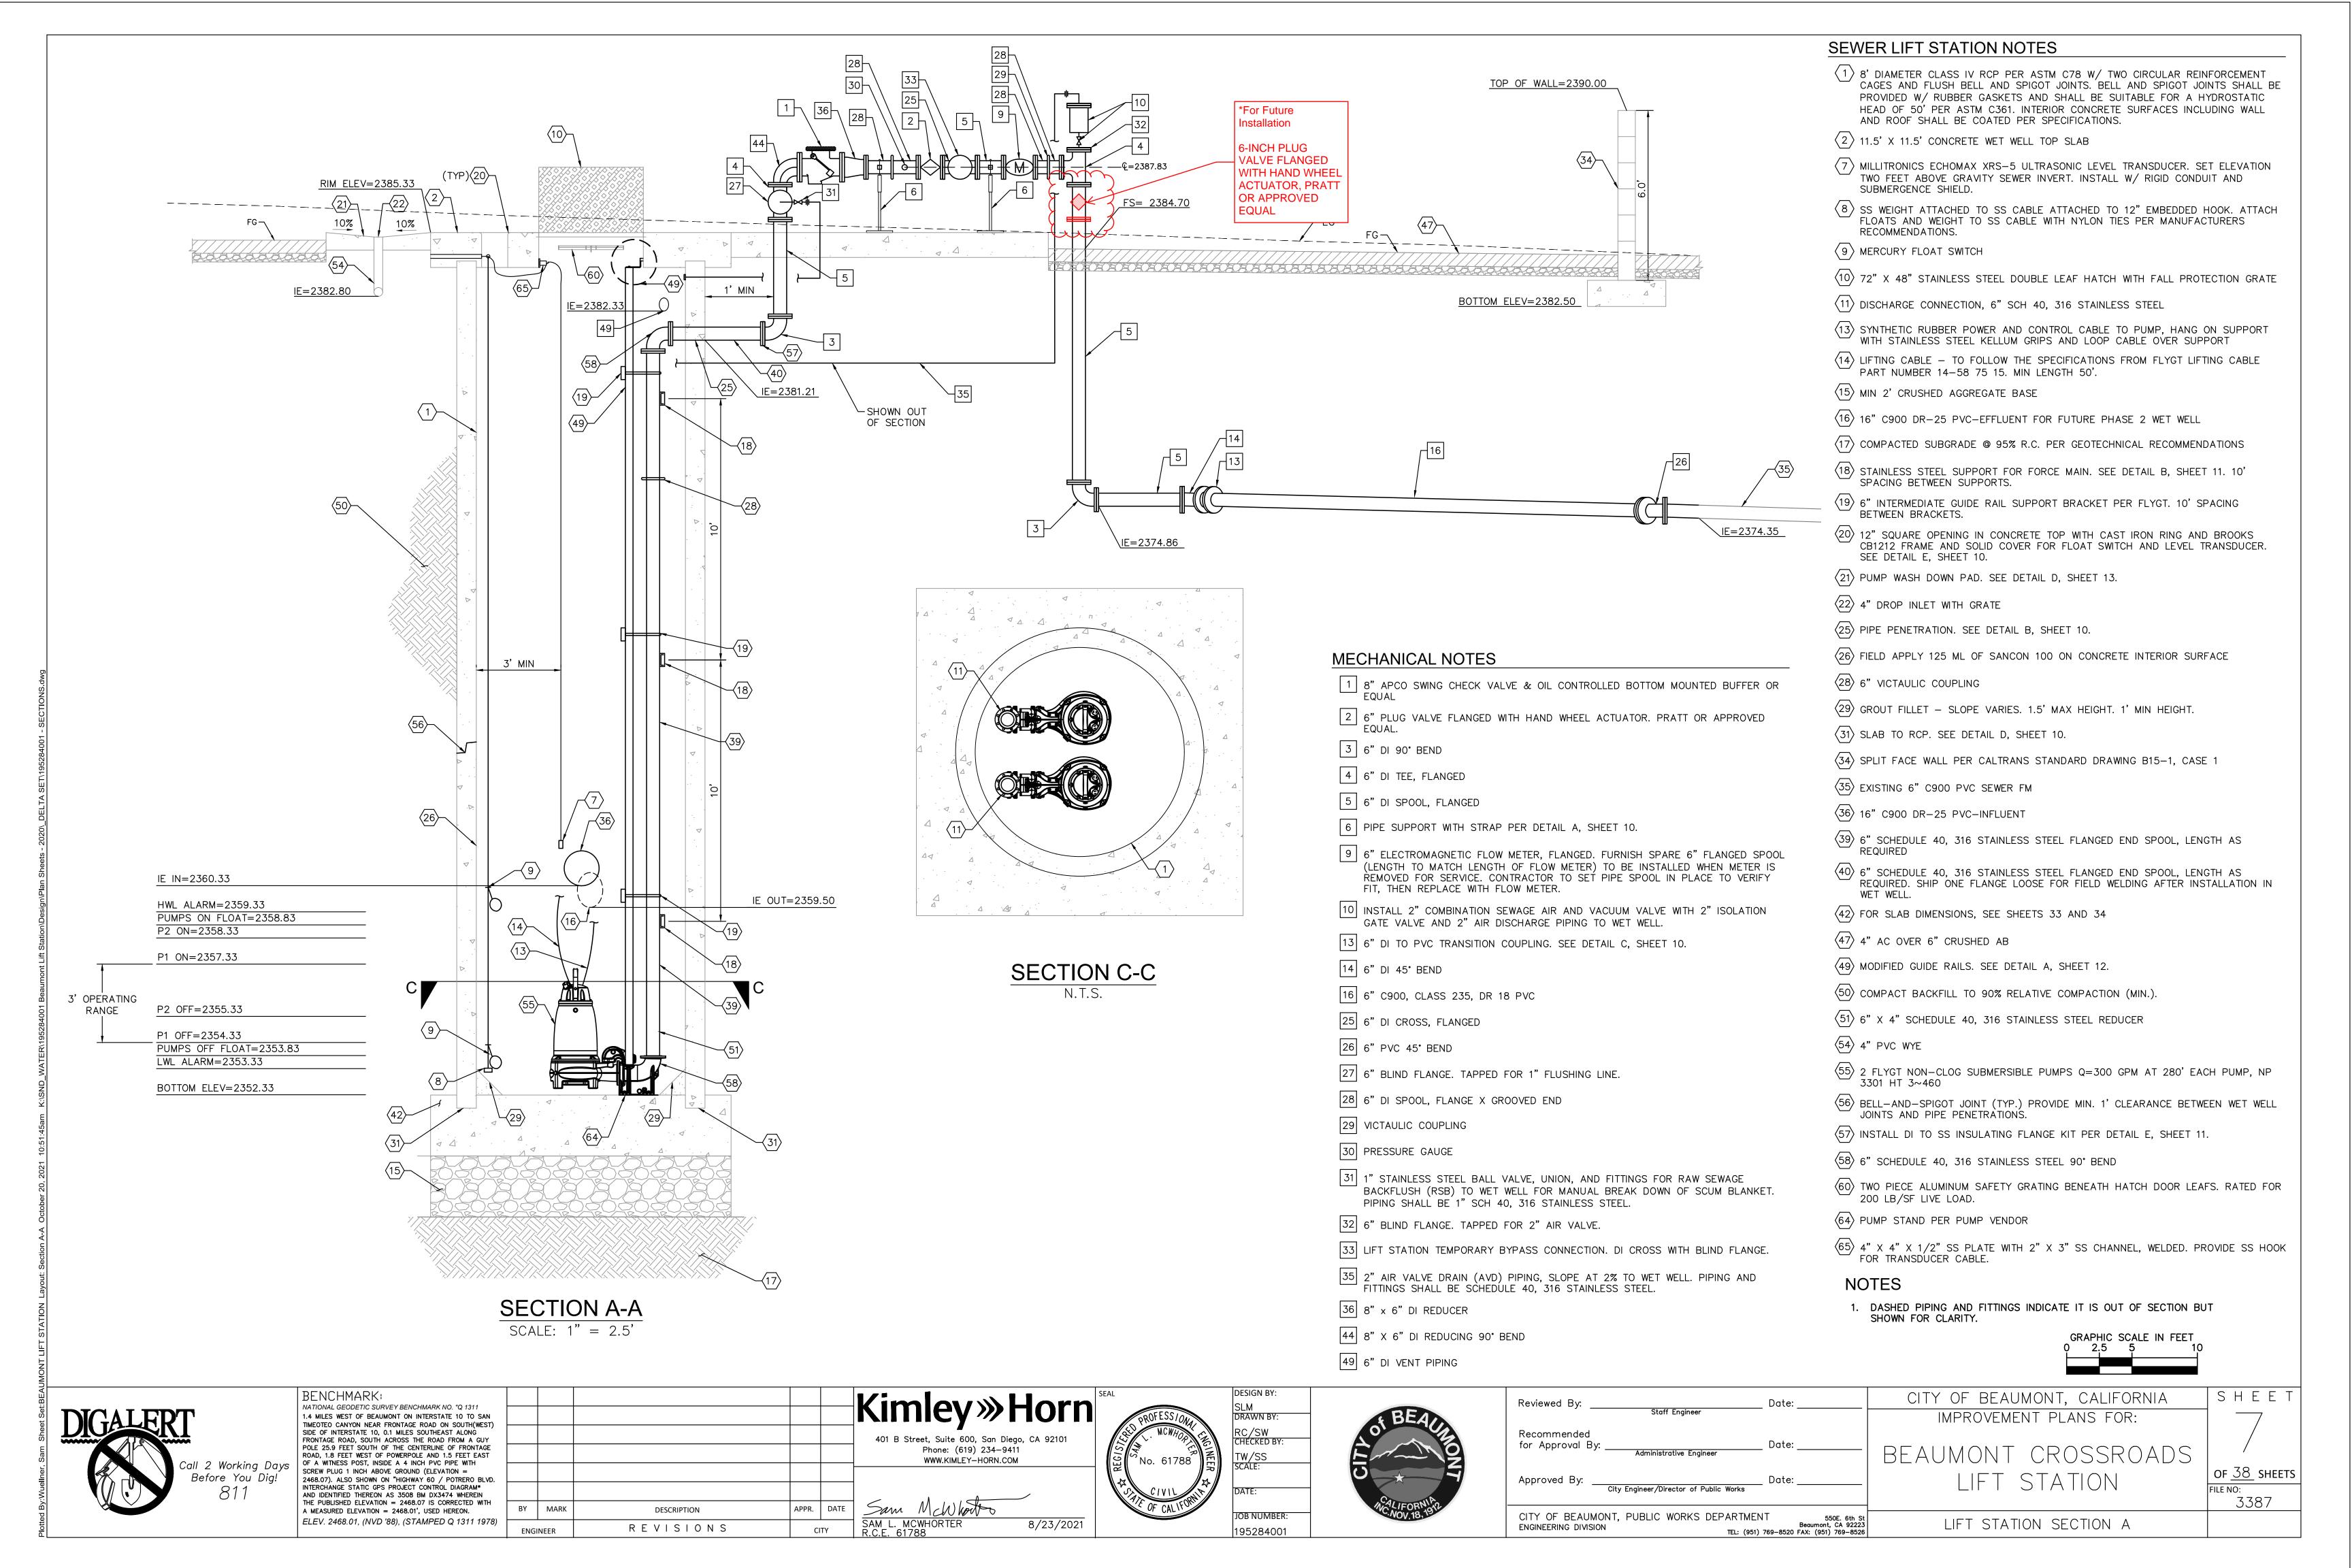

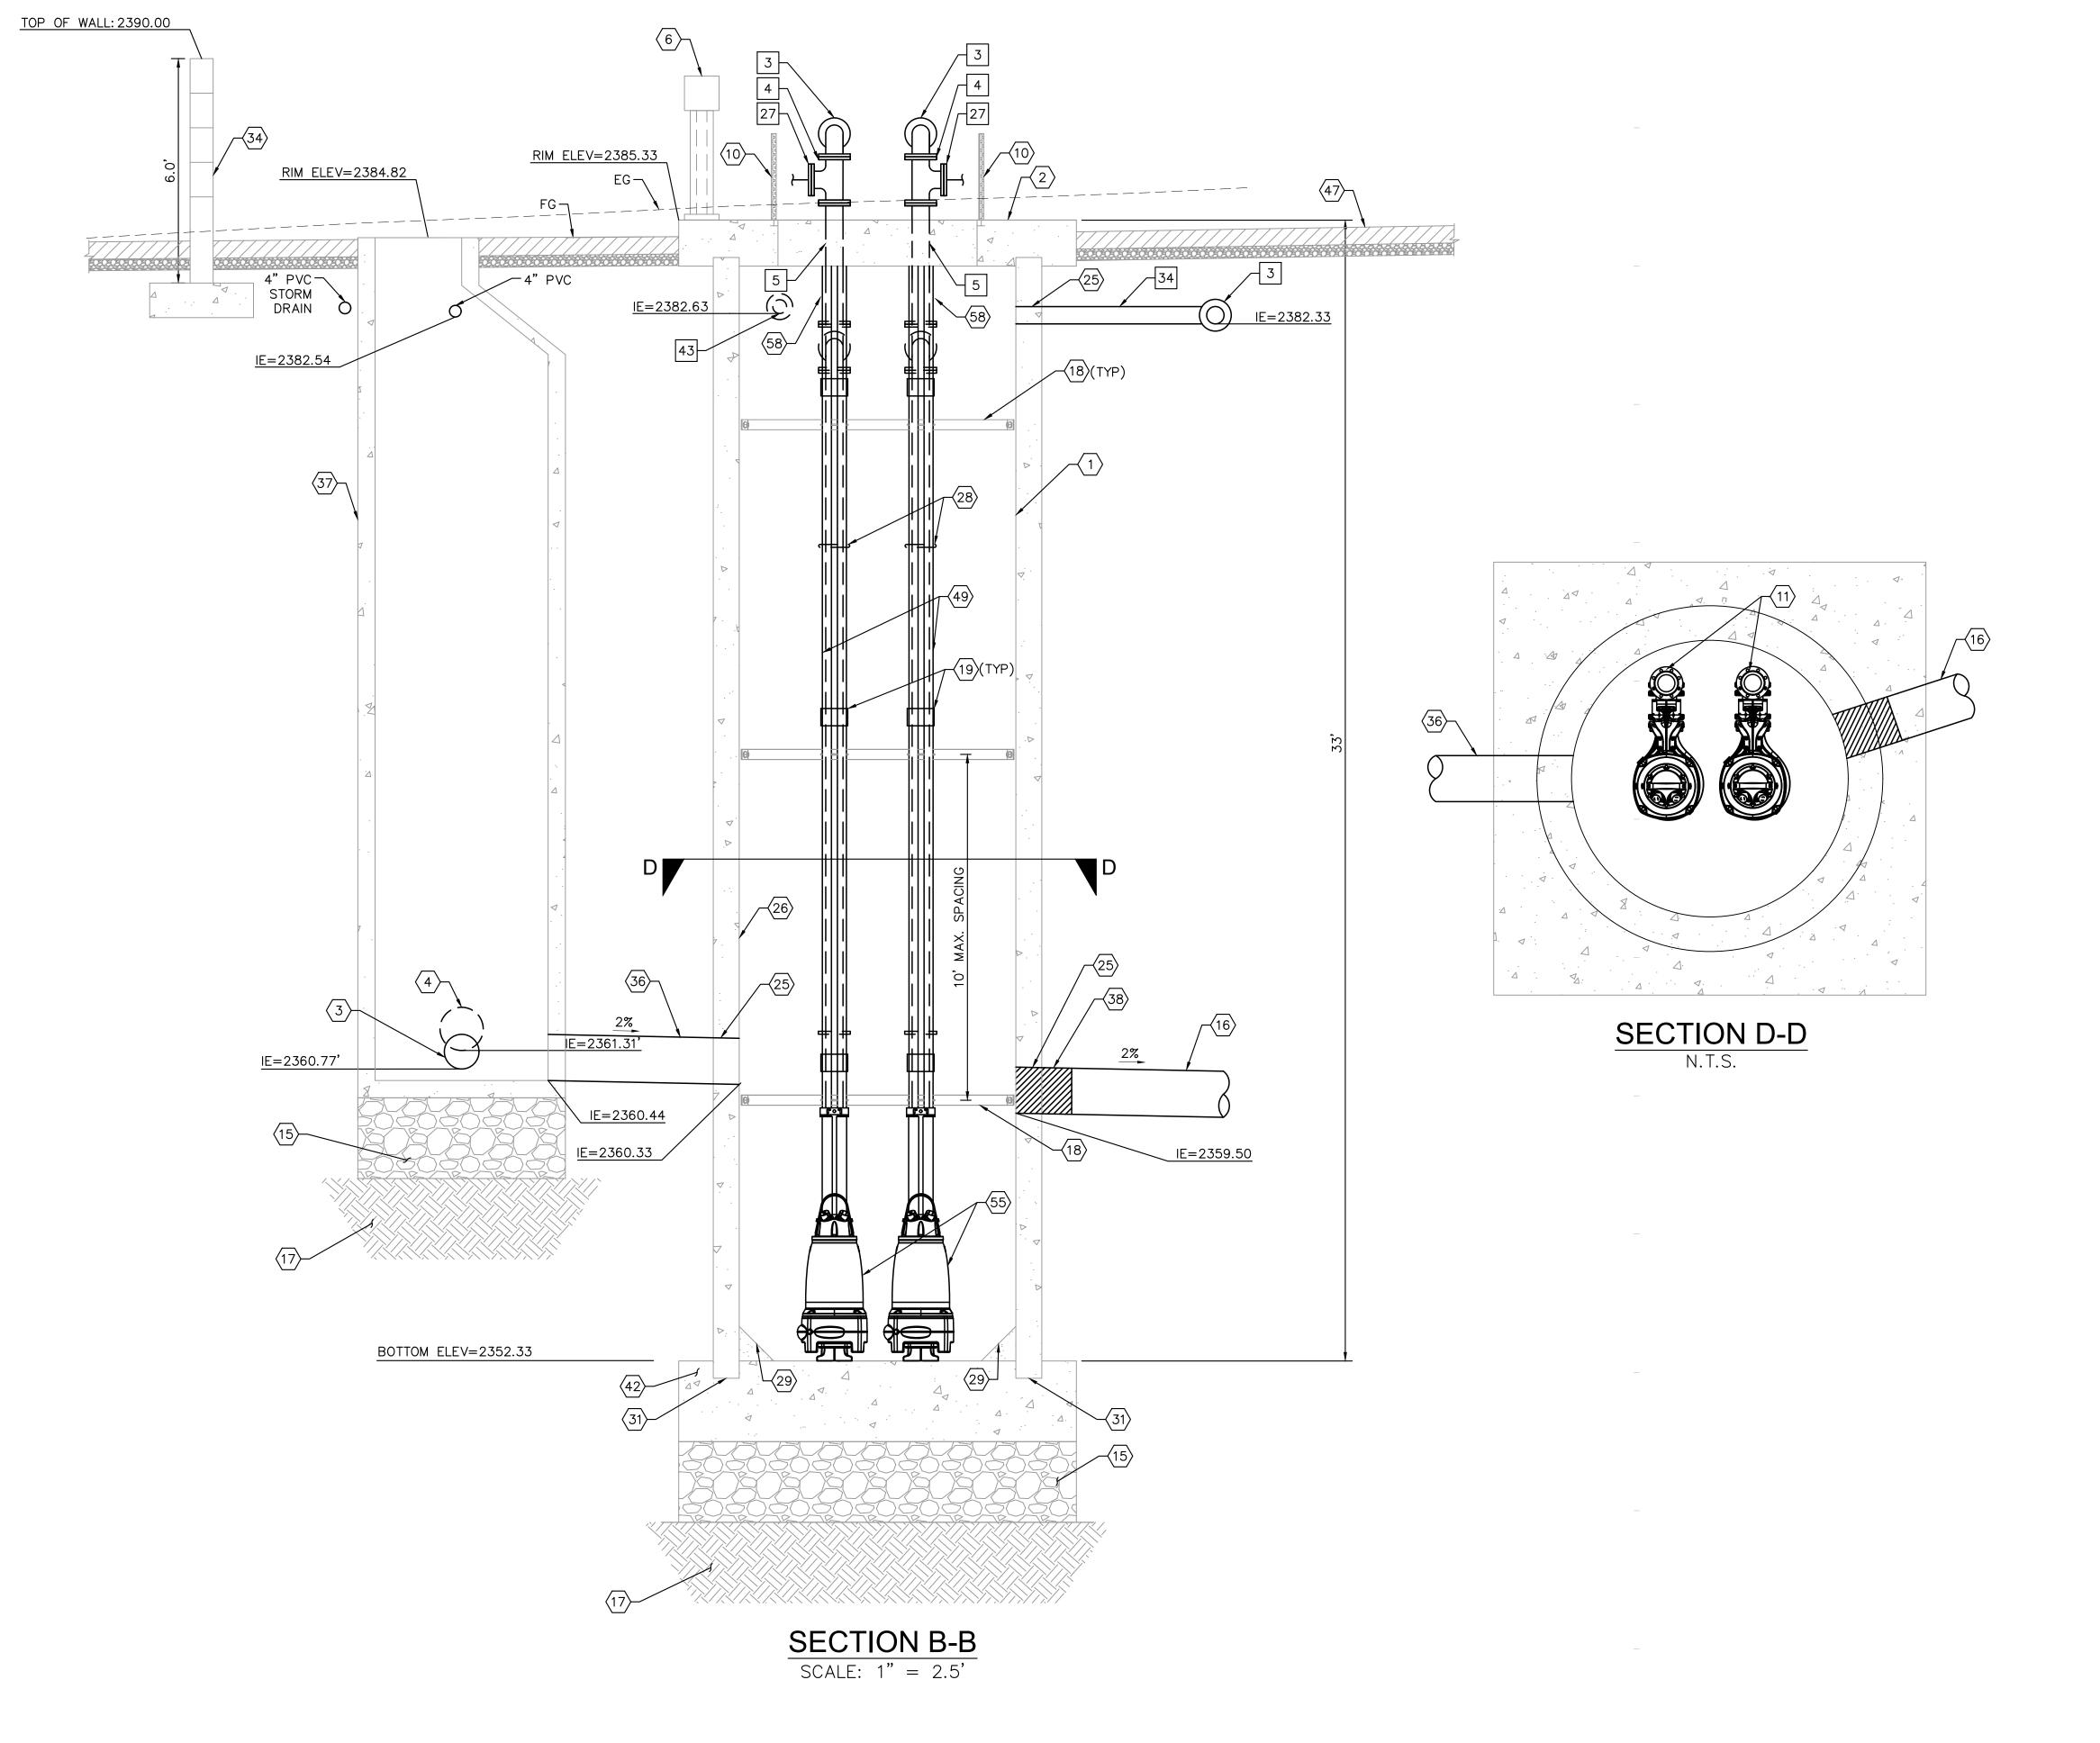

SEWER LIFT STATION NOTES

- 8' DIAMETER CLASS IV RCP PER ASTM C78 W/ TWO CIRCULAR REINFORCEMENT CAGES AND FLUSH BELL AND SPIGOT JOINTS. BELL AND SPIGOT JOINTS SHALL BE PROVIDED W/ RUBBER GASKETS AND SHALL BE SUITABLE FOR A HYDROSTATIC HEAD OF 50' PER ASTM C361. INTERIOR CONCRETE SURFACES INCLUDING WALL AND ROOF SHALL BE COATED PER SPECIFICATIONS.
- 2 11.5' X 11.5' CONCRETE WET WELL TOP SLAB
- $\sqrt{3}$ 12" SDR-26 PVC INFLUENT
- $\overline{\langle 4 \rangle}$ 15" SDR-26 PVC INFLUENT
- 6 ELECTRIC JUNCTION BOX AND STANCHION FOR PUMP POWER/CONTROL CABLES, FLOATS, AND TRANDUCERS.
- 72" X 48" STAINLESS STEEL DOUBLE LEAF HATCH WITH FALL PROTECTION GRATE
- 11) DISCHARGE CONNECTION, 6" SCH 40, 316 STAINLESS STEEL
- (15) MIN 2' CRUSHED AGGREGATE BASE
- (16) 16" C900 DR-25 PVC-EFFLUENT FOR FUTURE PHASE 2 WET WELL
- (17) COMPACTED SUBGRADE @ 95% R.C. PER GEOTECHNICAL RECOMMENDATIONS
- (18) STAINLESS STEEL SUPPORT FOR FORCE MAIN. SEE DETAIL B, SHEET 11. 10' SPACING BETWEEN SUPPORTS.
- 6" INTERMEDIATE GUIDE RAIL SUPPORT BRACKET PER FLYGT. 10' SPACING BETWEEN BRACKETS.
- 25) PIPE PENETRATION. SEE DETAIL B, SHEET 10.
- FIELD APPLY 125 ML OF SANCON 100 ON CONCRETE INTERIOR SURFACE
- 28 6" VICTAULIC COUPLING
- (29) GROUT FILLET SLOPE VARIES. 1.5' MAX HEIGHT. 1' MIN HEIGHT.
- (31) SLAB TO RCP. SEE DETAIL D, SHEET 10.
- 34 SPLIT FACE WALL PER CALTRANS STANDARD DRAWING B15-1, CASE 1
- 36 16" C900 DR-25 PVC-INFLUENT
- 5' DIA SEWER MANHOLE, RING AND COVER PER EMWD SA-87 AND SB-53.
- (38) TEMPORARY INFLATED NYLON PLUG TO BE REMOVED AFTER FUTURE PHASE II LIFT STATION CONSTRUCTION.
- (42) FOR SLAB DIMENSIONS, SEE SHEETS 33 AND 34
- 47 4" AC OVER 6" CRUSHED AB
- (49) MODIFIED GUIDE RAILS. SEE DETAIL A, SHEET 12.
- 2 FLYGT NON-CLOG SUBMERSIBLE PUMPS Q=300 GPM AT 280' EACH PUMP, NP 3301 HT 3~460
- (58) 6" SCHEDULE 40, 316 STAINLESS STEEL 90° BEND

MECHANICAL NOTES

- 3 6" DI 90° BEND
- 4 6" DI TEE, FLANGED
- 5 6" DI SPOOL, FLANGED
- 27 6" BLIND FLANGE. TAPPED FOR 1" FLUSHING LINE.
- 34 6" DI VENT PER DETAIL D, SHEET 12.
- 43 4" DI SPOOL, FLANGED


NOTES


1. DASHED PIPING AND FITTINGS INDICATE IT IS OUT OF SECTION BUT SHOWN FOR CLARITY.


GRAPHIC SCALE IN FEET
0 2.5 5 10



Kimley» Horn NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH BY MARK DESCRIPTION A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978) 8/23/2021 REVISIONS



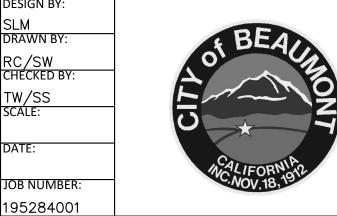

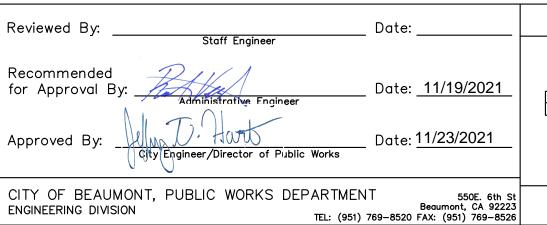

IMPROVEMENT PLANS FOR:


BEAUMONT CROSSROADS


LIFT STATION

LIFT STATION SECTION B


CITY OF BEAUMONT, CALIFORNIA

OF <u>38</u> SHEETS
FILE NO:
3387

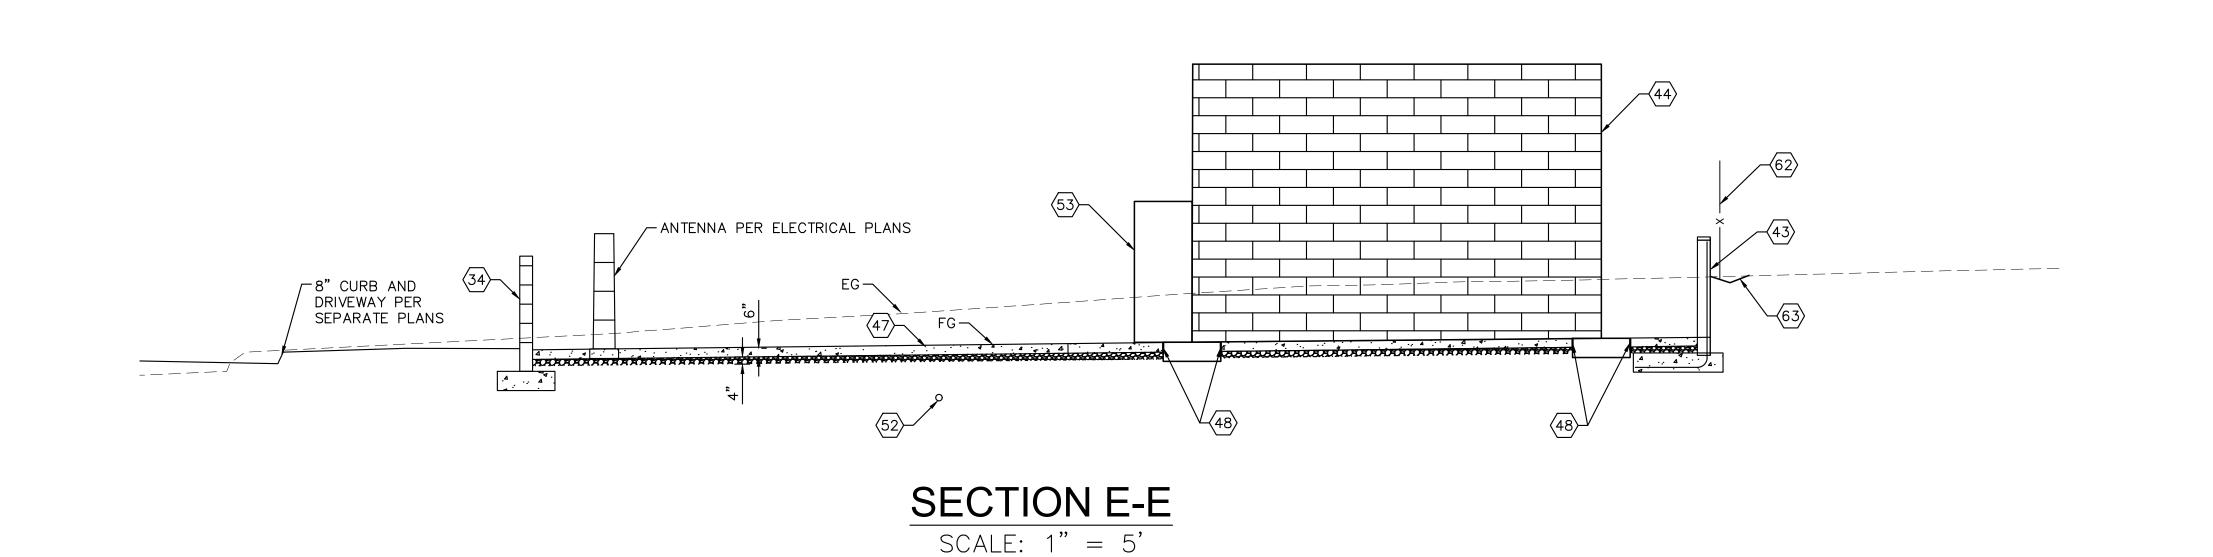

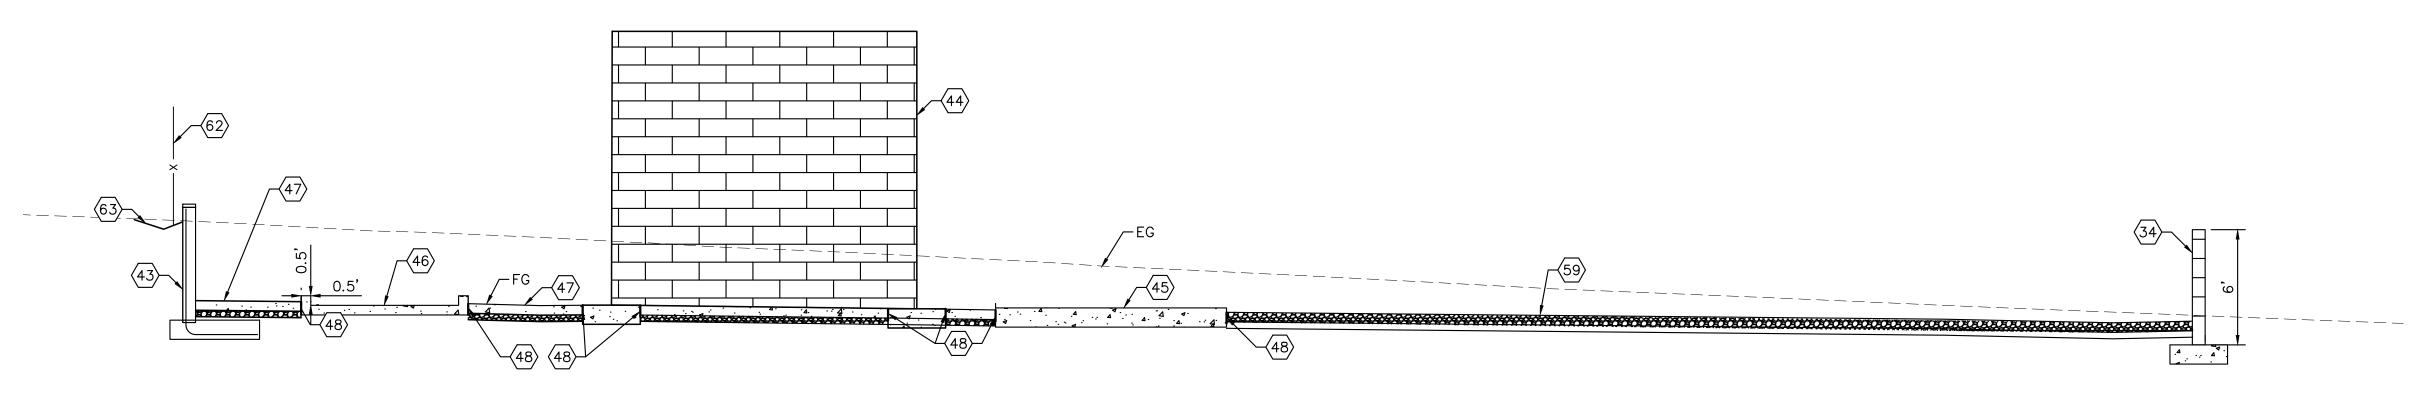



SECTION F-F SCALE: 1" = 5'

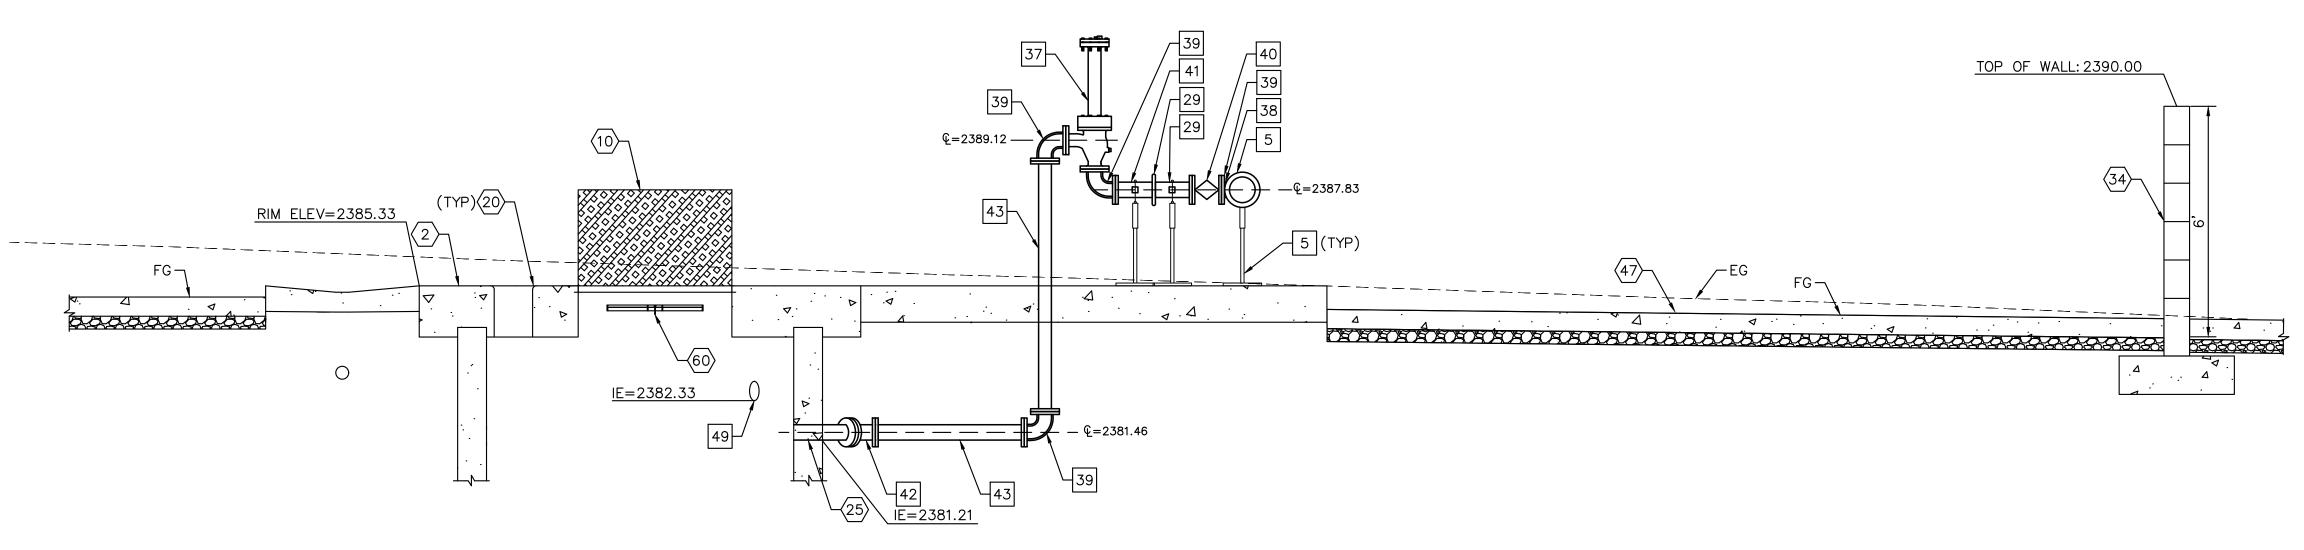



SECTION G-G

SCALE: 1" = 2.5'

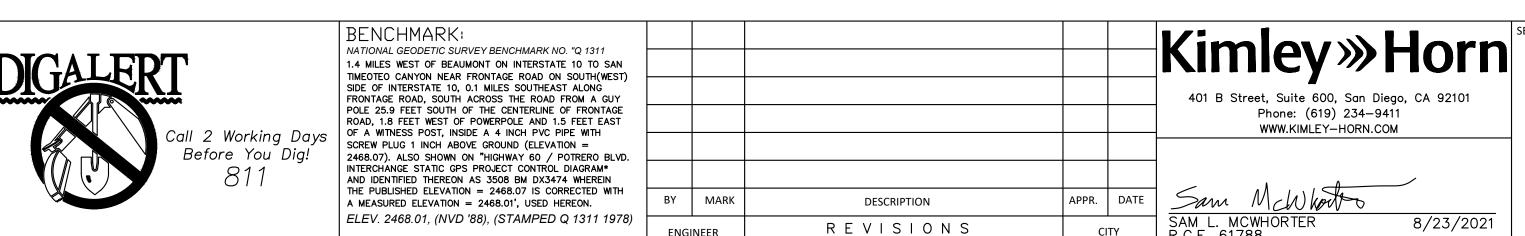





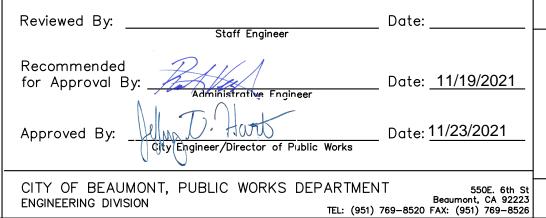

IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

LIFT STATION SECTION C

CITY OF BEAUMONT, CALIFORNIA

SEWER LIFT STATION NOTES

 $\langle 2 \rangle$ 11.5' X 11.5' CONCRETE WET WELL TOP SLAB

(25) PIPE PENETRATION. SEE DETAIL B, SHEET 10.

(45) ODOR CONTROL PAD. SEE DETAIL B SHEET 12.

 $\langle 59 \rangle$ Install 3/4" ROCK OVER MIRAFI LINER

 $\langle 62 \rangle$ INSTALL FENCE PER APWA STANDARD 600-3

47 4" AC OVER 6" CRUSHED AB

 $\overline{\langle 46 \rangle}$ ELECTRIC GENERATOR PAD. SEE DETAIL C SHEET 12.

44 MCC BUILDING.

48 EXPANSION JOINT

MECHANICAL NOTES

5 6" DI SPOOL, FLANGED

29 VICTAULIC COUPLING

38 6" x 4" DI REDUCER

41 4" DI SPOOL, FLANGE X GROOVED END

39 4" DI 90° BEND

42 4" DI 45° BEND

49 6" DI VENT PIPING

43 4" DI SPOOL, FLANGED

LEVEL TRANSDUCER. SEE DETAIL E, SHEET 10.

10 INSTALL 72" X 48" STAINLESS STEEL DOUBLE LEAF HATCH WITH FALL PROTECTION GRATE

20) 12" SQUARE OPENING IN CONCRETE TOP WITH CAST IRON RING AND BROOKS CB1212 FRAME AND SOLID COVER FOR FLOAT SWITCH AND

 $\langle 34 \rangle$ SPLIT FACE WALL PER CALTRANS STANDARD DRAWING B15-1, CASE 1

CONSTRUCT 6' HIGH TYPE-6A RETAINING WALL PER CALTRANS STD B3-7A.

52) INSTALL 4" PVC STORM DRAIN WITH TRENCHING AND BACKFILL PER EMWD SB-157 AND SB-158. INVERT PER GRADING PLAN

TWO PIECE ALUMINUM SAFETY GRATING BENEATH HATCH DOOR LEAFS. RATED FOR 200 LB/SF LIVE LOAD.


DRAINAGE DITCH PER SEPARATE PLANS. SEE ON-SITE GRADING PLANS (PERMIT NUMBER PW2019-0339).


37 INSTALL 4" APCO SURGE RELIEF ANGLE VALVE PRESSURE RANGE 100-200 PSI. SET TO 120 PSI.


4" PLUG VALVE FLANGED WITH HAND WHEEL ACTUATOR. PRATT OR APPROVED EQUAL.


53 INSTALL 6' WIDE BY 7.33' HIGH STEEL DOUBLE SWING DOOR

of 38 sheets 3387

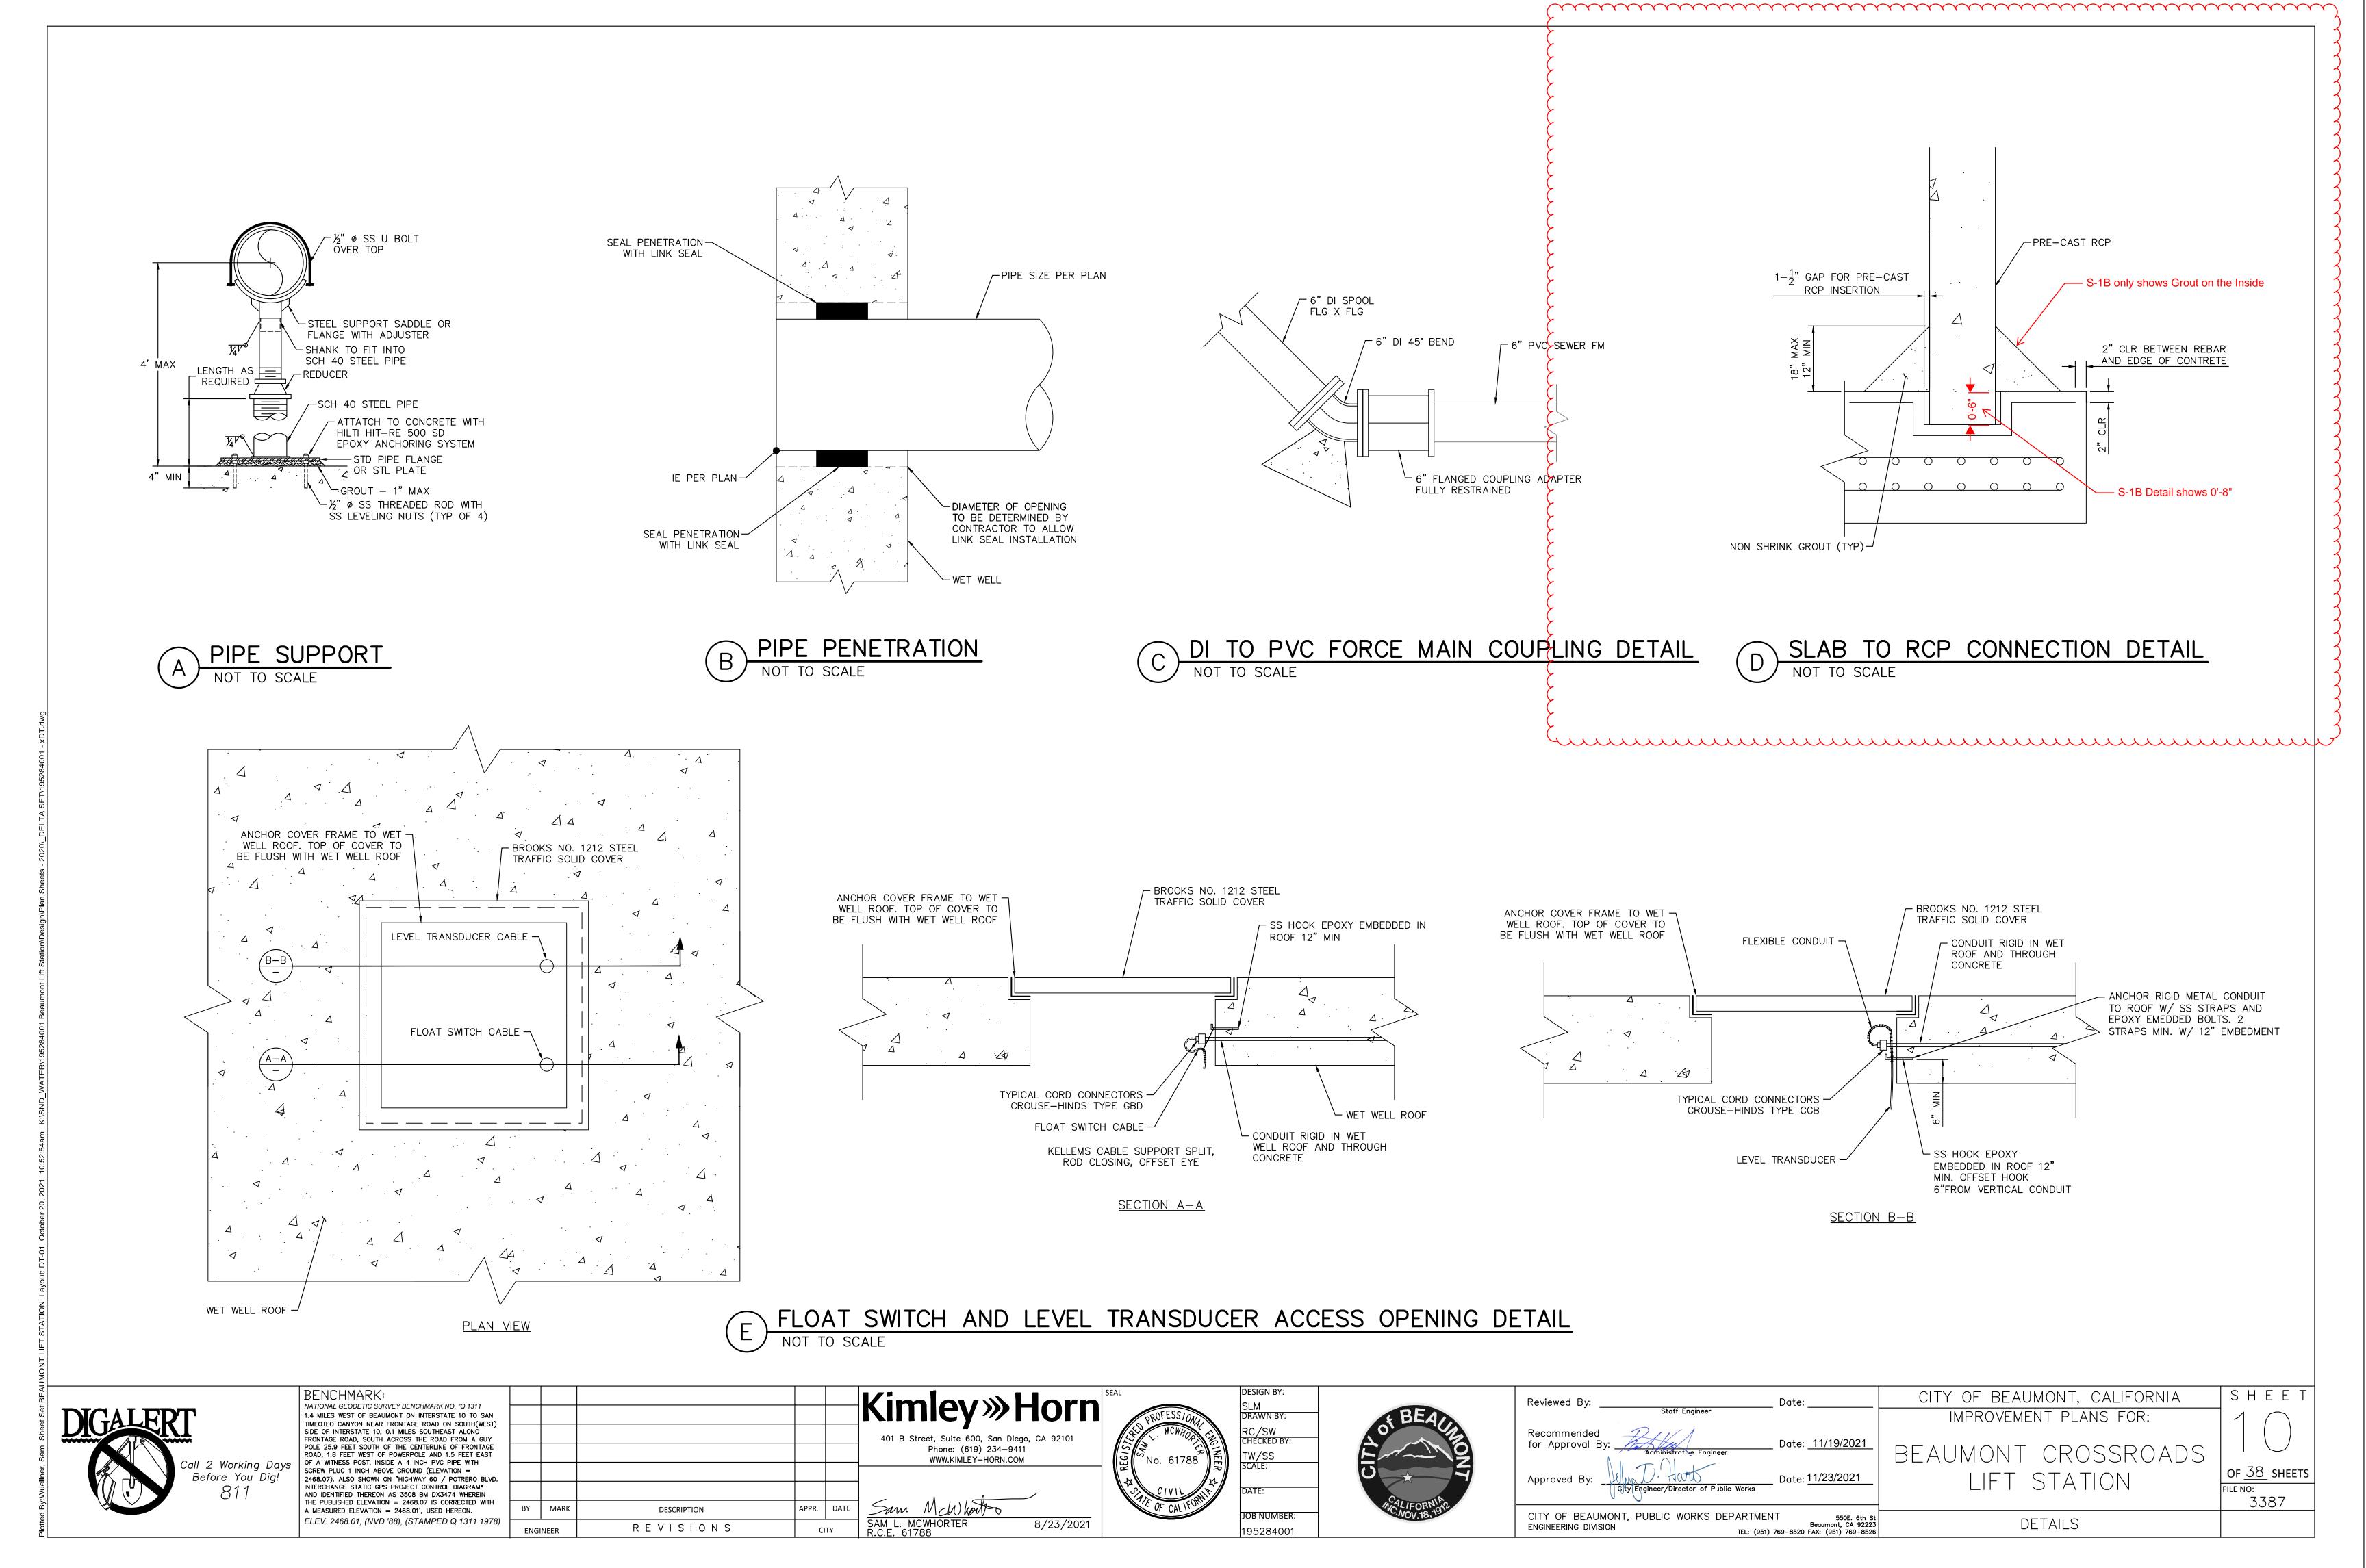

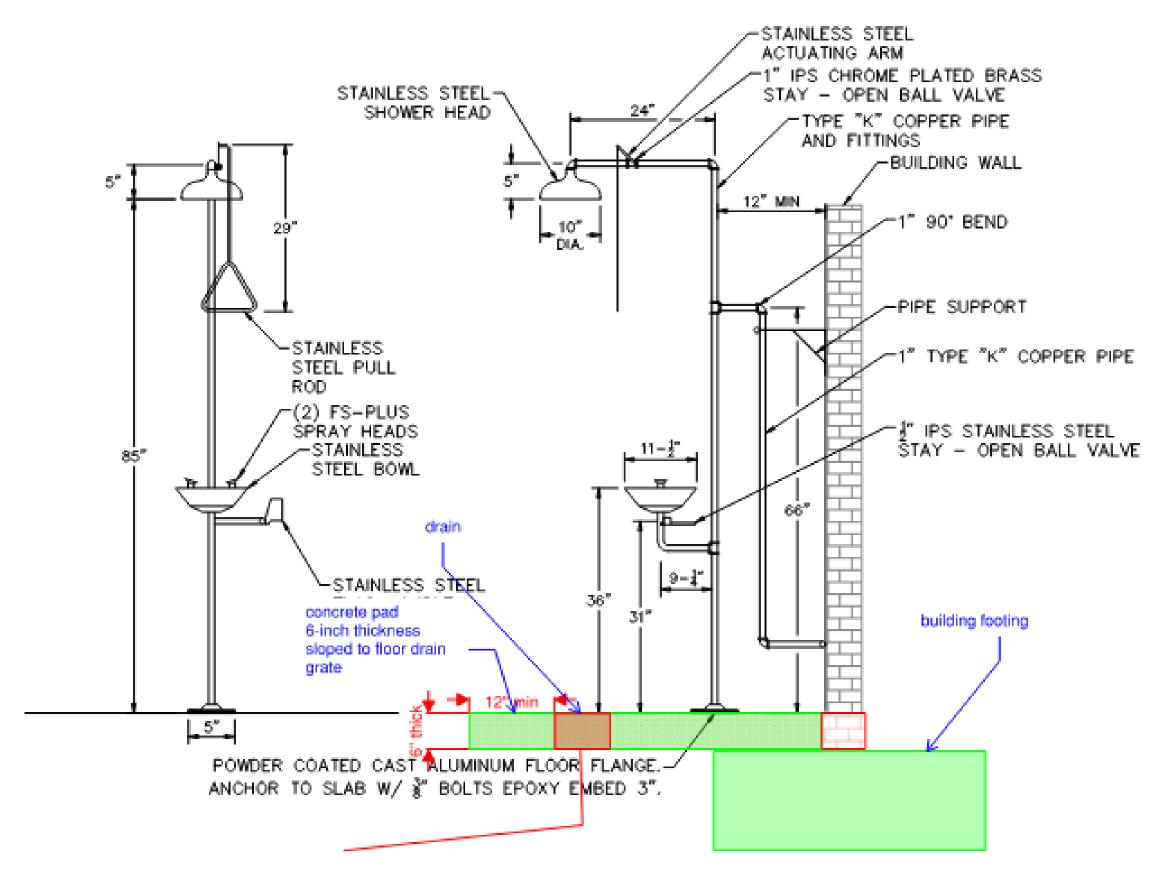


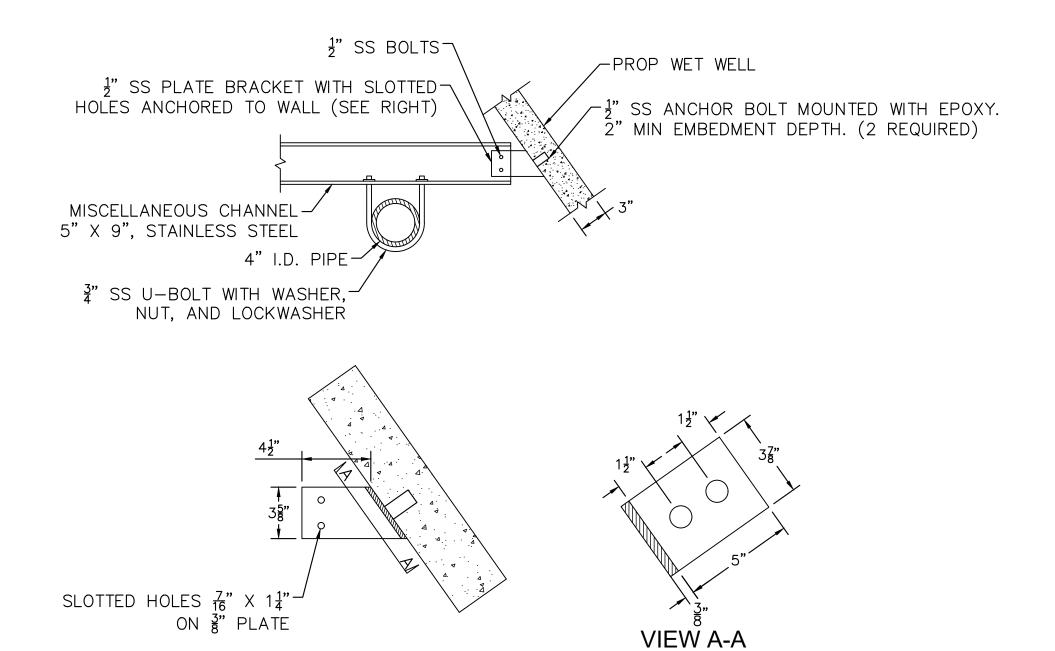


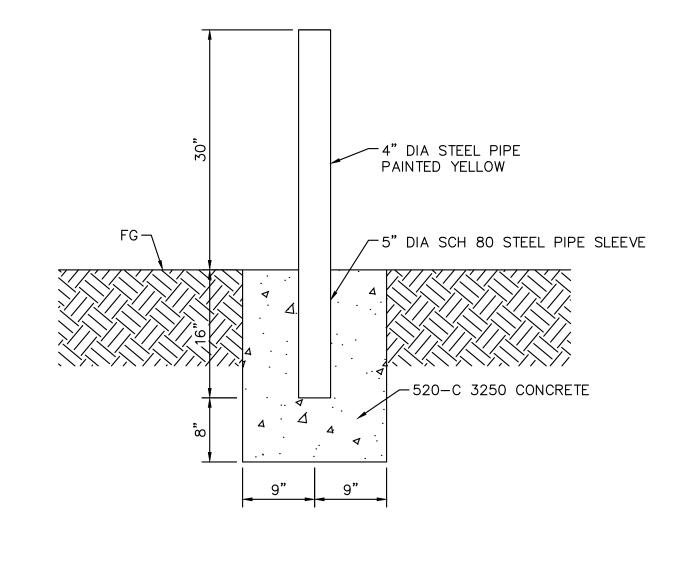

COMBINATION EMERGENCY EYE WASH AND SHOWER STATION NOT TO SCALE

STAINLESS STEEL SUPPORT

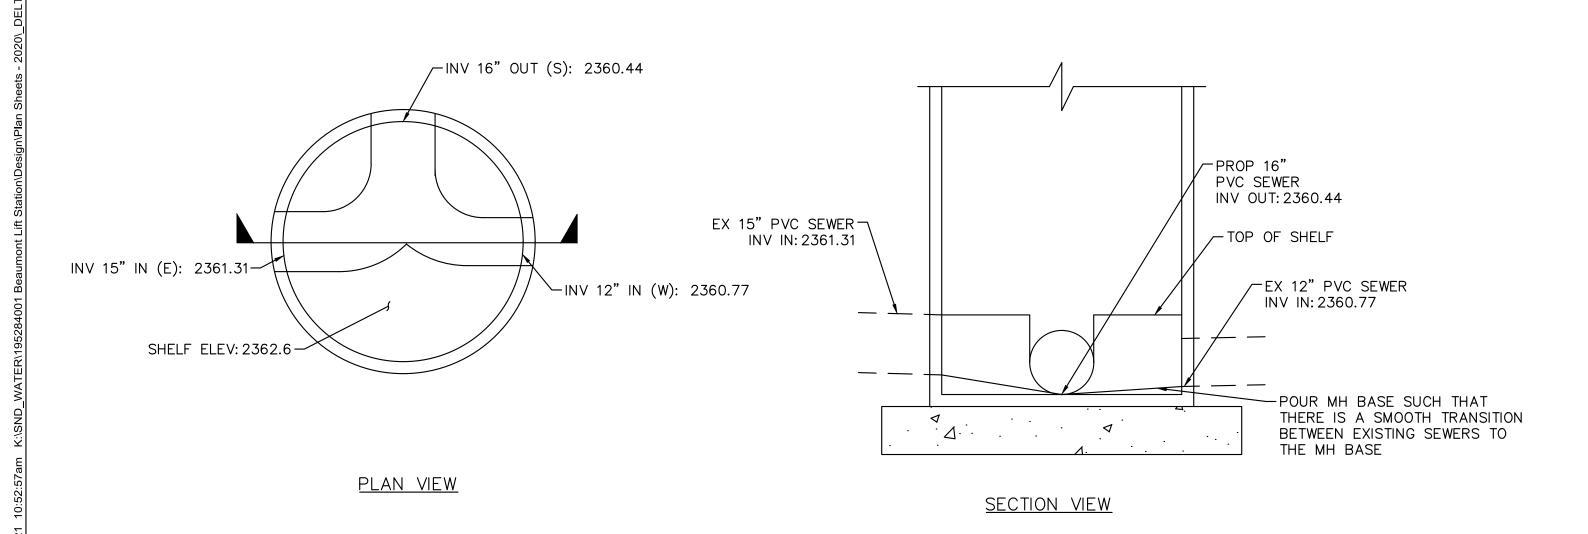


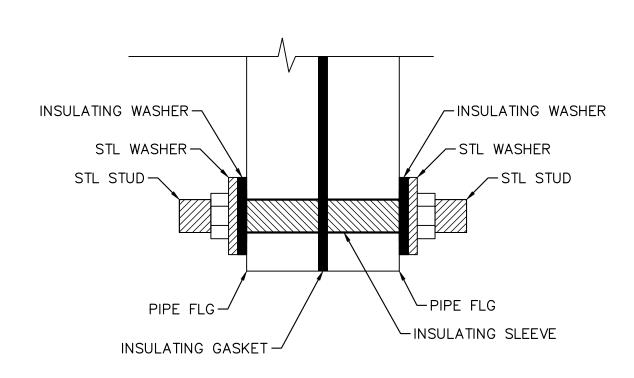

NOTES:

1. FULL LENGTH INSULATING SLEEVES REQUIRED AT ALL THRU-FLANGE BOLTS OR STUDS. INSULATING SLEEVES MUST EXTEND THROUGH THE RESTRAINING FLANGE, BOTH PIPE FLANGES, THE INSULATING GASKET, AND TWO INSULATING WASHERS.

BOLLARD SECTION DETAIL NOT TO SCALE

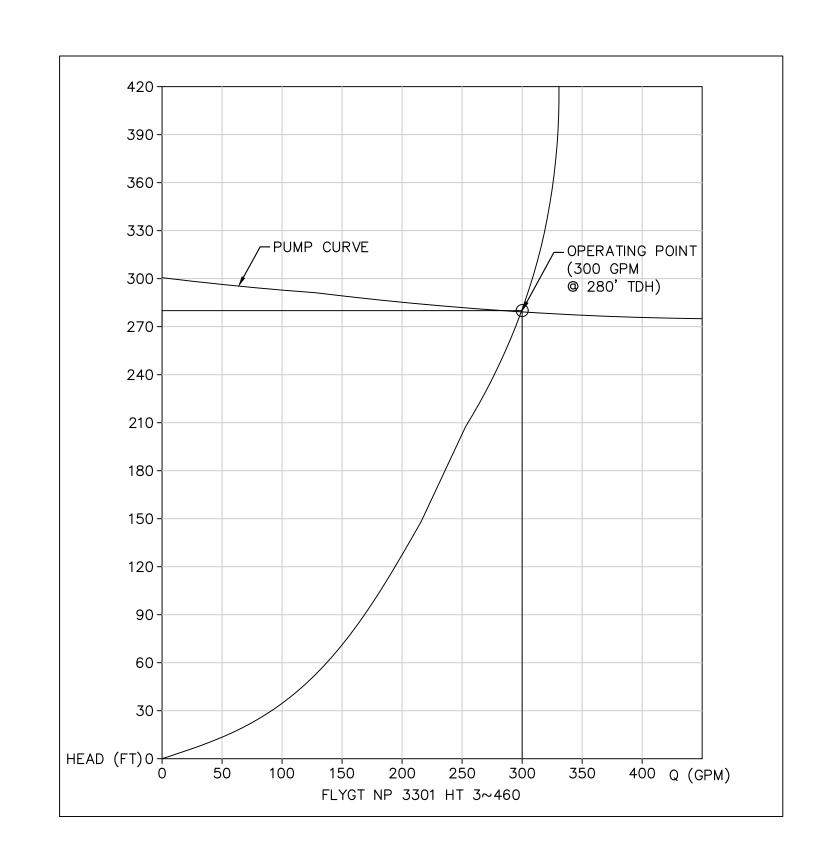

PROPOSED MANHOLE SHELF

SCALE: 1" = 2'


E INSULATING FLANGE KIT


וכ		
ed By:Wueliner, Sam Sheet Set:BEAL		Call 2 Working L Before You Di 811
(I) I) I	

|BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

Kimley» Horn Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM BY MARK DESCRIPTION 8/23/2021 REVISIONS



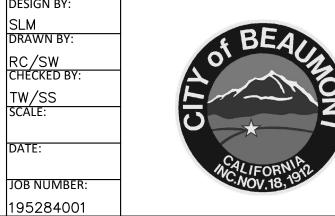

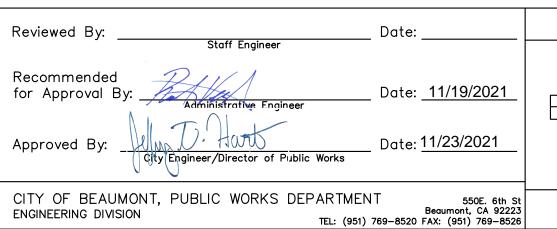



ENGINEERING DIVISION


CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION


DETAILS


of 38 sheets 3387

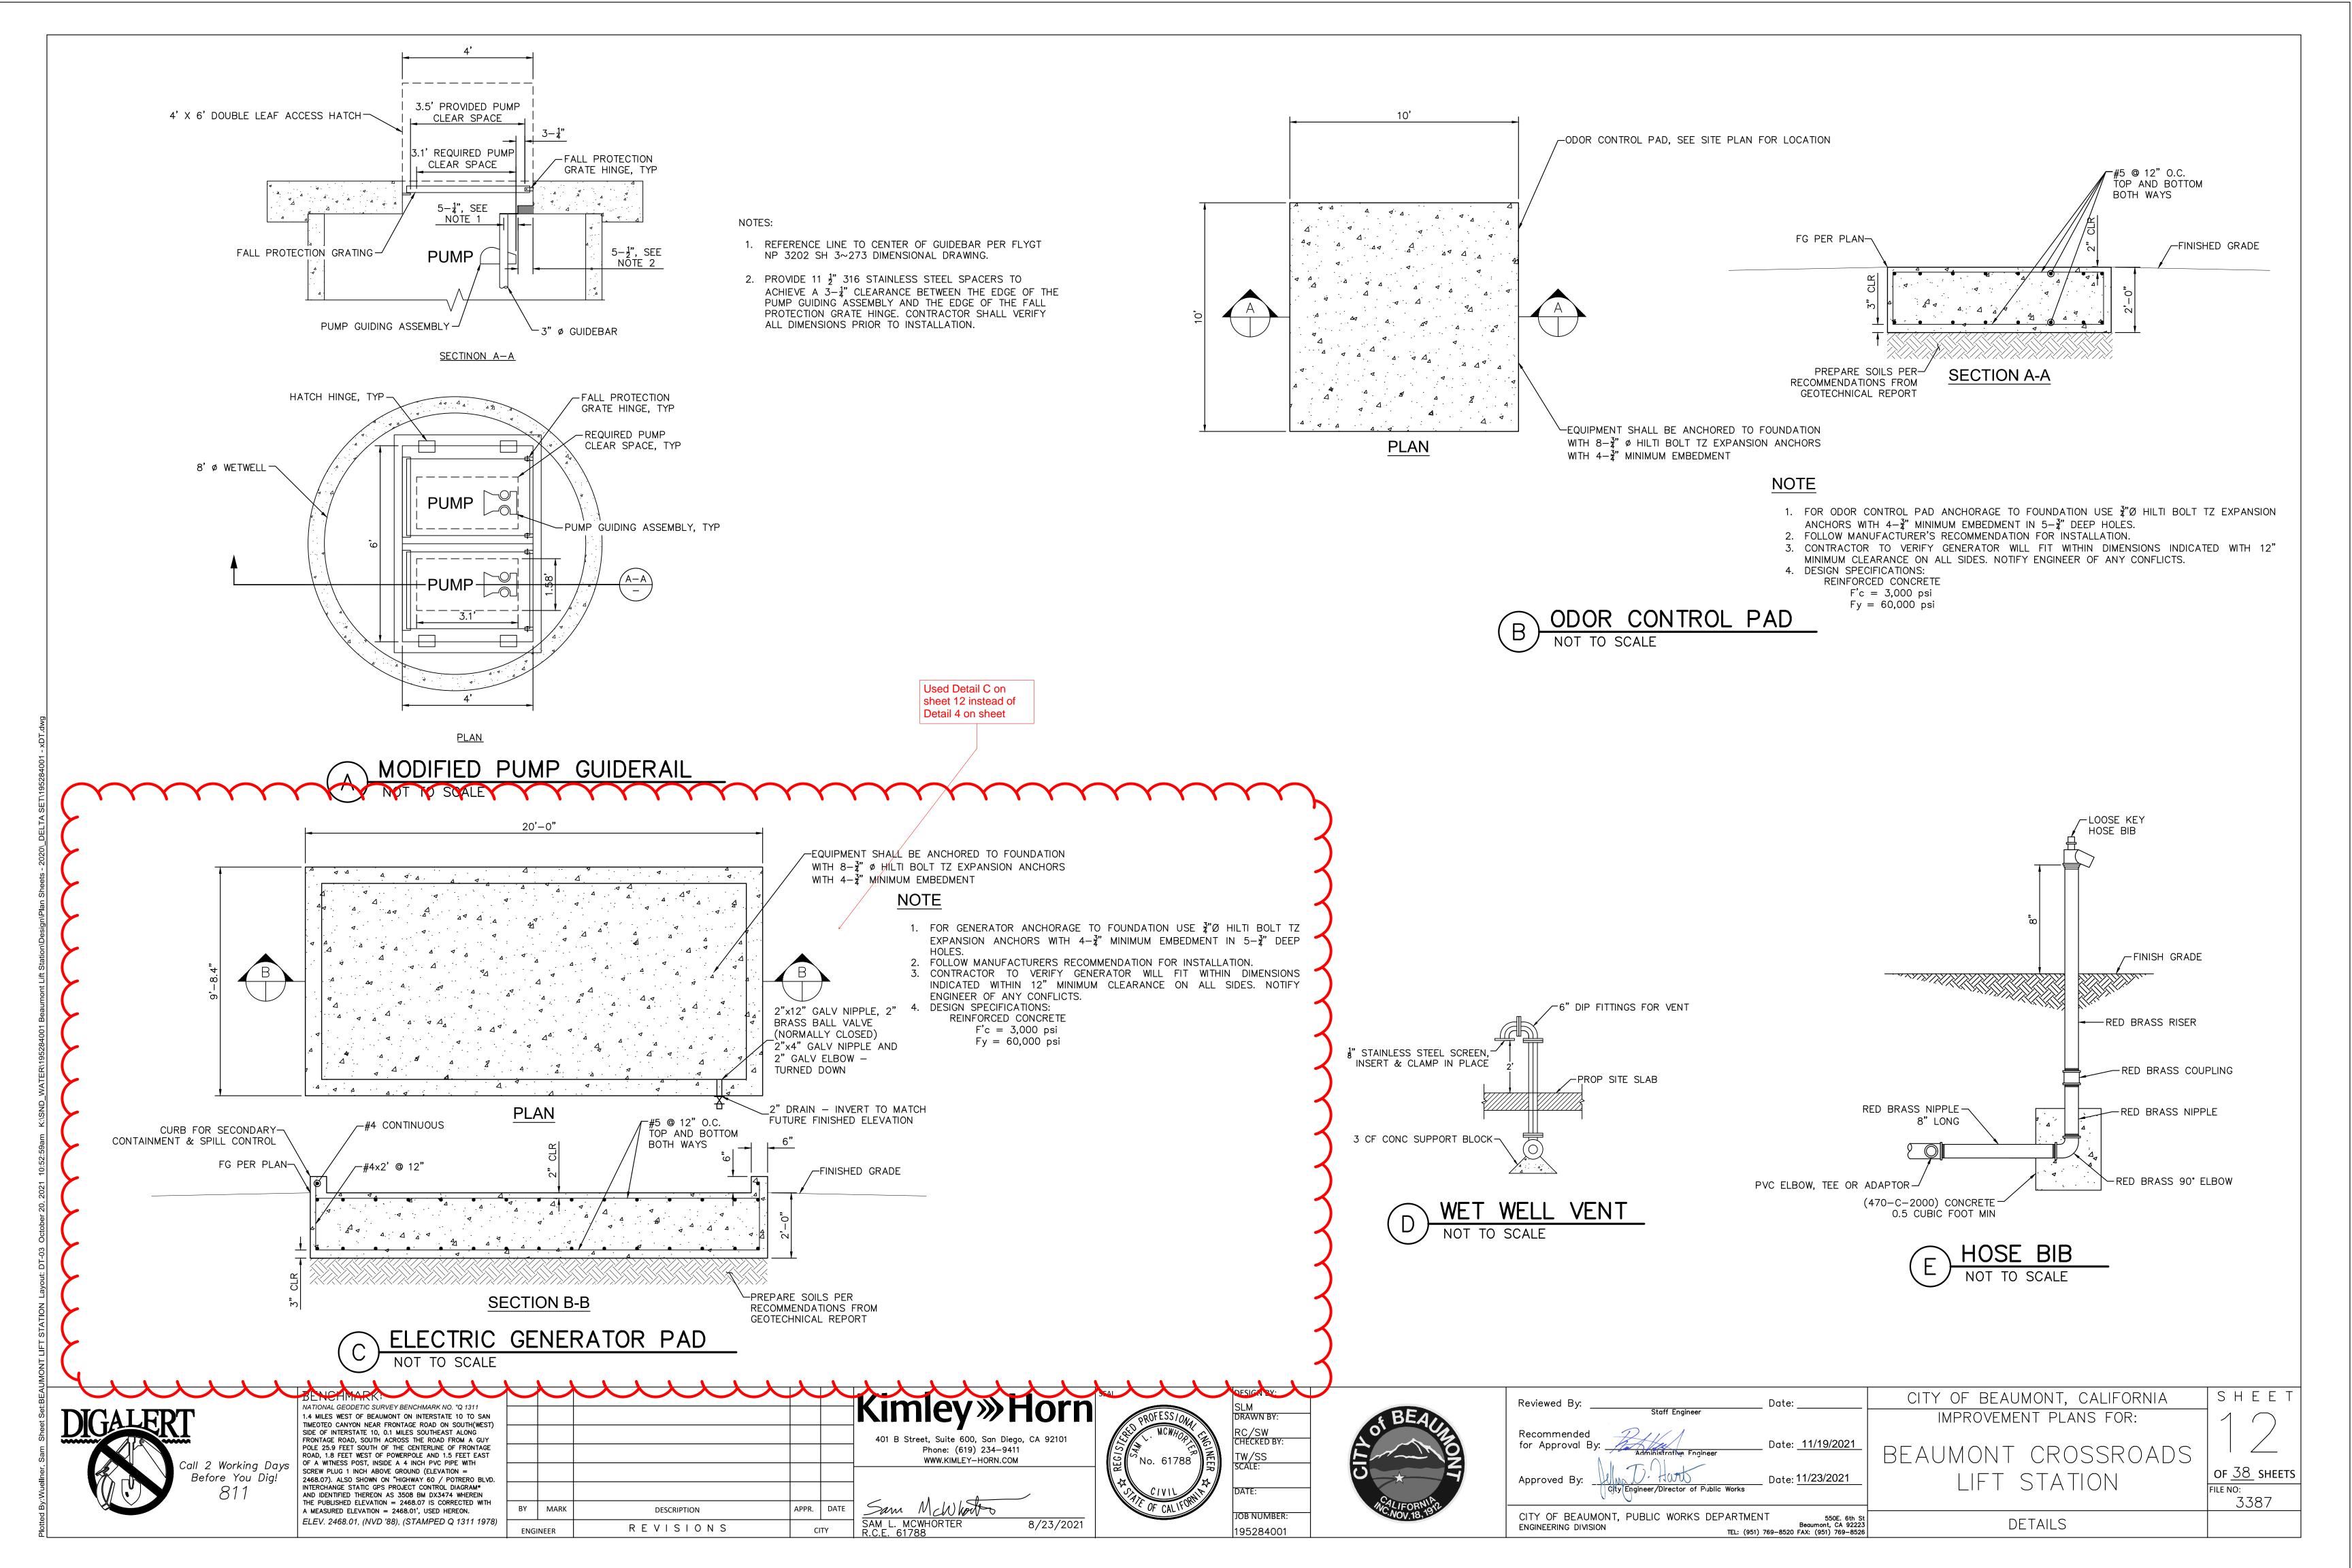


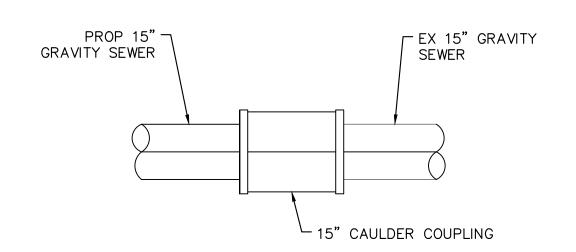

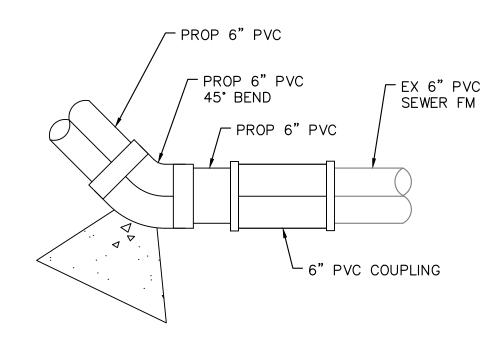


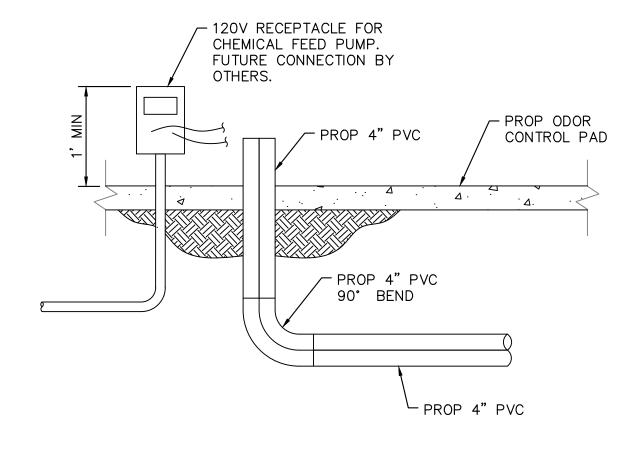








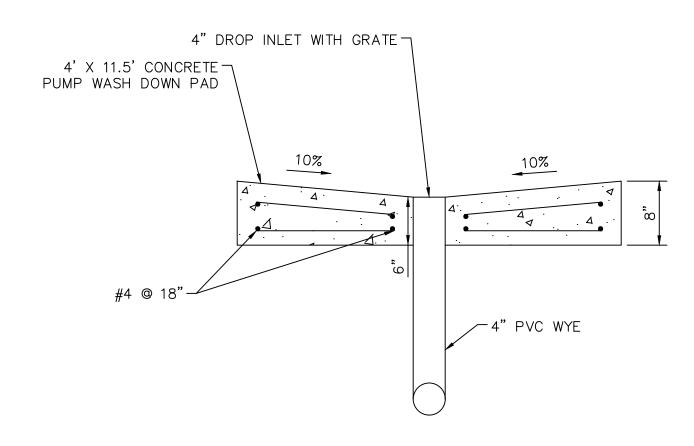







BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN					Kimley » Horn
TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE					401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411
ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD.					WWW.KIMLEY-HORN.COM
INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH	BY	MARK	DESCRIPTION	APPR.	DATE SAMA M. (1) Keylt
A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)		NEER	R E V I S I O N S		SAM L. MCWHORTER 8/23/2021 R.C.E. 61788



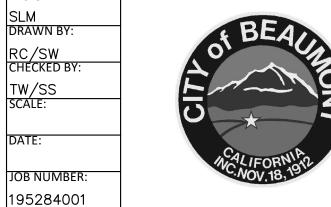

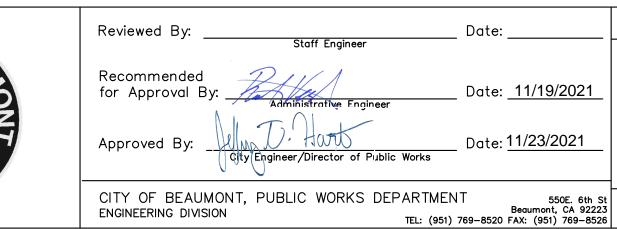

CITY OF BEAUMONT, CALIFORNIA	SHEET
IMPROVEMENT PLANS FOR:	17
BEAUMONT CROSSROADS	
LIFT STATION	of <u>38</u> sheets
LII I STATION	FILE NO:

OF <u>38</u> SHEETS
FILE NO:
3387

DETAILS

ELECTRICAL SYMBOLS CONTROL WIRING DIAGRAMS PLANS SINGLE LINE DIAGRAMS NORMALLY NORMALLY DEVICE — — CONDUIT RUN CONCEALED UNDER SLAB OR BELOW GRADE. AMMETER OPEN CLOSED (CONCEALED IN SLAB WHERE SO NOTED OR WHERE ALLOWED PER SPECIFICATIONS). VOLTMETER CONTACT CONDUIT RUN EXPOSED UNLESS OTHERWISE NOTED — — — EXISTING CONDUIT RUN O O LIMIT SWITCH ----- GROUND WIRE KILOWATT HOUR METER LIMIT SWITCH HELD CLOSED $\sqrt{2}$ \longrightarrow CONDUIT UP (OUT TOP OF EQUIPMENT) AS AMMETER SWITCH CONDUIT DOWN (OUT BOTTOM OF EQUIPMENT) LIMIT SWITCH HELD OPEN --- CONDUIT STUBBED OUT AND CAPPED VOLTMETER SWITCH O O PRESSURE OR VACUUM SWITCH LIGHTING FIXTURE MOUNTED ON POLE OR POST OR ABOVE PLATFORM CEILING MOUNTED LIGHTING FIXTURE LIQUID LEVEL SWITCH GROUND FAULT PROTECTION BRACKET MOUNTED LIGHTING FIXTURE O O TEMPERATURE ACTUATED SWITCH FLOODLIGHT CURRENT TRANSFORMER]LED STRIP 4' LIGHTING FIXTURE FLOW SWITCH (AIR, WATER, ETC.) POTENTIAL TRANSFORMER POLE MOUNTED LIGHT FIXTURE POWER TRANSFORMER SEE NOTE 1. PUSH BUTTON SINGLE CIRCUIT EXIT LIGHT MOMENTARY CONTACT. RECESSED INCANDESCENT OR MERCURY VAPOR LIGHTING FIXTURE CONTROL TRANSFORMER SEE NOTE 2. PUSH BUTTON SINGLE CIRCUIT LOCK-LIGHTING FIXTURES CONNECTED TO EMERGENCY CIRCUITS OUT(LOCATED AT MOTOR UNLESS OTHERWISE NOTED) LIGHTING FIXTURE TYPE A, 100 WATTS, WITH 1 LAMP. SEE ■ DRAW OUT TYPE EQUIPMENT LIGHTING FIXTURE SCHEDULE Q 0 0 T 0 TIMED CONTACT - CONTACT ACTION — ☐ → DRAW OUT TYPE HIGH VOLTAGE MOTOR RELAY ON ENERGIZATION. SINGLE POLE, SINGLE THROW TOGGLE SWITCH Q 0 0TO TIMED CONTACT - CONTACT ACTION PLUG-IN TYPE EQUIPMENT DOUBLE POLE. SINGLE THROW TOGGLE SWITCH RELAY ON DE-ENERGIZATION. ≻AT +48" CIRCUIT BREAKER, 3 POLE UNLESS OTHERWISE THREE-WAY TOGGLE SWITCH OR AS ON-OFF SWITCH. FOUR-WAY TOGGLE SWITCH NOTED DISCONNECT SWITCH, 3 POLE UNLESS EMERGENCY STOP PUSH BUTTON MANUAL MOTOR STARTER OTHERWISE INDICATED (MAINTAINED CONTACT) OUTLETS SHOWN WITH SUBSCRIPT "a" ADJACENT TO THEM _&_ OIL FUSE CUTOUTS STOP STOP -START PUSH-BUTTON SHALL BE CONTROLLED BY S a STATION (MAINTAINED CONTACTS). FUSE SEE NOTE 3. DUPLEX CONVENIENCE RECEPTACLE AT +12" OR AS NOTED SINGLE CONVENIENCE RECEPTACLE AT +12" OR AS NOTED TRANSFER SWITCH, AUTOMATIC SPECIAL PURPOSE RECEPTACLE AT +12" OR AS NOTED, RATING MAGNETIC MOTOR STARTER."1" INDICATES SIZE AS INDICATED RV SIZE 1 HAND-OFF-AUTO SELECTOR SWITCH SEE 1. RV INDICATES REDUCED VOLTAGE. 2S _ _ NOTE 3. (THREE POSITION). JUNCTION BOX, SIZE AS REQUIRED BY CODE INDICATES 2 SPEED. R INDICATES REVERSING. THERMOSTAT OUTLET AT +54" MAGNETIC CONTACTOR CLOCK OUTLET AT +7'-6" OR AS NOTED TELEPHONE OUTLET AT +12" OR AS NOTED CONDUIT NUMBER 12. SEE CONDUIT AND WIRING TWO POSITION SELECTOR SWITCH SEE SCHEDULE FOR SIZES AND QUANTITIES OF TELEPHONE FLOOR OUTLET NOTE 3. CONDUIT AND WIRES. HORN GROUND PILOT LIGHT, Y=YELLOW, R=RED. $-\overrightarrow{Q}R\overrightarrow{D}$ CONTROL DEVICE A=AMBER, SEE NOTE 3. B=BLUE KIRK KEY INTERLOCKING OF EQUIPMENT P = PRESSURE SWITCHW=WHITE, G=GREEN. ZS = LIMIT SWITCHL = LEVEL SWITCHEQUIPMENT FURNISHED, INSTALLED AND BELL V = CONTROL VALVECONNECTED UNDER ANOTHER SECTION OF THE CONTRACT. HORN OR SIREN CONTROL STATION: PUSH-BUTTON STATION OR SELECTOR SWITCH. SEE CONTROL WIRING DIAGRAMS FOR PHASE FAILURE RELAY REQUIREMENTS. (CR CONTROL RELAY EXISTING MOTOR SURGE ARRESTER М **NEW MOTOR** STARTER COIL. EXISTING MOTOR (HP SHOWN) TIME DELAY RELAY. (0-30 SECONDS M (TDR) UNLESS OTHERWISE NOTED). NEW MOTOR (ESTIMATED HP SHOWN) MOTOR STARTER OVERLOAD RELAY GROUND WELL CONTACTS GROUND ROD FUTURE MOTOR (ESTIMATED HP SHOWN) CONTROL TRANSFORMER. SEE NOTES 2 \bigcirc DISCONNECT SWITCH. SEE SINGLE LINE DIAGRAM FOR SIZE. MANUAL MOTOR STARTER LIGHTING PANEL. SURFACE MOUNTED. EYS SEAL SOLENOID OPERATED CONTROL VALVE SWITCHBOARD, DISTRIBUTION PANEL OR MOTOR CONTROL CENTER EQUIPMENT BY OTHERS 120 VOLT, 1 PHASE, MOTOR (UNLESS OTHERWISE NOTED) CONDUIT NUMBER 12. SEE CONDUIT AND WIRING SCHEDULE NOTES: (ELECTRICAL SYMBOLS) FOR SIZES AND QUANTITIES OF CONDUIT AND WIRES. RUNNING TIME METER. (ELAPSED TIME INDICATES HEIGHT FROM FINISHED FLOOR OR GRADE TO METER) 1. POWER TRANSFORMERS SHALL BE DRY TYPE CENTERLINE OF DEVICE. 480-208Y/120 VOLTS, 3 PHASE 4 WIRE UNLESS _______ SPACE HEATERS. (LOCATED AT MOTOR INDICATES TO REFER TO NOTE (1) ON DRAWING OTHERWISE INDICATED. UNLESS OTHERWISE NOTED). WEATHERPROOF. PROVIDE GASKETS AS REQUIRED 2. CONTROL TRANSFORMER SHALL BE DRY TYPE TERMINALS IN MOTOR CONTROL 480-120 VOLTS 1 PHASE UNLESS OTHERWISE CONDUIT ONLY CENTER/MCP INDICATED. SEE CONTROL WIRING DIAGRAMS FOR USE CONTACT OR DEVICE REMOTE FROM INSTRUMENTATION DEVICE. SEE PROCESS AND OF 120 VOLT CONTROL CIRCUITS CONTROL MOTOR CONTROL CENTER/MCP INSTRUMENTATION DRAWINGS FOR DESCRIPTIONS. TRANSFORMERS SHALL BE SIZED TO HANDLE THE LOADS OF ALL RELAYS, PILOT LIGHTS, ETC. TERMINALS IN MOTOR CONTROL PULL BOX (SIZE AS REQUIRED) CONNECTED THERE TO PLUS 50 VA EXTRA CAPACITY. CENTER/MCP CONTACT IN MOTOR CONTROL CENTER OUTPUT TERMINAL 3. LOCATED IN OR ON MOTOR CONTROL CENTER UNLESS FOR CONNECTION TO REMOTE OTHERWISE INDICATED. INPUT TERMINAL DEVICE/MCP DEVICE SIGNAL OUTPUT DEVICE SIGNAL INPUT |BENCHMARK:

ABBREVIATIONS

AMP AMPERE	HZ HERTZ (CYCLES PER SECOND)	O & M OPERATIONS AND MAINTENANCE
AL ALUMINUM	IC INTERRUPTING CAPACITY	P POLE
AT AMP TIP	JB JUNCTION BOX	PG&E PACIFIC GAS AND ELECTRIC
ATS AUTOMATIC TRANSFER SWITCH	KV KILOVOLTS	PLC PROGRAMMABLE LOGIC CONTROLLE
AWG AMERICAN WIRE GAUGE	LB ELBOW	PNL PANEL
B.C. BARE COPPER	LCL LONG CONTINUOUS LOAD	PR PAIR
BRK BREAKER	LSH LEVEL SWITCH HIGH	PVC POLYVINYL CHLORIDE
CAT CATALOG	LSHH LEVEL SWITCH HIGH HIGH	R RADIUS
CIRC.MIL CIRCULAR MILS (AWG)	LSL LEVEL SWITCH LOW	REC RECEPTACLE
CLR CLEARANCE	LSLL LEVEL SWITCH LOW LOW	RGS RIGID GALVANIZED STEEL
C.O. CONDUIT ONLY	LTG LIGHTING	RMS ROOT MEAN SQUARE
CKT CIRCUIT	MA MILLIAMPERE	R/W RIGHT OF WAY
CP CONTROL PANEL	MAX MAXIMUM	SCHED SCHEDULE
CU CONDENSER UNIT	MCC MOTOR CONTROL CENTER	SES SERVICE ENTRANCE SECTION
DIA DIAMETER	MCP MAIN CONTROL PANEL	SPECS SPECIFICATIONS
DWG DRAWING	MCM THOUSAND CIRCULAR MIL (AWG)	SQ SQUARE
EA EACH	MFR MANUFACTURER	SSS SOLID STATE STARTER
ELECT ELECTRICAL	MIN MINIMUM	STD STANDARD
ELEV ELEVATION	MIS MISCELLANEOUS	T THICK
EXIST EXISTING	MPZ MINI POWER ZONE	TB TERMINAL BLOCK
FLA FULL LOAD AMPS	MTG MOUNTING	TEL TELEPHONE
FUT FUTURE	MV MERCURY VAPOR	TDR TIME DELAY RELAY
GFCI GROUND FAULT CIRCUIT INTERRUPTER	N.C. NORMALLY CLOSED	TTB TELEPHONE TERMINAL BACKBOARD
GND GROUND	NEC NATIONAL ELECTRICAL CODE	TYP TYPICAL
HOA HANDS-OFF-AUTO	N.O. NORMALLY OPEN	UCP UNIT CONTROL PANEL
HP HORSEPOWER	NO. NUMBER	UG UNDERGROUND
HPS HIGH PRESSURE SODIUM	O.C. ON CENTER	U.L. UNDERWRITERS LABORATORY

GENERAL ELECTRICAL REQUIREMENTS

- 1. THE COMPLETED INSTALLATION SHALL CONFORM TO ALL APPLICABLE FEDERAL, STATE AND LOCAL CODE ORDINANCES AND REGULATIONS. CONTRACTOR SHALL OBTAIN NECESSARY PERMITS AND INSPECTIONS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION. ALL WORK SHALL BE DONE IN A NEAT, WORKMANLIKE, FINISHED AND SAFE MANNER, ACCORDING TO THE LATEST PUBLISHED N.E.C.A. STANDARDS OF INSTALLATION, UNDER COMPETENT SUPERVISION. INSTALL GROUNDING AS REQUIRED BY THE CODE(S).
- 2. VISIT THE SITE PRIOR TO BIDDING TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND ALL OTHER FACTORS WHICH MAY AFFECT THE EXECUTION OF THIS WORK. INCLUDE ALL RELATED COSTS IN THE INITIAL BID PROPOSAL.
- 3. ALL MATERIALS SHALL BE NEW AND OF THE BEST QUALITY, MANUFACTURED IN ACCORDANCE WITH NEMA, ANSI, U.L. OR OTHER APPLICABLE STANDARDS. THE USE OF MANUFACTURER'S NAMES, MODELS, AND NUMBERS IS INTENDED TO ESTABLISH STYLE, QUALITY, APPEARANCE, USEFULNESS AND BID PRICE. PROPOSED SUBSTITUTIONS SHALL BE SUBMITTED IN WRITING AND REVIEWED BY THE ENGINEER BEFORE ORDERING.
- 4. PROTECT ALL ELECTRICAL MATERIAL AND EQUIPMENT INSTALLED UNDER DIVISION 6 AGAINST DAMAGE BY OTHER TRADES, WEATHER CONDITIONS OR ANY OTHER CAUSES. EQUIPMENT FOUND DAMAGED OR IN OTHER THAN NEW CONDITION WILL BE REJECTED AS DEFECTIVE.
- 5. LEAVE THE SITE CLEAN, REMOVE ALL DEBRIS, EMPTY CARTONS, TOOLS, CONDUIT, WIRE SCRAPS AND ALL MISCELLANEOUS SPARE EQUIPMENT AND MATERIALS USED IN THE WORK DURING CONSTRUCTION. ALL COMPONENTS SHALL BE FREE OF DUST, GRIT AND FOREIGN MATERIALS, LEFT AS NEW BEFORE FINAL ACCEPTANCE OF WORK.
- 6. CIRCUIT CONDUCTORS #2 AWG OR SMALLER TO BE COPPER TYPE "XHHW" FOR BELOW GRADE INSTALLATION OR COPPER TYPE THHN/THWN FOR ABOVE GRADE INSTALLATIONS. #1 AWG OR LARGER SHALL BE COPPER TYPE "XHHW-2" STRANDED COPPER. MINIMUM CONDUCTOR SIZE TO BE #12 AWG WITH #12 GND.
- 7. UNDERGROUND CONDUITS TO BE SCHEDULE 40 PVC. MINIMUM DEPTH 30", MINIMUM SIZE 1", UNLESS OTHERWISE SHOWN ON THE PLANS. CONDUITS AS SHOWN ARE FOR INFORMATION ONLY. EXACT CONDUIT ROUTING SHALL BE DETERMINED IN THE FIELD BY THE CONTRACTOR.
- 8. OUTDOOR CONDUITS EXPOSED TO BE GALVANIZED RIGID STEEL, MINIMUM SIZE 3/4", UNLESS OTHERWISE NOTED ON THE PLANS. GRS CONDUIT SHALL EXTEND BELOW GRADE TO THE FIRST ELBOW. ALL RGS CONDUIT EXPOSED TO EARTH SHALL BE HALF LAPPED WRAPPED IN SCOTCHRAP 50 10 MIL TAPE OR EQUAL. EXTEND WRAP TO A HEIGHT OF 12" ABOVE GRADE. INDOOR CONDUITS SHALL BE IMC OR EMT UNLESS OTHERWISE SHOWN ON PLAN.
- 9. ALL SAFETY SWITCHES AND OTHER DISTRIBUTION AND CONTROL ELECTRICAL EQUIPMENT SHALL BE U.L. LISTED AND RATED FOR HEAVY DUTY SERVICE.
- 10. ALL WIRING DEVICES SHALL BE SPECIFICATION GRADE.
- 11. ALL ELECTRICAL EQUIPMENT, CONDUIT, WIRING, BOXES, ETC. SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO ORDERING. THE SUBMITTALS SHALL BE NEATLY GROUPED AND ORGANIZED. PERTINENT INFORMATION SHALL BE HIGHLIGHTED, AND THE SPECIFIC PRODUCT SHALL BE IDENTIFIED. ALL SUBMITTALS SHALL BE COMPLETE, AND PRESENTED IN ONE PACKAGE. THE SUBMITTAL SHALL INCLUDE A COMPLETE LIST OF THE EQUIPMENT AND MATERIALS, INCLUDING THE MANUFACTURER'S NAME, PRODUCT SPECIFICATION, DESCRIPTIVE DATA, TECHNICAL LITERATURE, PERFORMANCE CHARTS, CATALOG CUTS, INSTALLATION INSTRUCTIONS, AND SPARE PART RECOMMENDATIONS FOR EACH DIFFERENT ITEM OF THE EQUIPMENT SPECIFIED.

550E. 6th St Beaumont, CA 92223

TEL: (951) 769-8520 FAX: (951) 769-8526

12. IT IS THE OBLIGATION OF THE CONTRACTOR TO ORGANIZE HIS WORK, SO THAT A COMPLETE ELECTRICAL, INSTRUMENTATION, AND CONTROL SYSTEM FOR THE FACILITY WILL BE PROVIDED, AND WILL BE SUPPORTED BY ACCURATE SHOP AND RECORD DRAWINGS, AND O & M MANUALS.




NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468 07) ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH

BY MARK A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)


Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM DESCRIPTION MICHAEL A. COLOMBO 8/23/2021 REVISIONS R.C.E. 19280





195284001



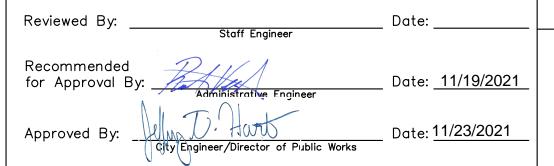

CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT

CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS STATION

V VOLTS

WP WEATHERPROOF

XFMR TRANSFORMER

VAC VOLT ALTERNATING CURRENT


VFD VARIABLE FREQUENCY DRIVE


3387


SHEET

of <u>38</u> sheets

GENERAL ELECTRICAL NOTES

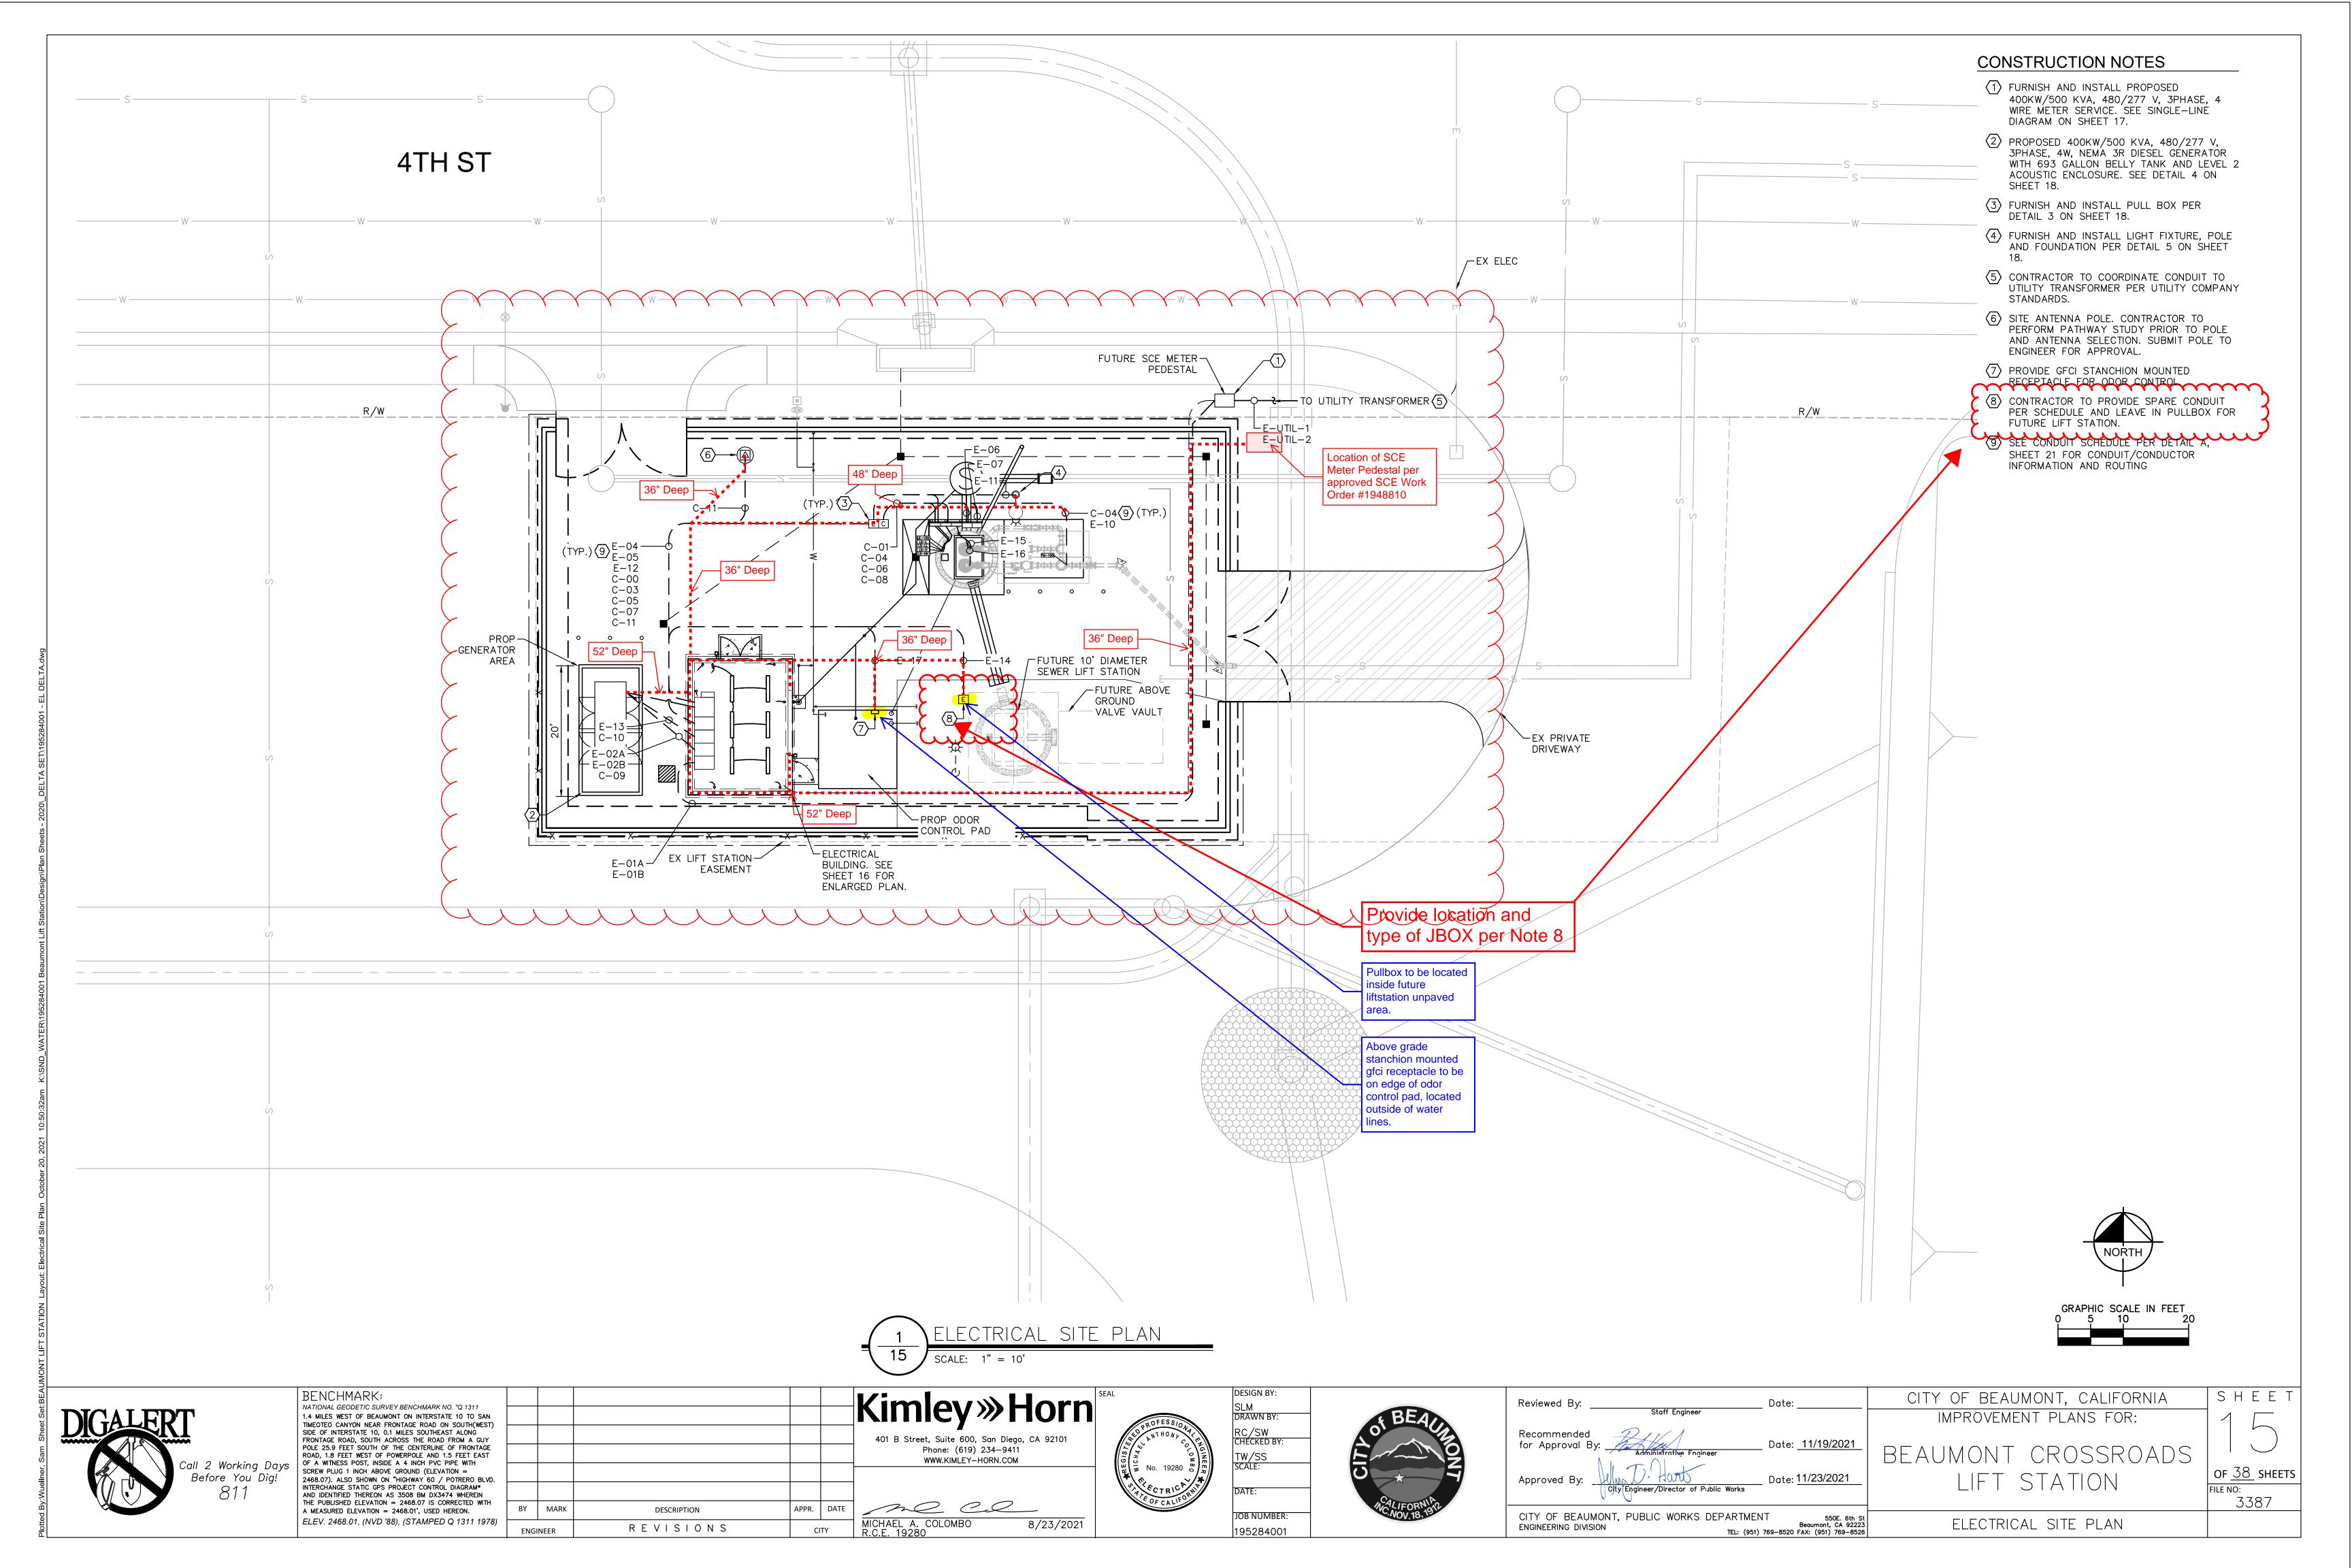


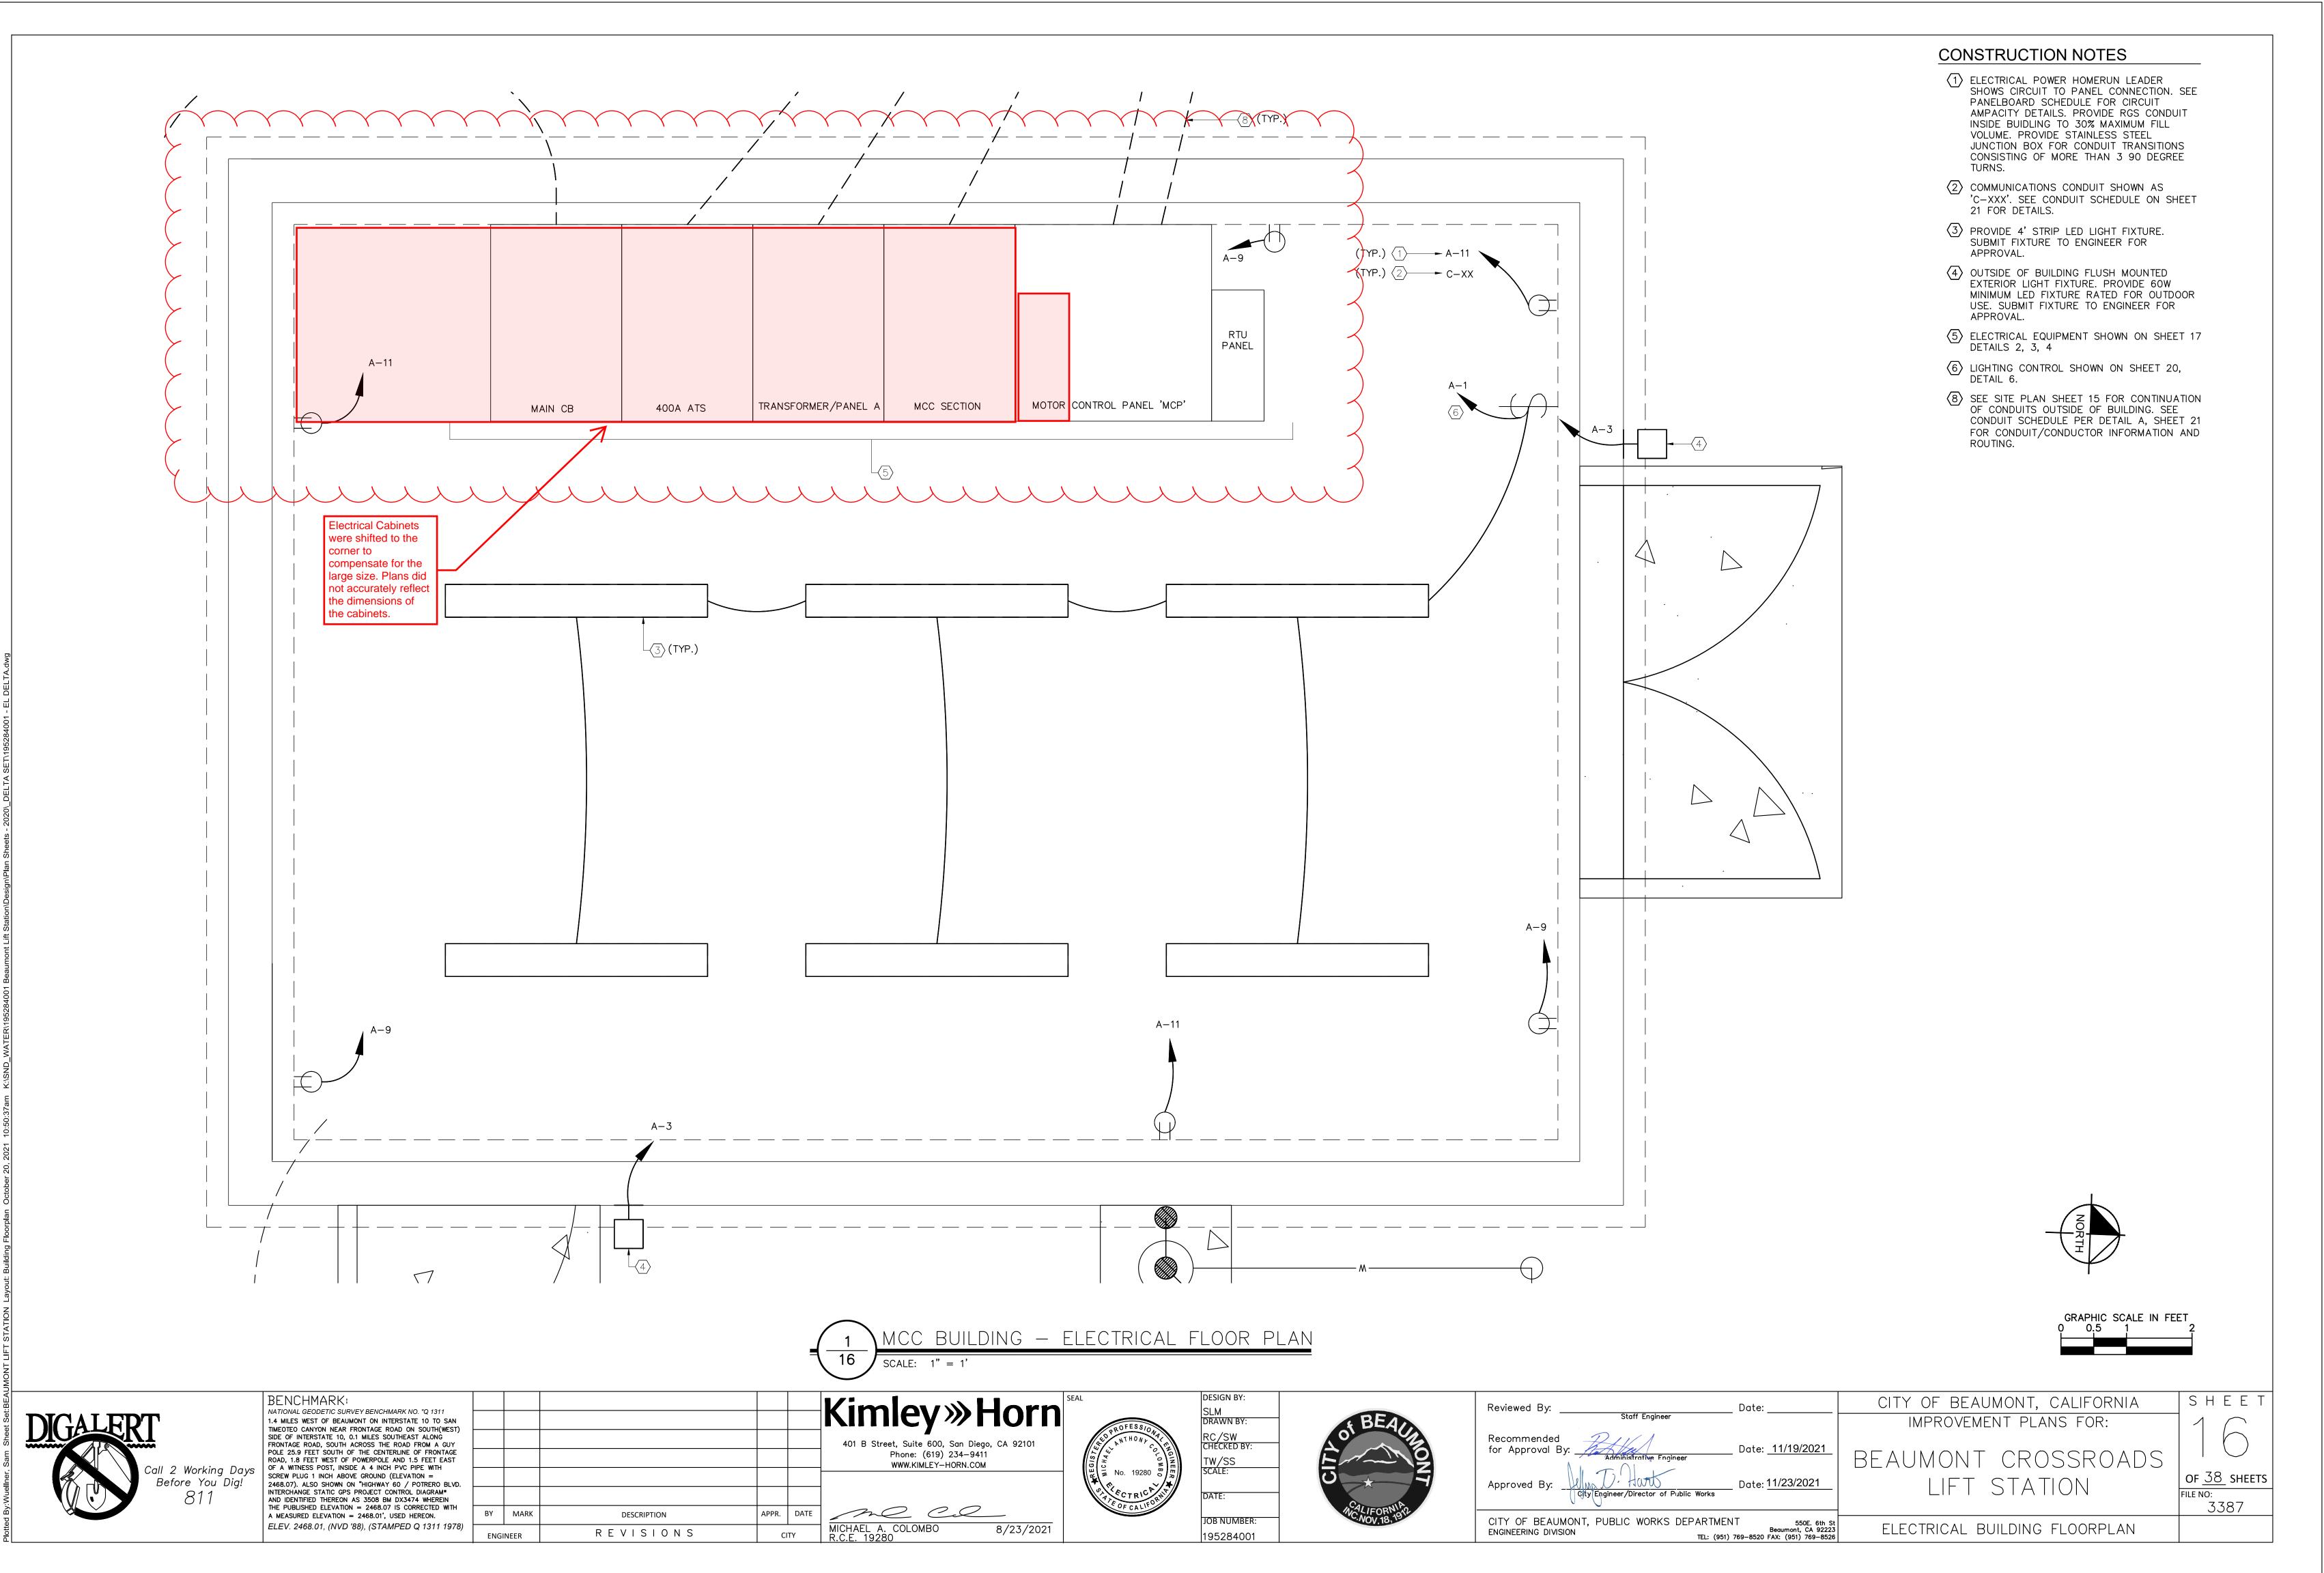

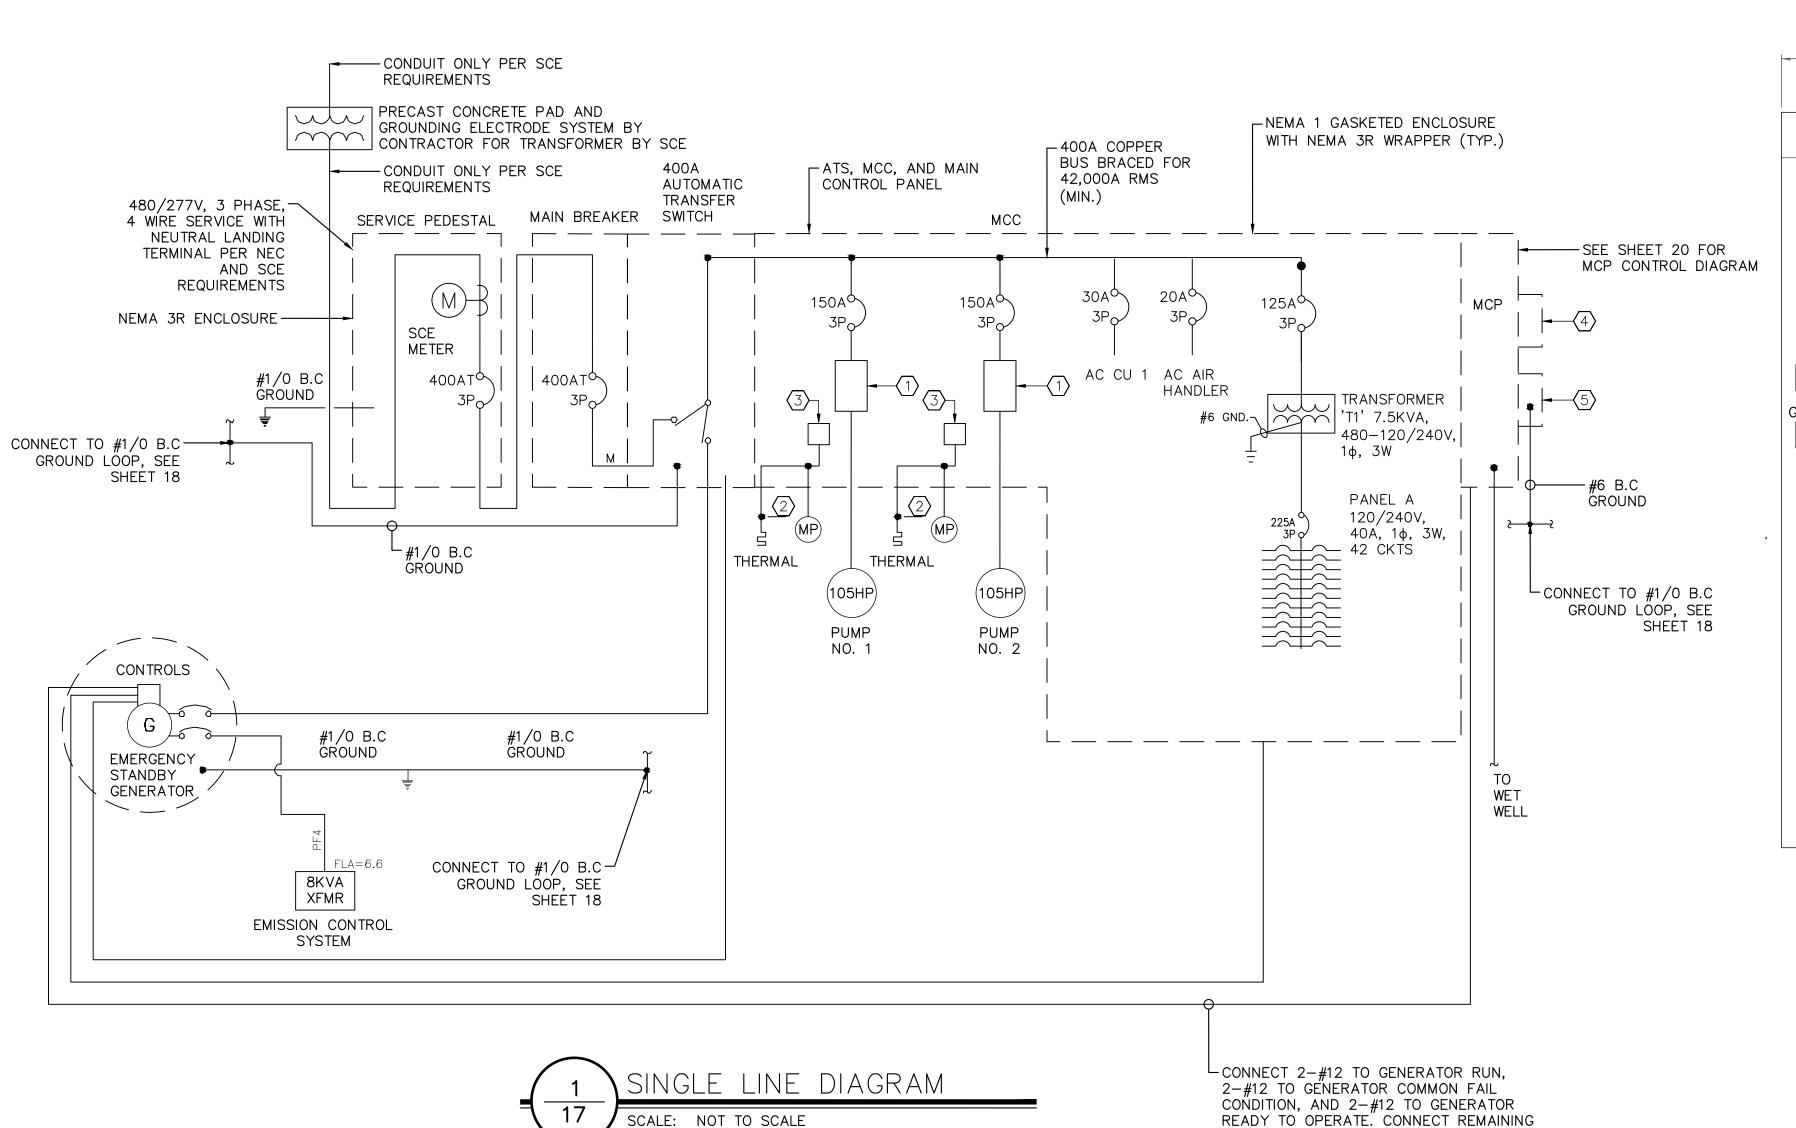



SINGLE-LINE DIAGRAM AND MCC NOTES


- 1 PROVIDE 125HP RATED VFD IN MCC, SIZE OCPD AS SHOWN ON ONE-LINE DIAGRAM.
- (2) THERMAL SENSOR AND MOISTURE PROBES IN PUMPING UNIT.
- MOTOR THERMAL AND MOISTURE PROTECTION CONTROL MODULE(S). IF REQUIRED, TO BE FURNISHED BY PUMP MANUFACTURER. MOUNT MODULE(S) IN MAIN CONTROL PANEL 'MCP'.
- (4) RTU PANEL. CONTRACTOR SHALL FURNISH AND INSTALL HOFFMAN PANEL, C-SD30248 WITH LOCKING HANDLE C-WHPTO, AND DATA POCKET A-DP2, DISTRICT WILL FURNISH BACK PANEL WITH RTU FOR CONTRACTOR TO INSTALL AND TERMINATE CONDUCTORS.
- RADIO LIGHTNING ARRESTOR PANEL. CONTRACTOR SHALL FURNISH AND INSTALL HOFFMAN PANEL, C-SD20208 WITH CP2020 BACK PANEL AND LOCKING HANDLE C-WHPTO. RADIO LIGHTNING ARRESTOR WILL BE FURNISHED AND INSTALLED BY DISTRICT.
- 6 2" LB and 2" RIGID ALUMINUM CONDUIT WITH WEATHER HEAD. ATTACH TO SIDE OF MCP WITH UNISTRUT SUPPORTS.
- PANEL ANCHOR BOLTS SHALL BE 316 S.S. DEFERRED BOLTING DEVICES PER SPECIFICATION REQUIREMENTS. CONTRACTOR SHALL SUBMIT ANCHORAGE CALCULATIONS IN ACCORDANCE WITH SPECIFICATION REQUIREMENTS.
- OPERATOR INTERFACE TERMINAL (OIT) C-MORE TOUCH PANEL PART NO. EA7-T6CL-R (NO SUBSTITUTES). PROVIDE 2-#14, 1-#14 GRD., 24VDC POWER CONDUCTORS, AND 8-CONDUCTOR FLAT COMMUNICATIONS CABLE FROM OIT TO RTU CABINET (DISTRICT WILL CONNECT TO RTU).
- PAPERLESS CHART RECORDER. EZTREND QXE, AS MANUFACTURED BY HONEYWELL MODEL TVEZQX-60-000-22 (NO SUBSTITUTES) CHART RECORDER SHALL BE FLUSH MOUNTED TO FACE OF MCP DOOR. CHART RECORDER SHALL ACCEPT A MINIMUM OF FOUR 4-20MA INPUTS AND OPERATE ON 120VAC POWER. CHART RECORDER SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S PRINTED INSTRUCTIONS. SUPPLIER OR CONTACT TRENDVIEW RECORDERS 1-800-843-6307
- (10) FLUSH MOUNT ULTRASONIC CONTROLLER ON MCP DOOR.
- FLUSH MOUNT REMOTE FLOW METER SIGNAL CONVERTER ON MCP DOOR. CONTRACTOR SHALL PROVIDE DOOR CUT-OUT, SUPPORT BRACKETS, AND BEZEL AS REQUIRED FOR FLUSH DOOR MOUNTING.
- PLEXIGLASS SHIELD TO COVER BACK OF DOOR MOUNTED DEVICES (LIGHTS, SWITCHES, OIT, ETC.). 1/8" THICK PLEXIGLASS SHIELD WITH 1/4" DIA. S.S. BOLTS AT EACH CORNER OF SHIELD AND SPACERS BETWEEN MCP DOOR AND PLEXIGLASS

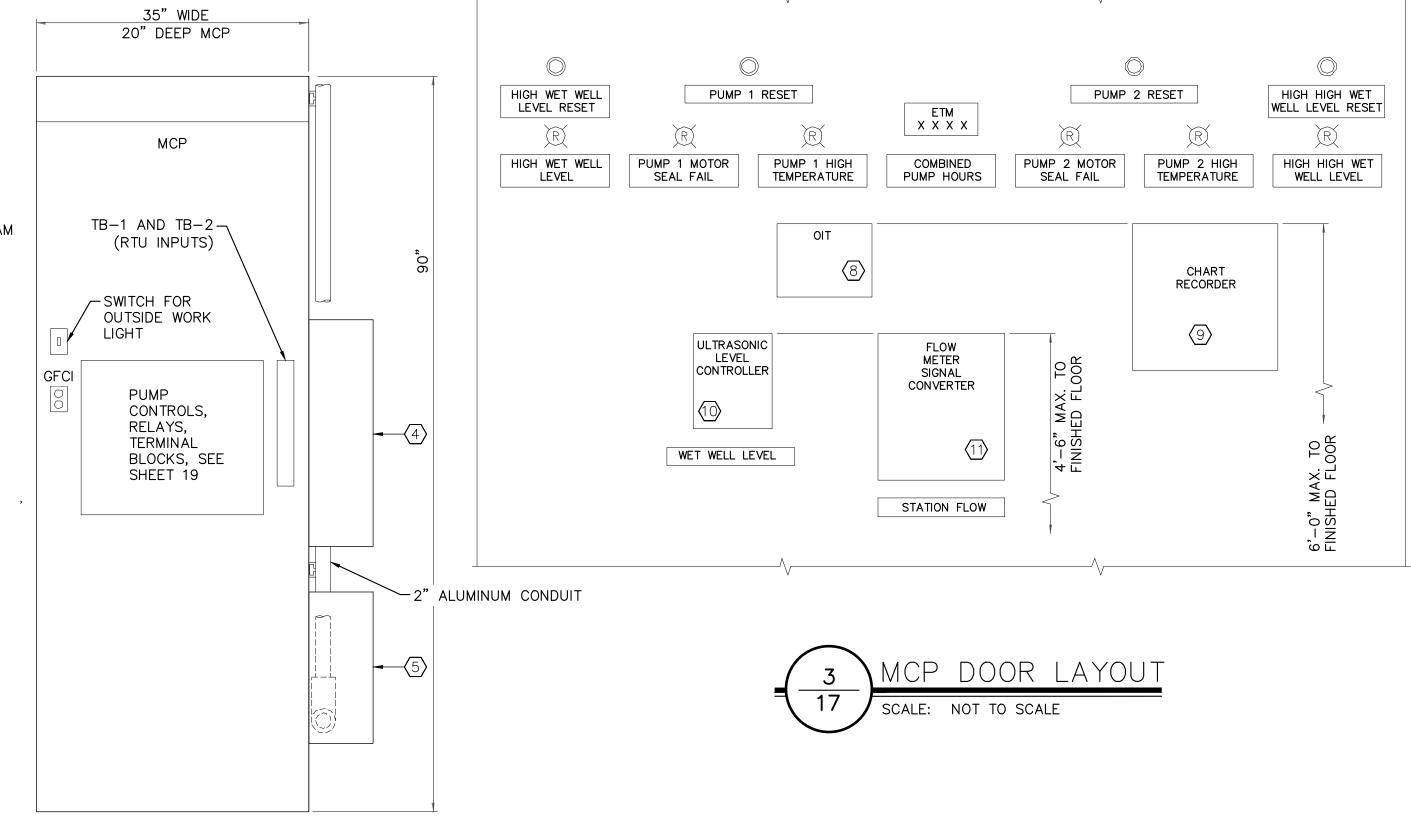


MAIN C.B.

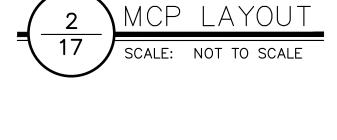

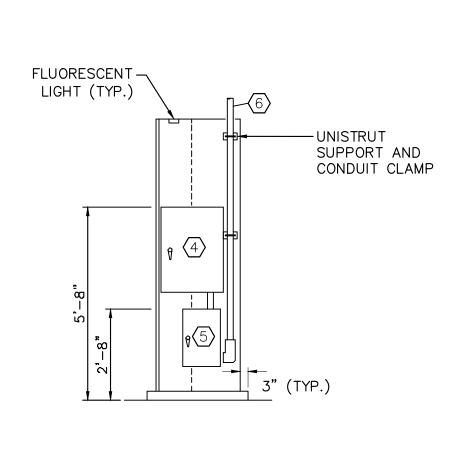

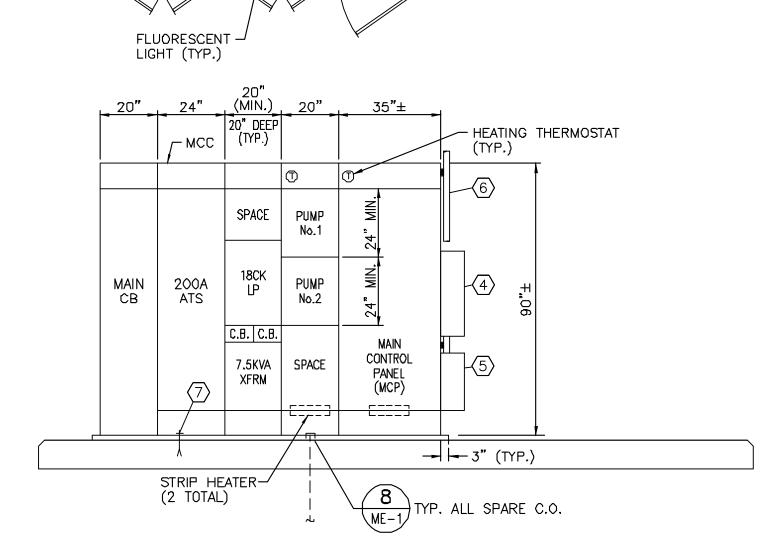



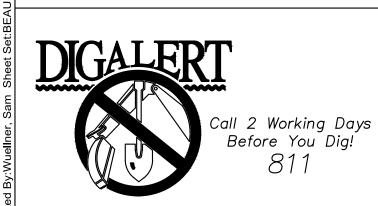


BENCHMARK:

NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311

1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM*
AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON.

ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)



SPARES TO MCP TERMINAL STRIP

DESIGN BY:

SLM
DRAWN BY:


RC/SW
CHECKED BY:

TW/SS
SCALE:

DATE:

JOB NUMBER:

195284001

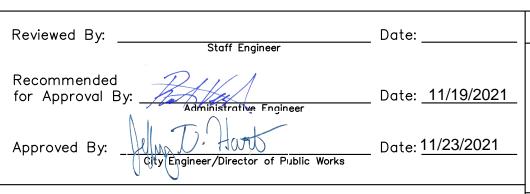

CITY OF BEAUMONT, CALIFORNIA
IMPROVEMENT PLANS FOR:
BEAUMONT CROSSROADS
LIFT STATION

OF <u>38</u> SHEETS
FILE NO:
3387


SHEET


CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT

ENGINEERING DIVISION

TEL: (951) 769-8520 FAX: (951) 769-8526

ELECTRICAL SINGLE LINE AND SCHEDULES

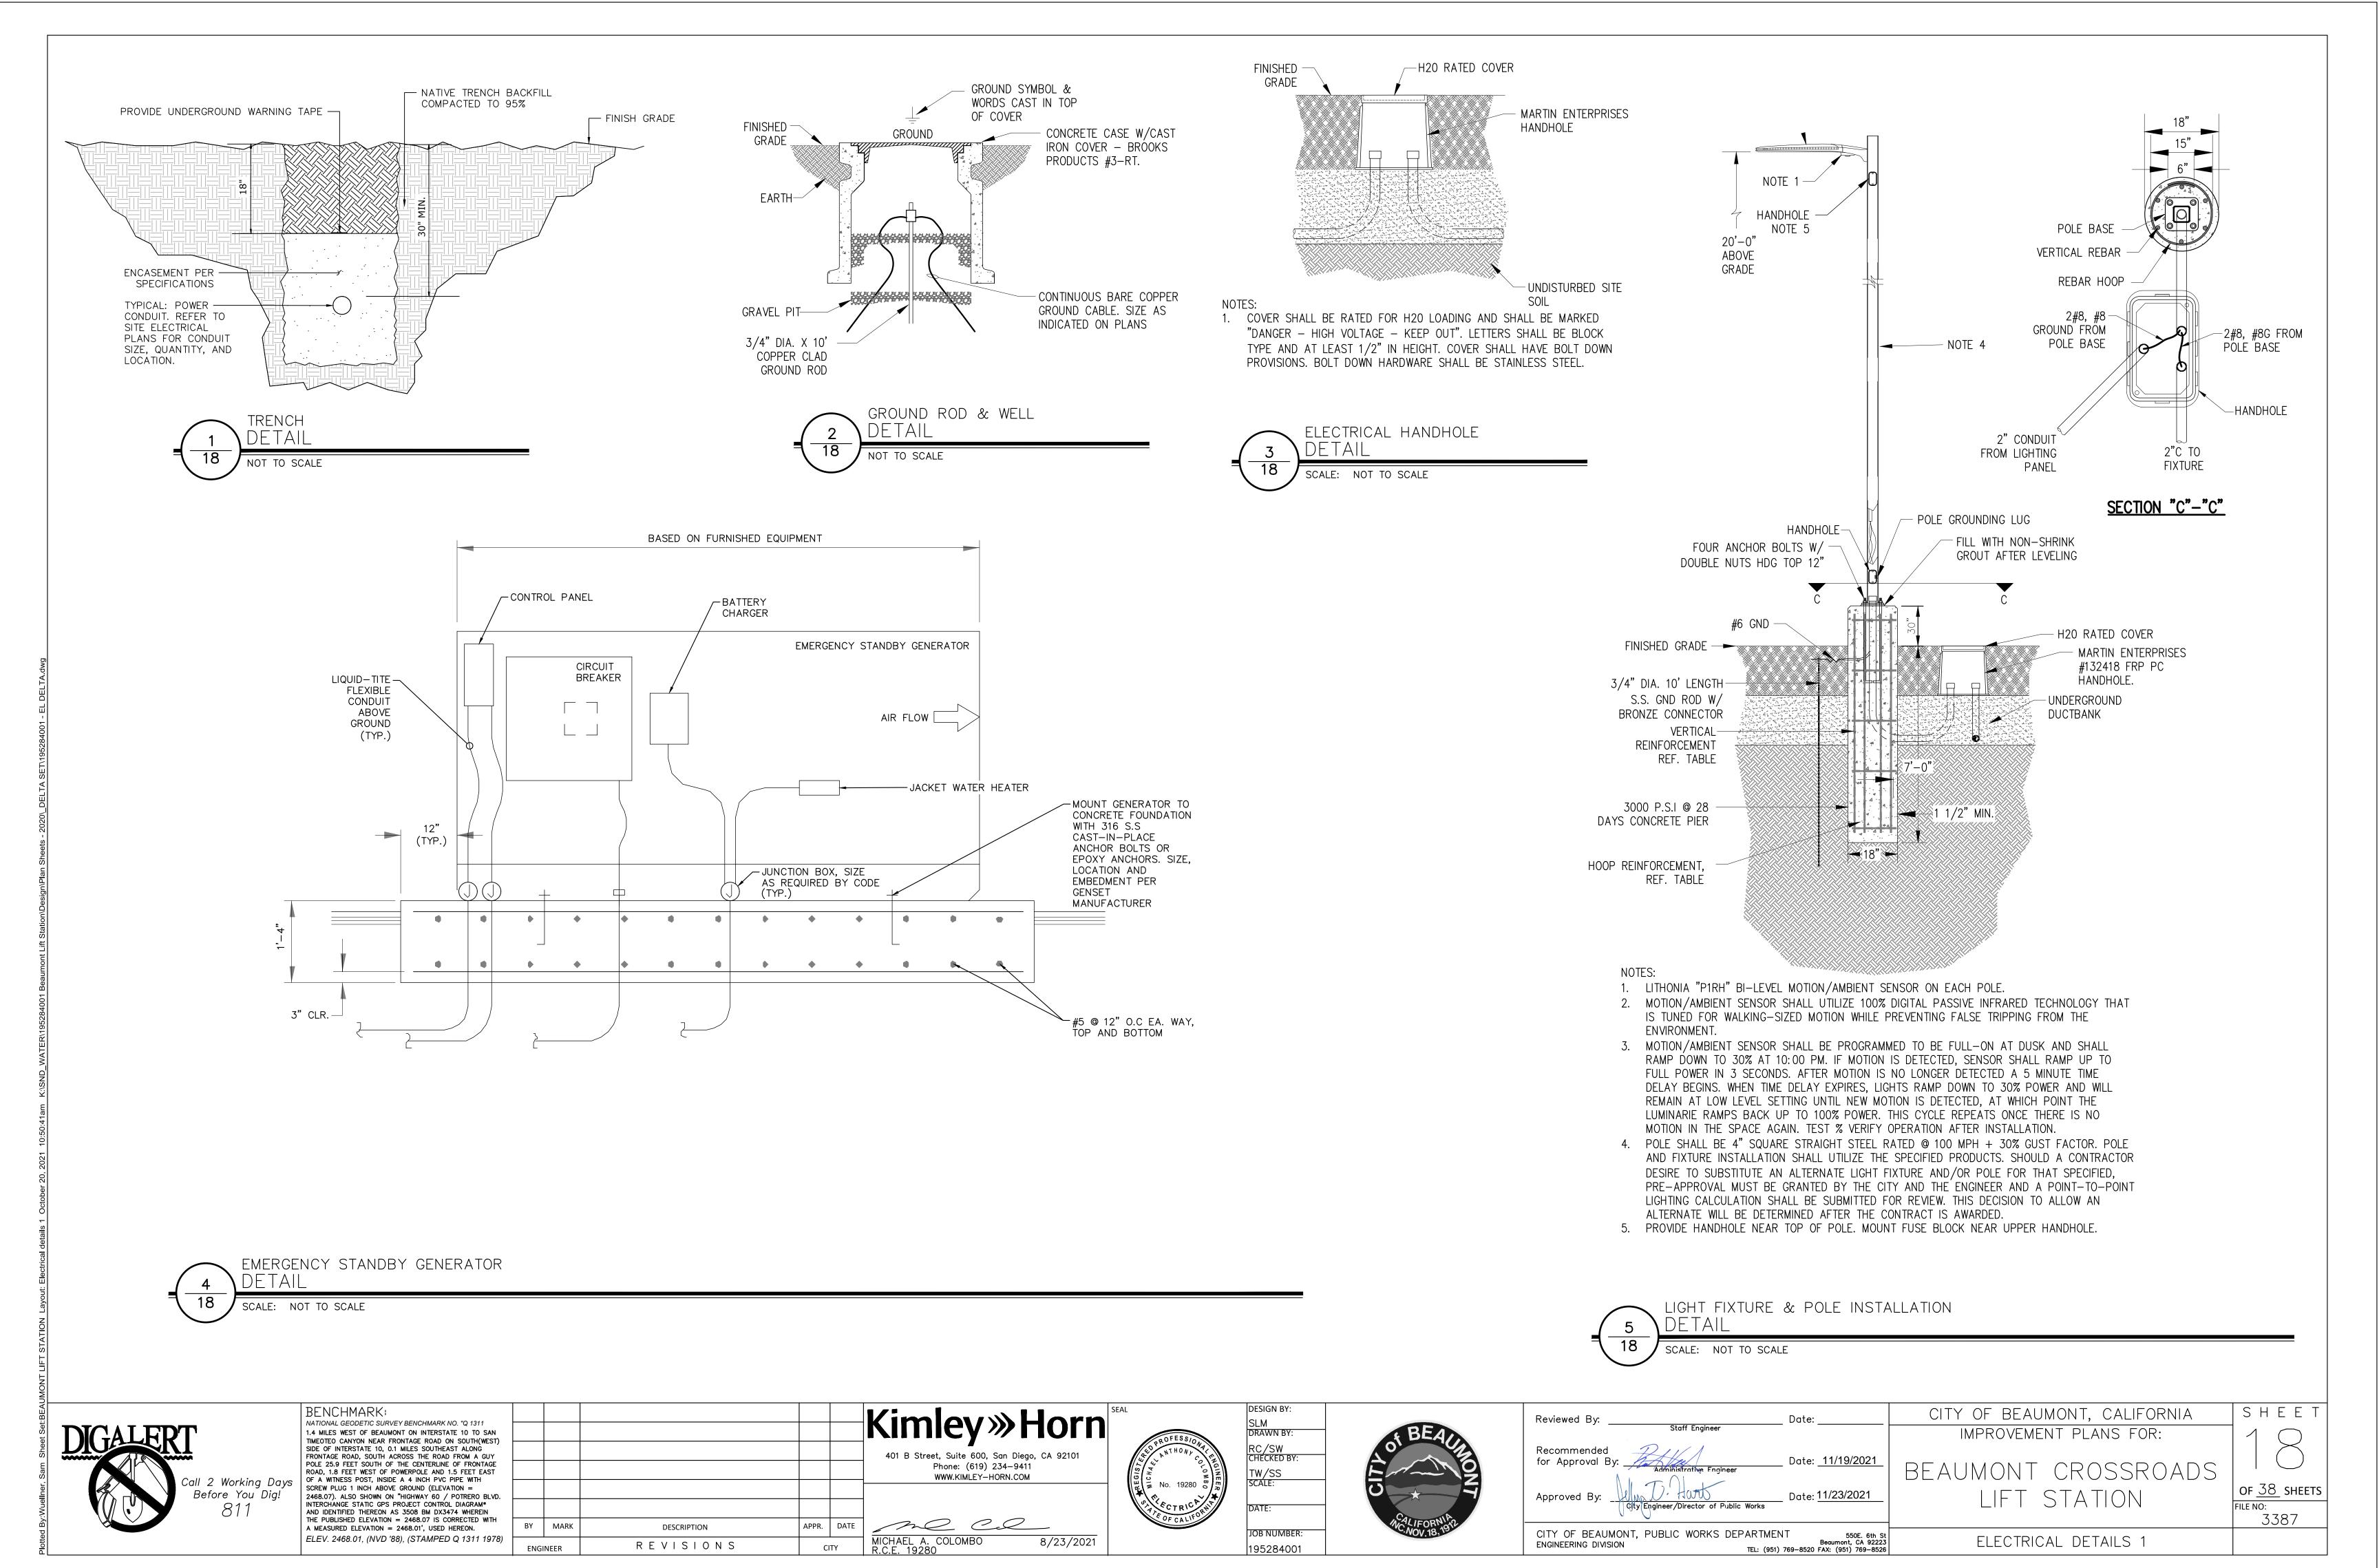


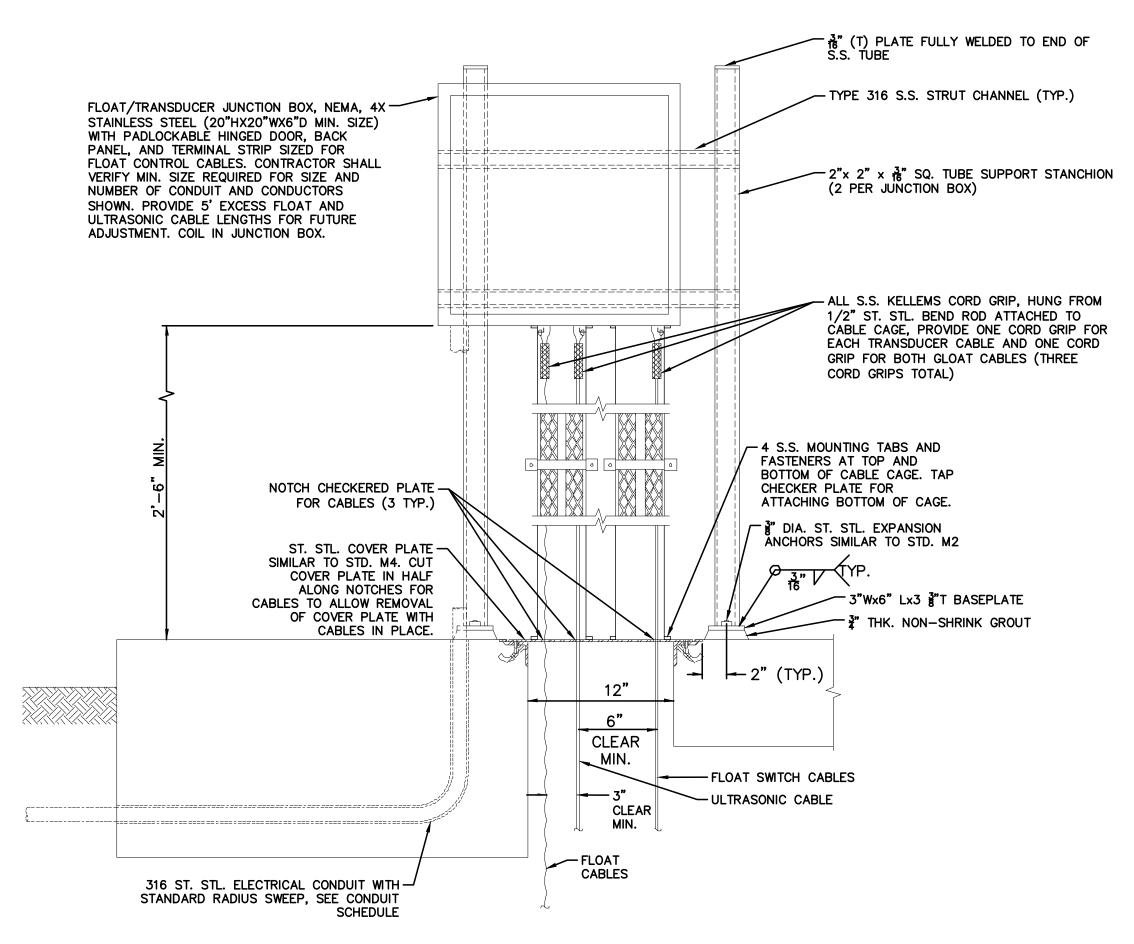

<u>notes:</u> 1. Junction box support stanchions shall be constructed of 316 stainless steel.

- 2. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR CABLE CAGE TO THE CITY FOR APPROVAL PRIOR TO FABRICATION.
- 3. WET WELL SHAFT NOT SHOWN FOR CLARITY.
- 4. LEVEL TRANSDUCER CABLE CONTINUOUS TO LEVEL CONTROLLER IN MCP.
- 5. ELECTRICAL PULL BOX NOT SHOWN FOR CLARITY.



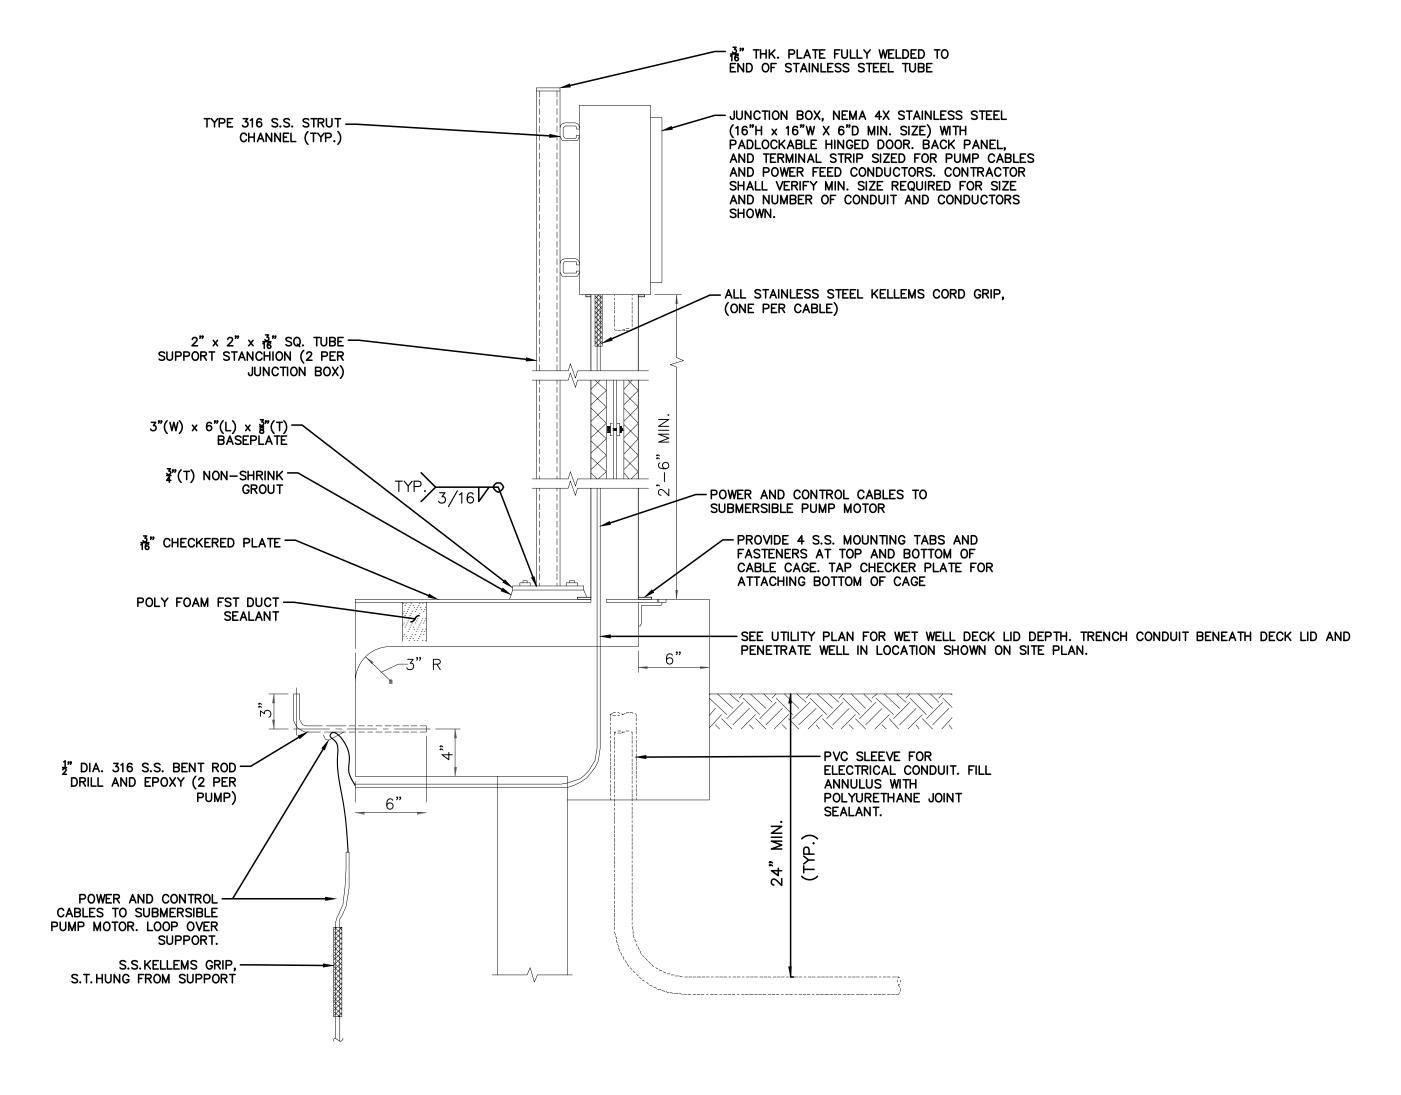



NOTES:

1. JUNCTION BOX SUPPORT STANCHIONS SHALL BE CONSTRUCTED OF 316
STAINLESS STEEL


2. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR PUMP CABLE CAGE TO THE CITY FOR APPROVAL PRIOR TO FABRICATION.




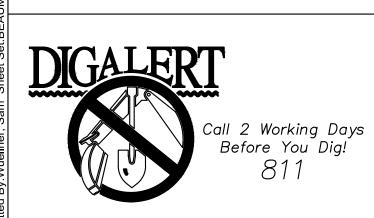

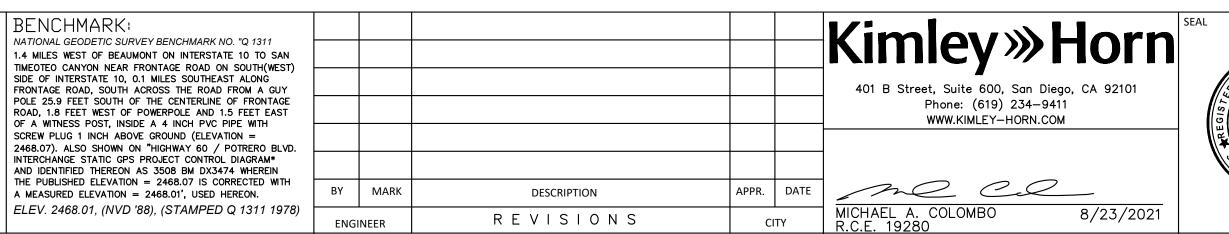



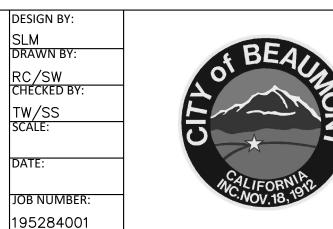


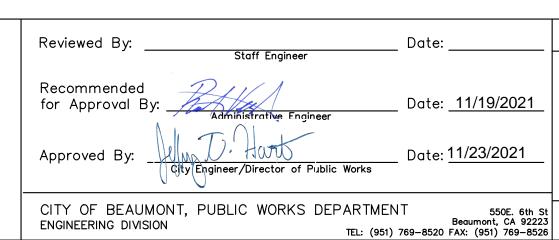

CITY OF BEAUMONT, CALIFORNIA
IMPROVEMENT PLANS FOR:
BEAUMONT CROSSROADS
LIFT STATION

ELECTRICAL DETAILS 2

OF <u>38</u> SHEETS
FILE NO:
3387

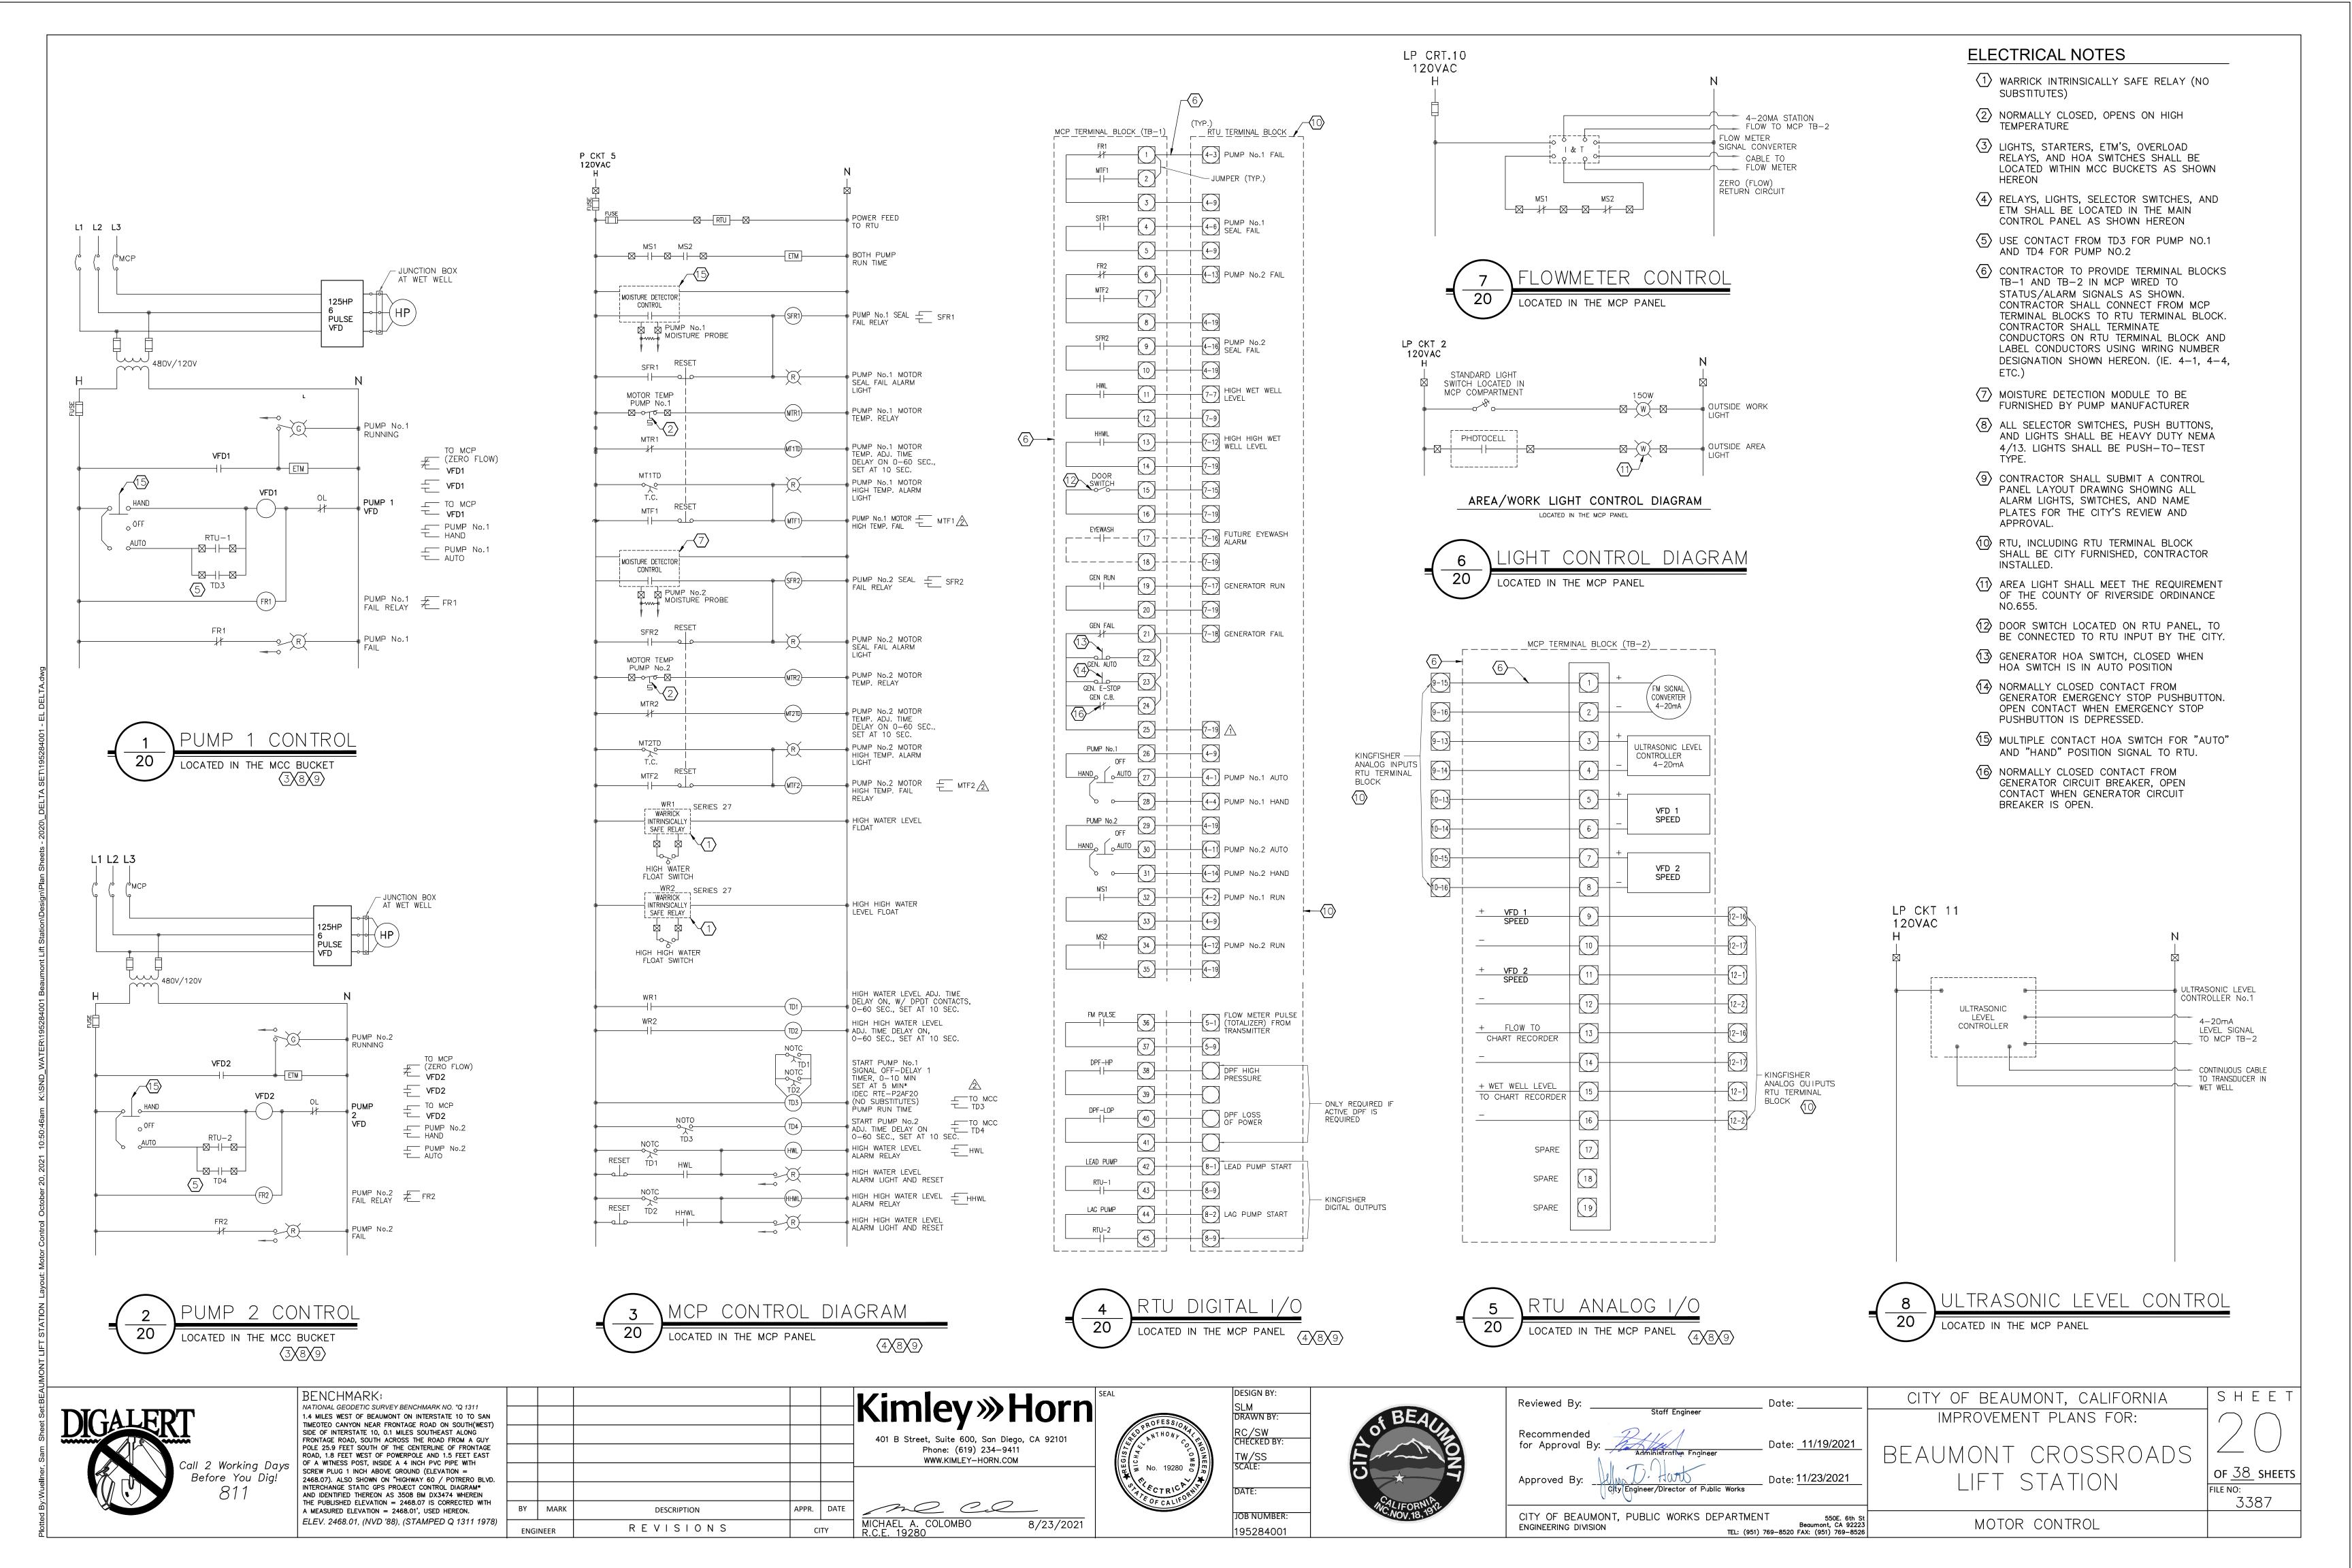

					CONDUIT SCHEDULE		
		CONDUIT	W	IRE	FROM	ТО	REMARKS
NO.	SIZE	TYPE	POWER	GROUND	THOW		KLIVIAKKS
E-UTIL-1	3"	SCHED 40 PVC UG			UTILITY METER	UTILITY TRANSFORMER	CONTRACTOR TO COORDINATE UTILITY TRANSFORMER LOCATION
E-UTIL-2	3"	SCHED 40 PVC UG			UTILITY METER	UTILITY TRANSFORMER	CONTRACTOR TO COORDINATE UTILITY TRANSFORMER LOCATION
E-01A	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	UTILITY METER	MCC MAIN BREKAER	PARALLEL SET TO ATS
E-01B	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	UTILITY METER	MCC MAIN BREKAER	PARALLEL SET TO ATS
E-02A	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	GENERATOR	ATS	PARALLEL SET TO ATS
E-02B	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	GENERATOR	ATS	PARALLEL SET TO ATS
E-03A		RUN IN WIREWAY	4-#3/0 AWG	1-#4 GND	MCC MAIN BREKAER	ATS	RUN IN WIREWAY
E-03B		RUN IN WIREWAY	4-#3/0 AWG	1-#4 GND	MCC MAIN BREKAER	ATS	RUN IN WIREWAY
E-04	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	MCC DISTRIBUTION BOARD	SITE ELECTRICAL PULL BOX	PUMP #1 POWER
E-05	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	MCC DISTRIBUTION BOARD	SITE ELECTRICAL PULL BOX	PUMP #2 POWER
E-06	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	SITE ELECTRICAL PULL BOX	PUMP #1 200A DISCONNECT	
E-07	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	SITE ELECTRICAL PULL BOX	PUMP #2 200A DISCONNECT	
E-08	-	-	-	-	-	-	NOT USED
E-09	-	-	-	-	-	-	NOT USED
E-10	1"	SCHED 40 PVC UG	2-#12 AWG	1-#12 GND	SITE ELECTRICAL PULL BOX	FLOW METER	FLOW METER POWER
E-11	1"	SCHED 40 PVC UG	2-#12 AWG	1-#12 GND	SITE ELECTRICAL PULL BOX	SITE LIGHT	SITE LIGHTING
	411		2-#10 AWG			0.77 7. 707 7. 7. 7. 7. 7. 7. 7. 7. 7. 7. 7. 7. 7.	FLOW METER POWER
E-12	1"	RGS AG/SCHED 40 PVC UG	2-#10 AWG	1-#10 GND	PANEL A	SITE ELECTRICAL PULL BOX	SITE LIGHTING
5.40	411	200 10/00/152 10 21/01/0	2-#10 AWG	4 #40 0115	5445	051150.1700	GENERATOR BATTERY CHARGER
E-13	1"	RGS AG/SCHED 40 PVC UG	2-#10 AWG	1-#10 GND	PANEL A	GENERATOR	GENERATOR BLOCK HEATER
E-14	2"	RGS AG/SCHED 40 PVC UG	_	-	MCC DISTRIBUTION BOARD	FUTURE LIFT STATION PULL BOX	SPARE FOR FUTURE USE
E-15	3"	PVC COATED RGS	MFR CABLE		NEMA 4X POWER JB	PUMP #1	PENETRATE WET WELL PER DETAIL 2, SHEET 16.
E-16	3"	PVC COATED RGS	MFR CABLE		NEMA 4X POWER JB	PUMP #2	PENETRATE WET WELL PER DETAIL 2, SHEET 16.
E-17	1"	SCHED 40 PVC UG	2-#12 AWG	1-#12 GND	PANEL A	ODOR CONTROL PAD GFI RECEPTACLE	,
C-00	1"	SCHED 40 PVC UG	4-PR #16 AWG		MCP	SITE COMMUNICATIONS PULL BOX	PUMP #1, PUMP #2 LEAK/OVERTEMP
C-01	1"	SCHED 40 PVC UG	4-PR #16 AWG		SITE COMMUNICATIONS PULL BOX	NEMA 4X FLOAT SWITCH JB	PUMP #1, PUMP #2 LEAK/OVERTEMP
C-02	1"	PVC COATED RGS	4-PR #16 AWG		NEMA 4X FLOAT SWITCH JB	NEMA 4X POWER JB	SPLICE MFTR PUMP POWER CABLE
C-03	1"	RGS AG/SCHED 40 PVC UG	MFR CABLE		MCP	SITE COMMUNICATIONS PULL BOX	FLOW METER 4-20Ma INSTANTANEOUS FLOW, TOTAL FLOW PULSE
C-04	1"	SCHED 40 PVC UG/ PVC COATED RGS	MFR CABLE		SITE COMMUNICATIONS PULL BOX	FLOW METER FM-100	FLOW METER 4-20Ma INSTANTANEOUS FLOW, TOTAL FLOW PULSE
C-05	1"	SCHED 40 PVC UG	MFR CABLE		MCP	SITE COMMUNICATIONS PULL BOX	US LEVEL SENSOR LE-100
C-06	1"	SCHED 40 PVC UG	MFR CABLE		SITE COMMUNICATIONS PULL BOX	NEMA 4X US SENSOR JB	US LEVEL SENSOR LE-100
C-07	1"	SCHED 40 PVC UG	8-PR #16 AWG		MCP	SITE COMMUNICATIONS PULL BOX	FLOAT SWITCHES LSLL, LSL, LSH, LSHH
C-08	1"	SCHED 40 PVC UG	8-PR #16 AWG		SITE COMMUNICATIONS PULL BOX	NEMA 4X FLOAT JB	FLOAT SWITCHES LSLL, LSL, LSH, LSHH
C-09	1"	SCHED 40 PVC UG	2-PR #16 AWG		ATS	GENERATOR	2-WIRE GENERATOR START/STOP SIGNAL
C-10	1"	SCHED 40 PVC UG	4-PR #16 AWG		MCP	GENERATOR	GENERATOR RUN, FAIL ALARMS, SPARES



PANEL: PANEL A PANEL BUS: 40 AMPS VOLTAGE: 120/240 MAIN: 40A BREAKER PHASE, WIRES: 1ø, 3W SCCR (AMPS): 10,000 SOURCE: T-1 DESCRIPTION VA CB CKT A B CKT CB VA DESCRIPTION
 240
 20/1
 1
 3.0
 2
 20/1
 120

 180
 20/1
 3
 13.2
 4
 20/1
 1400
 BUILDING INTERIOR LIGHTING FLOW METER RTU CABINET BUILDING EXTERIOR LIGHTING GENERATOR BATTERY CHARGER LIGHTING CONTROL CABINET 180 20/1 5 3.5 6 20/1 240
 180
 20/1
 5
 3.5
 6
 20/1
 240

 240
 20/1
 7
 7.0
 8
 20/1
 600

 720
 20/1
 9
 6.0
 10

 720
 20/1
 11
 6.0
 12

 720
 20/1
 13
 6.0
 14

 600
 20/1
 15
 5.0
 16

 20/1
 17
 0.0
 18

 19
 0.0
 20
 GENERATOR BLOCK HEATER SITE LIGHTING BUILDING RECEPTACLES
BUILDING RECEPTACLES SPACE SITE RECEPTACLES BIOXIDE/ODOR CONTROL PUMP SPARE 21 0.0 22 23 0.0 24 TOTALS 18.5 31.2 AMPS LOAD CALCULATIONS: SUBTOTAL (VA): 5960 +25% PER NEC (VA): 1490 TOTAL (VA): 7450 @ 240V, 1Ø = 31.1 AMPS



MANUFACTURER: SCHNEIDER EQUIPMENT LOCATION: ELECTRICAL ROOM FED FROM: UTILITY

VOLTS/PHASE/WIRE 480V/3 PHASE/4W MAIN BUS RATING: 400A MAIN BREAKER (AMPS): 400A AIC RATING (AMPS): 45,000


SECTION NO.	BREAKER SIZE	STARTER SIZE	FEEDER CABLE SIZE	EQUIPMENT NAME	KVA	HP	FLA	BREAKER TRIP RATING
1	150A	VFD		PUMP 1		105	125.0	
2	150A	VFD		PUMP 2		105	125.0	1
3				7.5KVA TRANSFORMER	6		7.2	
4				AC CU 1	15		18.0	
5				AC AIR HANDLER	2		2.4	
ELA FOR N	ON-MOTOR L	OAD (AMPS	3).				27.6	
	OTOR LOAD		e):				250.0	
	OF LARGEST						31.3	
TOTAL AME							308.9	
SERVICE S							400.0	
120 100 100 100		THAN 900/	OF CELECTED LO	AD SERVICE SIZE):			77%	







BENCHMARK:
NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST)
SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

Kimley» Horn Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM APPR. DATE BY MARK DESCRIPTION REVISIONS



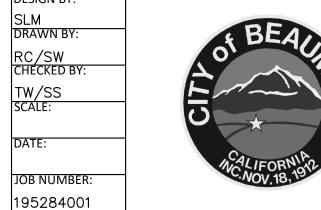

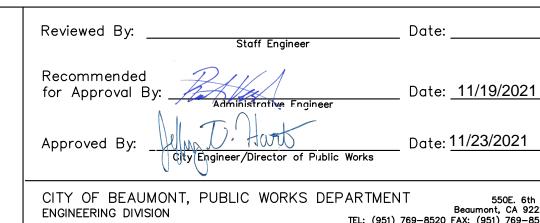

SHEET CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

of 38 sheets 3387

PARTMENT 550E. 6th St Beaumont, CA 92223 TEL: (951) 769–8520 FAX: (951) 769–8526 ELECTRICAL SCHEDULES

STRUCTURAL GENERAL NOTES

1.00 DESIGN LOADS

1.01 2019 CALIFORNIA BUILDING CODE (CBC), ASCE 7-16, ACI 318-14, AISC 360-16, TMS 402-16)

1.02 BUILDING RISK CATEGORY = II

1.03 DEFLECTION CRITERIA: SEE CBC TABLE 1604.3 AND PROJECT SPECIFICATIONS FOR VERTICAL DEFLECTION AND LATERAL DIRFT REQUIREMENTS.

1.04 LOADING INFORMATION

U 4	LOAL	JING INFOR	INIATION		
	Α.	DEAD:	SELF WEIGHT + 10 PSF (INCLUDING ROOFING ELEMENTS	+	MECHANICAL
	В.	LIVE:	ROOF	=	20 PSF
			SIDEWALKS	=	250 PSF
	C.	SNOW:	IMPORTANCE FACTOR, Is	=	1.0
			GROUND SNOW LOAD, PG	=	5 PSF
	D.	WIND:	IMPORTANCE FACTOR, IW	=	1.0
			WIND SPEED, V (SITE SPECIFIC):	=	97 MPH
			EXPOSURE CATEGORY	=	С
			INTERNAL PRESSURE COEFFICIENT, GCPI	=	±0.18
			COMPONENTS AND CLADDING:		
			ROOF	=	17.5 PSF, — PSF (UPLIF
	E.	SEISMIC:	IMPORTANCE FACTOR, I _E :	=	1.0
			MAPPED SHORT PERIOD SPECTRAL ACCELERATION, S _S	=	1.688 G
			MAPPED 1-S PERIOD SPECTRAL ACCELERATION, S1	=	0.659 G
			SITE CLASS	=	D

MAIN SEISMIC FORCE RESISTING SYSTEM CMU MCC BUILDING:

SITE COEFFICIENT, FA

SITE COEFFICIENT, FV

ACCELERATION, SDS

ACCELERATION, S_{D1}

SEISMIC DESIGN CATEGORY

SHORT PERIOD DESIGN SPECTRAL RESPONSE

1-S PERIOD DESIGN SPECTRAL RESPONSE

SPECIAL REINFORCED MASONRY SHEAR WALLS - EQUIVALENT

= 1.0

= 1.7

= D

= 1.351 G

= 0.747 G

LATERAL FORCE PROCEDURE	
BASE SHEAR IN N-S DIRECTION, V_{NS}	= 7.32 KIPS
BASE SHEAR IN E-W DIRECTION, VEW	= 7.08 KIPS
SEISMIC RESPONSE COEFFICIENT, Cs	= 0.27
RESPONSE MODIFICATION FACTOR, R	= 5
OVERSTRENGTH FACTOR, Ω_0	= 2.5
DEFLECTION AMPLIFICATION FACTOR, C_D	= 3.5
REDUNDANCY FACTOR, P	= 1.3

F. GEOTECHNICAL:

FOUNDATIONS. RETAINING AND BASEMENT WALLS. FOUNDATION DRAINAGE. SLABS ON GRADE AND OTHER ITEMS RELATED TO THE SOILS ARE DESIGNED AND SHALL BE IN ACCORDANCE TO WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT "FINAL GEOTECHNICAL REPORT ON THE OBSERVATION AND TESTING OF REMEDIAL AND ROUGH GRADING, HIDDEN CANYON INDUSTRIAL PARK, BEAUMONT, CALIFORNIA.". PREPARED BY KLING CONSULTING GROUP, INC. DATED OCTOBER 1, 2019 AND THE CITY OF BEAUMONT DESIGN CRITERIA, BASED ON THE 2019 CBC VALUES

ALLOWABLE SOIL DESIGN PARAMETERS:

BEARING PRESSURE:	=	2000 PSF
SOIL LATERAL BEARING CAPACITY;	=	100 PCF
SOIL SLIDING COEFFICIENT;	=	0.25

ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

2.00 DOCUMENTS AND LIMITATIONS

- 2.01 THESE STRUCTURAL DOCUMENTS, TOGETHER WITH THE CONCEPTS AND DESIGNS PRESENTED HEREIN, AS AN INSTRUMENT OF SERVICE, ARE INTENDED ONLY FOR THE SPECIFIC PURPOSE AND CLIENT FOR WHICH IT WAS PREPARED. REUSE OF, AND IMPROPER RELIANCE ON THIS DOCUMENT WITHOUT WRITTEN AUTHORIZATION AND ADAPTATION BY KIMLEY-HORN AND ASSOCIATES, INC. SHALL BE WITHOUT LIABILITY TO KIMLEY-HORN AND ASSOCIATES, INC.
- 2.02 IT IS UNDERSTOOD THAT THE STRUCTURAL ENGINEER OF RECORD MAKES NO WARRANTY, EITHER EXPRESSED OR IMPLIED, AS TO FINDINGS, DESIGNS, RECOMMENDATIONS, SPECIFICATIONS, OPINION, OR PROFESSIONAL ADVICE, EXCEPT THAT THESE INSTRUMENTS OF SERVICE HAVE BEEN PREPARED IN ACCORDANCE WITH CURRENT. GENERALLY ACCEPTED PROFESSIONAL ENGINEER PRACTICES.

2.03 ALL NON-STRUCTURAL ELEMENTS INDICATED ON THE STRUCTURAL DRAWINGS HAVE BEEN SHOWN IN GENERAL TO THEIR RELATIONSHIPS TO STRUCTURAL ELEMENTS. THEY SHALL NOT BE ASSUMED TO BE ACCURATE AND REFERENCE MUST BE MADE TO THE APPROPRIATE CONSULTANT(S) AND SPECIFICATIONS.

3.00 CONSTRUCTION SAFETY

- 3.01 IT IS UNDERSTOOD THAT THE CONTRACTOR IS SOLELY RESPONSIBLE FOR INITIATING, MAINTAINING, AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK ON THE PROJECT. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS FOR THE SAFETY OF ALL PERSONS AND PROTECT THEM FROM INJURY. LIKEWISE, THE CONTRACTOR SHALL PROTECT ALL PROPERTY AGAINST DAMAGE AND LOSS.
- 3.02 THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE LAWS. ORDINANCES, RULES, REGULATIONS, AND ORDERS OF ANY PUBLIC BODY HAVING JURISDICTION FOR THE SAFETY OF PERSONS OR PROPERTY.
- 3.03 THE CONTRACTOR'S DUTIES AND RESPONSIBILITIES FOR THE SAFETY AND PROTECTION OF THE WORK SHALL CONTINUE UNTIL SUCH TIME AS THE WORK IS SATISFACTORILY COMPLETED, AND THE ENGINEER HAS ISSUED A NOTICE TO THAT EFFECT TO THE OWNER AND THE CONTRACTOR.

4.00 FORMWORK AND SHORING

- 4.01 THE CONTRACTOR SHALL EMPLOY AT HIS EXPENSE, A FORMWORK/SHORING ENGINEER REGISTERED IN CALIFORNIA TO CONTROL ALL OPERATIONS RELATING TO DESIGN. INSTALLATION AND REMOVAL OF ALL FORMWORK AND SHORING.
- 4.02 CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR FABRICATION, ERECTION, SUPPORT, AND BRACING OF FORMWORK AND SHORING PROCEDURES FOR THE ENGINEER'S RECORDS.
- 4.03 PRIOR TO THE PLACEMENT OF CONCRETE, THE FORMWORK/SHORING ENGINEER NEEDS TO INSPECT THE SHORING AFTER THE FIRST POUR (AND AGAIN IF THERE IS ANY CHANGE IN THE METHOD OF SHORING), TO VERIFY THAT THE SHORING INSTALLATION IS IN CONFORMANCE WITH THE SHORING SHOP DRAWINGS. A WRITTEN STATEMENT OF COMPLIANCE SIGNED BY THE SHORING ENGINEER SHALL BE SUBMITTED TO THE OWNER.

5.00 DIMENSIONS

- 5.01 BEFORE STARTING WORK. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS ON THE SITE. AND REPORT ANY DISCREPANCIES IMMEDIATELY TO THE ENGINEER
- 5.02 THE CONTRACTOR, BEFORE STARTING ANY WORK, SHALL CHECK ALL DIMENSIONS GIVEN ON THE STRUCTURAL DRAWINGS, RELATING TO GRID LINES, COLUMN AND WALL LOCATIONS, STRUCTURAL AND FINISHED FLOOR ELEVATIONS, MEMBER SIZES, ETC., WITH THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND CIVIL DRAWINGS. IF ANY DISCREPANCY IS NOTICED, IT SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE ENGINEER, AND WORK SHALL NOT COMMENCE UNTIL INSTRUCTIONS ARE RECEIVED FROM THE ENGINEER.
- 5.03 THE CONTRACTOR SHALL REFER TO THE ENGINEER FOR HIS INSTRUCTIONS FOR ANY DIMENSION NOT GIVEN ON OR OBTAINABLE FROM THE DRAWINGS. THE CONTRACTOR SHALL NOT USE SCALE TO OBTAIN OR VERIFY ANY DIMENSION SHOWN ON THESE DRAWINGS.

6.00 SHOP DRAWINGS

- 6.01 REVIEW OF SHOP DRAWINGS BY THE ENGINEER IS LIMITED TO COMPLIANCE OF THE COMPLETED STRUCTURE WITH THE DESIGN CONCEPT AND INFORMATION GIVEN IN THE CONTRACT DOCUMENTS. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR DIMENSIONS, QUANTITIES, PERFORMANCE, SAFETY, COORDINATION WITH OTHER WORKS, AND ALL OTHER REQUIREMENTS OF THE CONTRACT DOCUMENTS. REVIEW DOES NOT AUTHORIZE CHANGES TO THE CONTRACT.
- 6.02 THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO THE ENGINEER FOR HIS REVIEW IN ACCORDANCE WITH A SCHEDULE OF SUBMITTALS ACCEPTABLE TO THE ENGINEER. THESE SHOP DRAWINGS SHALL HAVE BEEN CHECKED BY, AND STAMPED WITH THE APPROVAL OF. THE CONTRACTOR AND IDENTIFIED AS THE ENGINEER MAY REQUIRE. THE DATA SHOWN ON THE SHOP DRAWINGS SHALL BE COMPLETE WITH RESPECT TO DIMENSIONS, DESIGN CRITERIA, AND DULY SIGNED AND SEALED BY A PROFESSIONAL ENGINEER (WHERE APPLICABLE).

7.00 MASONRY

- 7.01 THE CONTRACTOR SHALL REFER TO FINISHES AND DOORS & ROOF DRAWINGS FOR ADDITIONAL DETAILS RELATING TO MASONRY WORK, CONTRACTOR SHALL FURTHER CHECK ANY DETAILS SHOWN ON STRUCTURAL DRAWINGS WITH THE FINISHES AND DOORS & ROOF DRAWINGS AND NOTIFY ENGINEER AND ARCHITECT OF ANY NOTED DISCREPANCIES
- 7.02 CONCRETE MASONRY UNITS (CMU) SHALL BE ERECTED AS LOAD BEARING CONCRETE MASONRY. COMPLY WITH ACI 530.1 "SPECIFICATION FOR MASONRY STRUCTURES" FOR MATERIALS, METHODS, AND WORKMANSHIP AND ERECTION TOLERANCES.
- 7.03 PROVIDE CONCRETE MASONRY UNIT ASSEMBLIES (CMUS) AS INDICATED ON THE DRAWINGS THAT AS FOLLOWS:
 - A. CMUS SHALL CONFORM TO ASTM C90 WITH A MINIMUM AVERAGE NET-AREA
 - B. WEIGHT CLASSIFICATION: MEDIUM WEIGHT, UNLESS OTHERWISE NOTED

COMPRESSIVE STRENGTH OF 1900 PSI.

CHLORIDE IN MORTAR OR GROUT.

- C. SIZE: MANUFACTURED TO DIMENSIONS 3/8" LESS THAN NOMINAL DIMENSIONS
- 7.04 PROVIDE MORTAR AND GROUT MATERIALS AS INDICATED ON THE DRAWINGS AND CONFORMING TO THE REQUIREMENTS LISTED BELOW. ALL CELLS CONTAINING REINFORCEMENT, CELLS BELOW GRADE, AND ANY LOCATIONS NOTED ON THE DRAWINGS SHALL BE GROUTED SOLID. DO NOT USE ADMIXTURES, INCLUDING AIR-ENTRAINING AGENTS, ACCELERATORS, RETARDERS, WATER-REPELLENT AGENT, ANTIFREEZE COMPOUNDS, OR OTHER ADMIXTURES UNLESS OTHERWISE NOTED. DO NOT USE CALCIUM
 - MORTAR FOR MASONRY ASSEMBLIES SHALL BE TYPE S, PCL MORTAR, CONFORMING TO ASTM C270.
 - GROUT FOR UNIT MASONRY SHALL BE FINE GROUT CONFORMING TO ASTM C476 AND HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH (FM) OF 2000 PSI. GROUT SHALL HAVE A SLUMP OF 8 TO 11 INCHES AS MEASURED ACCORDING TO ASTM C143. COMPLY WITH TABLE 1.15.1 IN ACI 530.1 FOR DIMENSIONS OF GROUT SPACES AND POUR HEIGHT.
- 7.05 LAY HOLLOW CONCRETE MASONRY UNITS IN A BOND PATTERN COMPLYING WITH THE ARCHITECTURAL DRAWINGS AND AS FOLLOWS:

- A. WITH FACE SHELLS FULLY BEDDED IN MORTAR AND WITH HEAD JOINTS OF DEPTH EQUAL TO BED JOINTS.
- B. WITH WEBS FULLY BEDDED IN MORTAR IN ALL COURSES OF PIERS, COLUMNS, AND PILASTERS.
- C. WITH WEBS FULLY BEDDED IN MORTAR IN GROUTED MASONRY. INCLUDING STARTING COURSE ON FOOTINGS.
- D. WITH ENTIRE UNITS, INCLUDING AREAS UNDER CELLS, FULLY BEDDED IN MORTAR AT STARTING COURSE ON FOOTINGS WHERE CELLS ARE NOT GROUTED.
- 7.06 PROVIDE VERTICAL REINFORCING AS NOTED PER THE CMU WALL REINFORCING SCHEDULE AND PER THE REQUIREMENTS BELOW. PROVIDE MATCHING DOWELS INTO THE FOOTING OR FOUNDATION CONSTRUCTION. PROVIDE TWO ADDITIONAL BARS AND DOWELS UNDER POINT LOADS, LINTELS AND BEAMS WHICH HAVE A REACTION EXCEEDING 10 KIPS, WHETHER OR NOT NOTED ON THE FRAMING PLANS.
 - A. ALL REBAR SHALL BE UNCOATED STEEL REINFORCING BARS: ASTM ASTM A615. GRADE 60
 - B. REINFORCING STEEL SHALL BE PLACED IN COMPLIANCE WITH ACI 530.1.
 - C. GROUT ALL CELLS CONTAINING REINFORCEMENT AND DO NOT PLACE GROUT UNTIL THE ENTIRE HEIGHT OF MASONRY TO BE GROUTED HAS ATTAINED ENOUGH STRENGTH TO RESIST GROUT PRESSURE. LIMIT HEIGHT OF VERTICAL GROUT POURS TO NOT MORE THAN 60".
 - D. PROVIDE AN OPEN BOTTOM BOND BEAM REINFORCED WITH (1) NO. 5 CONTINUOUS BARS AT THE FOLLOWING LOCATIONS AND AS NOTED ON THE DRAWINGS.
 - i. AT THE TOP OF ALL WALL ELEVATIONS.
 - ii. AT ALL JOIST AND FRAMING BEARING ELEVATIONS
 - iii. EQUALLY SPACED BETWEEN LATERAL SUPPORTS OR AT 10'-0" O.C. MAXIMUM VERTICALLY, IF THE DISTANCE BETWEEN LATERAL SUPPORTS EXCEEDS 10'-0"
- 7.07 PROVIDE MASONRY JOINT REINFORCING AT 16" O.C. VERTICALLY, IN ADDITION TO CONTINUOUS REINFORCEMENT, AND NOT MORE THAN 8" ABOVE AND BELOW OPENINGS IN MASONRY WALLS AND EXTENDING 12" BEYOND SAID OPENING. INTERRUPT JOINT REINFORCEMENT AT CONTROL AND EXPANSION JOINTS, UNLESS OTHERWISE INDICATED. CUT AND BEND REINFORCING UNITS AS DIRECTED BY MANUFACTURER FOR CONTINUITY AT CORNERS, RETURNS, OFFSETS, COLUMN FIREPROOFING, PIPE ENCLOSURES, AND OTHER SPECIAL CONDITIONS. JOINT REINFORCING SHALL CONSIST OF HOT-DIPPED GALVANIZED, CARBON STEEL CONFORMING TO ASTM A951 AND PER THE REQUIREMENTS BELOW:
 - A. JOINT REINFORCEMENT FOR SINGLE WYTHE WALLS SHALL CONSIST OF EITHER LADDER OR TRUSS TYPE WITH A SINGLE PAIR OF SIDE RODS. SIDE AND CROSS RODS SHALL BE W1.7" DIAMETER.
- 7.08 PROVIDE MASONRY LINTELS AS NOTED ON THE PLANS.
- 7.09 DURING CONSTRUCTION, COVER TOPS OF WALLS, PROJECTIONS, AND SILLS WITH WATERPROOF SHEETING AT END OF EACH DAY'S WORK. COVER PARTIALLY COMPLETED MASONRY WHEN CONSTRUCTION IS NOT IN PROGRESS.
- 7.10 DO NOT APPLY UNIFORM FLOOR OR ROOF LOADS FOR AT LEAST 12 HOURS AND CONCENTRATED LOADS FOR AT LEAST 3 DAYS AFTER BUILDING MASONRY WALLS OR COLUMNS.
- 7.11 DO NOT USE FROZEN MATERIALS OR MATERIALS MIXED OR COATED WITH ICE OR FROST. DO NOT BUILD ON FROZEN SUBSTRATES. REMOVE AND REPLACE UNIT MASONRY DAMAGED BY FROST OR BY FREEZING CONDITIONS. COMPLY WITH COLD-WEATHER CONSTRUCTION REQUIREMENTS CONTAINED IN ACI 530.1.
- 7.12 COMPLY WITH HOT-WEATHER CONSTRUCTION REQUIREMENTS CONTAINED IN ACI 530.1.
- 7.13 ALL REINFORCEMENT SHALL BE DETAILED PER TMS 402

8.00 STRUCTURAL STEEL

- 8.01 DESIGN, FABRICATION, AND ERECTION SHALL BE IN ACCORDANCE WITH AISC 360 "SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS".
- 8.02 WIDE FLANGE MEMBERS SHALL CONFORM TO ASTM A992, GRADE 50.
- 8.03 ALL C CHANNELS, L ANGLES, STRUCTURAL PLATES AND BARS SHALL CONFORM TO ASTM A36, GRADE 36.
- 8.04 ANCHOR BOLTS SHALL CONFORM TO ASTM F1554 GRADE 55. THE UPPER 1'-0" AND LOWER 6"SHALL BE THREADED. THE ENTIRE LENGTH OF BOLT SHALL BE GALVANIZED IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM A153.
- 8.05 ALL WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS AND SHALL BE IN ACCORDANCE WITH AMERICAN WELDING SOCIETY (AWS) D1.1 STRUCTURAL WELDING CODE. RETURN ALL WELDS AT CORNERS A MINIMUM OF TWICE THE NORMAL SIZE OF THE WELD.
- 8.06 WELDING ELECTRODES SHALL BE E70XX UNLESS OTHERWISE NOTED.
- 8.07 NUTS SHALL BE HEAVY HEX NUTS CONFORMING TO ASTM A563.

8.08 WASHERS SHALL CONFORM TO ASTM F436.

- 8.09 ALL STEEL AND HARDWARE SHALL BE HOT-DIP GALVANIZED UNLESS OTHERWISE NOTED.
- 8.10 ALL CONNECTIONS NOT DETAILED ON THE DRAWINGS SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF CALIFORNIA AND SHOP DRAWINGS SUBMITTED FOR REVIEW.
- 8.11 THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR ALL STRUCTURAL STEEL WORK, SHOWN IN CONTRACT DRAWINGS, TO THE ENGINEER FOR THEIR REVIEW.
- 8.12 OMIT PAINT ON CONTACT SURFACES WHERE BOLTS AND WELDS ARE USED TOGETHER IN A CONNECTION. BOLTS TO BE BEARING TYPE
- 8.13 BOLTED CONNECTIONS SHALL BE MADE WITH 3/4" DIA A-325 BOLTS WITH THREADS INCLUDED IN THE SHEAR PLANE, UON. INSTALL BOLTS IN PROPERLY ALIGNED HOLES AND TIGHTEN USING ONE OF THE FOLLOWING METHODS: SNUG-TIGHT CONDITION, TURN-OF-THE-NUT METHOD, A DIRECT TENSION INDICATOR, OR CALIBRATED WRENCH AS DEFINED BY THE AISC "SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A-325 OR A490 BOLTS, 2014 EDITION"

- 8.14 THE BOLT SUPPLIER SHALL USE PAINT TO COLOR AND IDENTIFY UNIQUE BOLT SIZES AND GRADES. A MATCHING PAINT STRIPE SHALL BE MADE NEAR THE END OF EACH MEMBER THAT IS TO ACCEPT A UNIQUE BOLT SIZE OR GRADE.
- 8.15 HEADED-STUD TYPE CONNECTORS SHALL BE ASTM A-108, GRADES 1010 THRU 1020. COLD FINISHED CARBON STEEL; AWS D1.1, TYPE B.
- 8.16 ALL COPES, BLOCKS AND CUTS IN STRUCTURAL MEMBERS SHALL BE MADE FREE OF NOTCHES, OR OTHER AREAS THAT COULD CREATE STRESS CONCENTRATIONS. THE MINIMUM RADIUS AT CORNERS SHALL BE 1/2".
- 8.17 ALL FIELD SPLICES OF CONTINUOUS BEAMS AND COLUMNS SHALL BE COMPLETE JOINT PENETRATION WELDS, NO BOTTLED FIELD SPLICES WILL BE PERMITTED.
- 8.18 FABRICATOR SHALL PROVIDE A FIELD-WELD SCHEDULE SUMMARIZING MINIMUM PREHEAT, THE WELD FILLER MATERIAL, THE PROPER WELD DEPOSITION RATE AND WELDING MACHINE SETTINGS FOR EACH WELD THAT WILL BE UTILIZED IN THE FIELD.

9.00 POST-INSTALLED ANCHORS

9.01 UNLESS NOTED OTHERWISE INDICATED ON PLANS, POST-INSTALLED ANCHORS SHALL CONSIST OF THE FOLLOWING ANCHOR TYPES, OR APPROVED EQUAL:


ADHESIVE ANCHOR	MECHANICAL ANCHOR				
SOLID CONCRETE					
HILTI RE 500 SD	HILTI KWIK HUS EZ				
HILTI HY 200 SAFE SET SYSTEM	HILTI KWIK BOLT TZ				
GROUTED MASONRY					
HILTI HY 270	HILTI KWIK BOLT 3				

- 9.02 SUBSTITUTION REQUESTS FOR ALTERNATE PRODUCTS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD PRIOR TO USE. CONTRACTOR SHALL PROVIDE CALCULATIONS DEMONSTRATING THAT THE SUBSTITUTED PRODUCT IS CAPABLE OF ACHIEVING THE PERFORMANCE VALUES OF THE SPECIFIED PRODUCT. SUBSTITUTIONS WILL BE EVALUATED BY THEIR HAVING AN ICC ESR SHOWING COMPLIANCE WITH THE RELEVANT BUILDING
- 9.03 INSTALL ANCHORS PER THE MANUFACTURER INSTRUCTIONS, AS INCLUDED IN THE ANCHOR PACKAGING.
- 9.04 THE CONTRACTOR SHALL ARRANGE AN ANCHOR MANUFACTURER'S REPRESENTATIVE TO PROVIDE ONSITE INSTALLATION TRAINING FOR ALL OF THEIR ANCHORING PRODUCTS SPECIFIED. THE ENGINEER OF RECORD MUST RECEIVE DOCUMENTED CONFIRMATION THAT ALL OF THE CONTRACTOR'S PERSONNEL WHO INSTALL ANCHORS ARE TRAINED PRIOR TO THE COMMENCEMENT OF INSTALLING ANCHORS.
- 9.05 ANCHOR CAPACITY IS DEPENDANT UPON SPACING BETWEEN ADJACENT ANCHORS AND PROXIMITY OF ANCHORS TO EDGE OF CONCRETE. INSTALL ANCHORS IN ACCORDANCE WITH SPACING AND EDGE CLEARANCES INDICATED ON THE DRAWINGS.
- 9.06 EXISTING REINFORCING BARS IN THE CONCRETE STRUCTURE MAY CONFLICT WITH SPECIFIC ANCHOR LOCATIONS. UNLESS NOTED ON THE DRAWINGS THAT THE BARS CAN BE CUT, THE CONTRACTOR SHALL REVIEW THE EXISTING STRUCTURAL DRAWINGS AND SHALL UNDERTAKE TO LOCATE THE POSITION OF THE REINFORCING BARS AT THE LOCATIONS OF THE CONCRETE ANCHORS.


Call 2 Working Days Before You Dig!

|BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE Phone: (619) 234-9411 ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST WWW.KIMLEY-HORN.COM OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN HE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH DATE BY MARK A MEASURED ELEVATION = 2468.01', USED HEREON. DESCRIPTION

REVISIONS



8/23/2021







Reviewed By: Date: Recommended Date: <u>11/19/2021</u> for Approval By: Administrative Engineer Date: 11/23/2021 City Engineer/Director of Public Works

TEL: (951) 769-8520 FAX: (951) 769-8526

CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT

ENGINEERING DIVISION

IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

GENERAL STRUCTURAL NOTES I

CITY OF BEAUMONT, CALIFORNIA

SHEET

of <u>38</u> sheets

3387

STRUCTURAL GENERAL NOTES

10.00 REINFORCED CONCRETE (CAST-IN-PLACE)

- 10.01 THE GENERAL CONTRACTOR SHALL ASSIST AND COOPERATE WITH AN INDEPENDENT TESTING LABORATORY (TO BE RETAINED BY THE OWNER) WHICH SHALL CONDUCT ALL OF THE SPECIFIED TESTS REQUIRED FOR THE CONCRETE WORK AND REPORT THE RESULTS OF THESE TESTS DIRECTLY AND PROMPTLY TO THE ENGINEER FOR HIS REVIEW.
- 10.02 DETAILING OF REBAR SHALL BE IN ACCORDANCE WITH THE LATEST REVISION OF THE ACI DETAILING MANUAL, AND CONCRETE REINFORCING INSTITUTE'S LATEST EDITION OF "MANUAL OF STANDARD PRACTICE". ALL SHOP DRAWINGS PERTAINING TO REBAR DETAILS SHALL BE SUBMITTED TO THE ENGINEER FOR HIS REVIEW.
- 10.03 CONCRETE MIX DESIGN FOR ALL CONCRETE WORK IS REQUIRED TO BE SUBMITTED TO THE ENGINEER FOR HIS REVIEW. IT IS TO BE NOTED THAT THE CONCRETE SUPPLIER SHALL HAVE A QUALITY CONTROL PROCEDURE FOR THE PRODUCTION OF ALL CONCRETE. WHICH MUST BE ACCEPTABLE TO THE ENGINEER AND MEETS CURRENT ACI STANDARDS.
- 10.04 CONSTRUCTION JOINTS SHALL BE AS APPROVED BY THE ENGINEER. ENGINEER SHALL BE INFORMED AT LEAST 48 HOURS PRIOR TO THE COMMENCEMENT OF ANY CONCRETE WORK.
- 10.05 COPY OF ACI 301 "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" AND ACI SP 15 "FIELD REFERENCE MANUAL" SHALL BE KEPT IN THE PROJECT FIELD OFFICE AT ALL TIMES.
- 10.06 CONCRETE COMPRESSIVE DESIGN STRENGTH IN 28 DAYS: CONCRETE EXPOSURE CLASS F1 FOR SPREAD FOOTINGS, WALL FOOTINGS, AND SLAB-ON-GRADE, SEE ACI 318-14 TABLE 19.3.1.1 AND TABLE 19.3.2.1.

SPREAD FOOTINGS: 4,000 PSI MAX	W/C RATIO:	0.45
WALL FOOTINGS: 4,000 PSI		0.45
SLAB-ON-GRADE: 4,000 PSI		0.45

- 10.07 CLEAR DISTANCE FROM FACE OF CONCRETE TO MAIN STEEL SHALL BE AS SHOWN ON THE STRUCTURAL DRAWINGS. WHERE CLEAR DISTANCE IS NOT SHOWN, ACI 301 SHALL
- 10.08 PROVIDE 3/4 INCH CHAMFERS AT ALL EXPOSED EDGES UNO.
- 10.09 EMBEDDED ITEMS THAT WILL SUPPORT STRUCTURAL STEEL CONSTRUCTION SHALL BE PLACED WITHIN THE TOLERANCES PRESCRIBED IN THE LATEST EDITION OF THE AISC "CODE OF STANDARD PRACTICE". GENERAL CONTRACTOR SHALL FIELD VERIFY LOCATION OF EMBEDDED ITEMS PRIOR TO FABRICATION AND DELIVERY OF STRUCTURAL STEEL TO THE PROJECT SITE.
- 10.10 BAR SUPPORTS, DESIGN, DETAILING, FABRICATION, AND PLACING OF REINFORCING BARS SHALL BE IN ACCORDANCE WITH ACI 318-14 (BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE) AND THE LATEST EDITION OF THE ACI DETAILING MANUAL.
- 10.11 WHERE SHOWN OR SPECIFIED ON PLANS, PROVIDE STANDARD ACI 90-DEGREE OR 180-DEGREE HOOK, AS APPLICABLE.
- 10.12 REINFORCING: ASTM A615, GRADE 60, FOR SLABS, RETAINING / STAIR WALLS, AND FOUNDATIONS IS ACCEPTABLE. ALL REINFORCING TO BE A706 GRADE WHERE WELDING IS REQUIRED.
- 10.13 BAR DETAILS AND SUPPORTS: ACI DETAILING MANUAL AND BUILDING CODE. LAP ALL SPLICES AS SHOWN ON THE STRUCTURAL DRAWINGS.
- 10.14 CLEAR DISTANCE FROM FACE OF CONCRETE TO REINFORCING STEEL SHALL BE AS SHOWN ON THE STRUCTURAL DRAWINGS. WHERE CLEAR DISTANCE IS NOT ILLUSTRATED, ACI 301 REQUIREMENTS SHALL CONTROL
- 10.15 ALL REINFORCEMENT SHOWN IS INTENDED TO BE CONTINUOUS UNLESS NOTED OTHERWISE. LAP SPLICES SHALL BE 40 BAR DIAMETERS FOR #5 AND SMALLER, 48 BAR DIAMETERS FOR #6 AND LARGER.
- 10.16 CORE DRILLING SHALL NOT BE ALLOWED THROUGH IN-PLACE CONCRETE ELEMENTS UNLESS SPECIFICALLY APPROVED BY THE ENGINEER. PENETRATIONS THROUGH CONCRETE ELEMENTS SHALL BE ILLUSTRATED ON SHOP DRAWINGS AND SHALL UTILIZE SCHEDULE 40 STEEL PIPE. CLEARANCE REQUIRED WITHIN PIPE SLEEVE SHALL BE CONFIRMED BY SUBCONTRACTOR RESPONSIBLE FOR THE MATERIAL PASSING THROUGH THE SLEEVE. REINFORCEMENT CLEAR COVER SHALL BE MAINTAINED AROUND THE SLEEVE PENETRATION.
- 10.17 FOLLOWING FOUNDATION PLACEMENT AND PRIOR TO STEEL ERECTION, THE CONCRETE CONTRACTOR SHALL PROVIDE THE STEEL ERECTOR WITH WRITTEN DOCUMENTATION STATING THAT COLUMN FOUNDATION ELEMENTS HAVE REACHED A MINIMUM OF 75% OF DESIGN COMPRESSIVE STRENGTH AND THAT ALL ANCHOR BOLT PLACEMENT IS IN CONFORMANCE WITH CONTRACT DOCUMENTS OR THAT REPAIRS WERE COMPLETED PER EOR DIRECTION. REFER TO 1926 OSHA REGULATIONS SUBPART R FOR ADDITIONAL DETAILS.

11.00 ELEVATED METAL DECK

- 11.01 ALL NOTES APPLY TO NONCOMPOSITE AND COMPOSITE METAL FLOOR DECKING WITH CONCRETE TOPPING AND UNTOPPED ROOF DECKING, UNLESS NOTED OTHERWISE.
- 11.02 REFER TO CONTRACT DRAWINGS FOR CONNECTION DETAILS AND DEFINITION OF PERIMETER AND CORNER AREAS.
- 11.03 METAL DECK SHALL BE PROVIDED IN LONGEST LENGTHS POSSIBLE, PROVIDED A MINIMUM OF 3-SPAN CONDITIONS IN ALL LOCATIONS.
- 11.04 STEEL DECK SHALL CONFORM TO ASTM A653 AND SDI DESIGN MANUAL FOR COMPOSITE DECKS, FORM DECKS AND ROOF DECKS. STEEL DECK SHALL BE RECOGNIZED UNDER THE LATEST VERSION OF ICC-ES AC43 ACCEPTANCE CRITERIA FOR STEEL DECK, ROOF AND FLOOR SYSTEMS.
- 11.05 SHOP DRAWINGS INDICATING STEEL DECK LAYOUT, FASTENING METHOD AND PATTERN SHALL BE SUBMITTED TO THE ENGINEER OF RECORD PRIOR TO STEEL DECK INSTALLATION.
- 11.06 CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO ENSURE STEEL DECK IS NOT DAMAGED PRIOR TO INSTALLATION DURING STORAGE, HANDLING AND ERECTION. DAMAGED STEEL DECK SHALL BE REPLACED.
- 11.07 STEEL DECK SHALL BE STORED OFF THE GROUND WITH ONE END ELEVATED TO PROVIDE DRAINAGE AND SHOULD BE PROTECTED FROM THE ELEMENTS WITH A WATERPROOF COVERING VENTILATED TO PREVENT CONDENSATION.

- 11.08 STEEL DECK PANELS SHALL BE PLACED STRAIGHT AND TRUE WITH A MAXIMUM 1/4-INCH HORIZONTAL MISALIGNMENT IN 100 FEET LENGTH. STEEL DECK SHALL BE MARKED OVER JOIST CHORDS PRIOR TO FASTENING TO PREVENT WELD BURN THROUGH OR MECHANICAL FASTENER PUNCH THROUGH.
- 11.09 ENDLAPS OF STEEL DECK SHALL OVERLAP ADJACENT SHEETS A MINIMUM OF 2 INCHES UNLESS NOTED OTHERWISE.
- 11.10 FRAMING AROUND TYPICAL OPENINGS SHALL BE IN ACCORDANCE WITH STANDARD PRACTICE DETAILS PROVIDED IN SDI "MANUAL OF CONSTRUCTION WITH STEEL DECK."
- 11.11 NO MECHANICAL, ELECTRICAL, PLUMBING, ARCHITECTURAL OR MISCELLANEOUS ELEMENTS SHALL BE SUPPORTED FROM THE UNDERSIDE OF THE METAL DECK.
- 11.12 REFER TO ARCHITECTURAL AND MECHANICAL DRAWINGS FOR SIZE AND LOCATION OF ALL ROOF OPENINGS, ROOF DRAIN DETAILS, SKYLIGHT AND ROOF HATCH DETAILS.
- 11.13 MECHANICAL FASTENERS:
 - A. INSTALL POWDER-ACTUATED FASTENERS ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS.
 - POWDER-ACTUATED FASTENERS SHALL BE MANUFACTURED FROM AISI 1070 MODIFIED STEEL, AUSTEMPERED TO A ROCKWELL C HARDNESS OF 52-58. FASTENERS SHALL HAVE MINIMUM TENSILE AND SHEAR STRENGTHS OF 285 KSI AND 182 KSI RESPECTIVELY.
 - C. POWDER-ACTUATED FASTENERS SHALL HAVE BALLISTIC POINTS AND KNURLED SHANKS AND MINIMUM 12-MILLIMETER DIAMETER STEEL WASHERS.

ABBREVIATIONS AND DEFINITIONS:

A AR	EA	
ACI AM	IERICAN CONCRETE INSTITUTE	
AISC AM	IERICAN INSTITUTE OF STEEL CO	ONSTRUCTION
AISI AM	IERICAN IRON AND STEEL INSTI	TUTE

AMERICAN SOCIETY FOR TESTING AND MATERIALS ASTM AWS AMERICAN WELDING SOCIETY BOTTOM OF WALL

CENTERLINE CALIFORNIA BUILDING CODE CHAPTER CIP CAST-IN-PLACE CL CENTERLINE

CLR CLEAR CONCRETE CONC CONT CONTINUOUS CY CUBIC YARD DIA DIAMETER DTL DETAIL EΑ EACH EF EACH FACE EXISTING GROUND

EL, ELEV ELEVATION EACH WAY EXISTING ΕX FINISHED GROUND FΤ FEET, FOOT HEIGHT, HIGH

INCHES KH, KHA KIMLEY-HORN AND ASSOCIATES, INC.

KIPS PER SQUARE INCH LENGTH, LONG LINEAR FEET LT LEFT MAXMAXIMUM MIN

MINIMUM NO NUMBER NOT TO SCALE OC ON CENTER

OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION PORTLAND CEMENT CONCRETE

PΕ PROFESSIONAL ENGINEER PL PLATE PROP PROPOSED

REINF REINFORCEMENT RT

SDI STEEL DECK INSTITUTE SE STRUCTURAL ENGINEER SEC SECTION

STANDARD

SQUARE FEET SPECIAL INSPECTION/INSPECTOR SQUARE, SQUARED

POUNDS PER SQUARE FOOT

THICK TW TOP OF WALL TYP TYPICAL T&B TOP AND BOTTOM UON UNLESS OTHERWISE NOTED

WATER TO CEMENT DIAMETER FEET **INCHES**

STD

STEEL SPECIAL	INSPECT	ION TA	BLE	
TYPE	CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION	REFERENCE	QUALIF.
1. REVIEW SHOP FABRICATION AND QUALITY CONTROL PROCEDURES.	Х	-	IBC 1704.2.5.1	AWS/AISC -SSI ICC-SWSI
PRE-WEL	D INSPECTION			
2. VERIFY WELDER QUALIFICATION RECORDS, WELDER CONTINUITY RECORDS, AND MATERIAL IDENTIFICATION (TYPE/GRADE).	_	Х	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
3. VERIFY AVAILABILITY OF WELDING PROCEDURE SPECIFICATION & MATERIAL CERTIFICATIONS OF WELDING CONSUMABLES.	X	-	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
4. INSPECT FIT-UP GROOVE WELDS, CJP GROOVE WELDS OF HSS T-, Y-, AND K-JOINTS WITHOUT BACKING, AND FILLET WELDS. INSPECT CONFIGURATION OF AND FINISH OF ACCESS HOLES.	_	X	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
DURING WELI	DING INSPECTI	ON		
5. INSPECT PRE—HEAT, POST—HEAT, SURFACE PREPARATION. VERIFY PROPER ELECTRODE USE, CHARPY V—NOTCH TEST WELDS WHERE REQUIRED.	-	х	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
6. VERIFY WELDING PROCEDURE SPECIFICATIONS (WPS) ARE FOLLOWED AND VERIFY REQUIRED TECHNIQUES.	_	X	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
POST WELD	ING INSPECTIO	N		
7. TEST 10% OF ALL COMPLETE AND PARTIAL PENETRATION WELDS 5/16" OR GREATER	_	Х	_	AWS/AISC -SSI ICC-SWSI
BOLTING	INSPECTION			
8. INSPECT INSTALLATION AND TIGHTENING OF HIGH-STRENGTH BOLTS. VERIFY THAT SPLINES HAVE SEPARATED FROM TENSION CONTROL BOLTS. VERIFY PROPER TIGHTENING SEQUENCE.	_	X	AISC 360: N5.6	AWS/AISC -SSI ICC-SWSI
9. INSTALLATION OF BOLTS IN SLIP—CRITICAL CONNECTIONS SHALL BE MONITORED CONTINUOUSLY EXCEPT AS ALLOWED PER AISC 360: N5.6	×	l	AISC 360: N5.6	AWS/AISC -SSI ICC-SWSI
MISC. STEE	L INSPECTIONS	S		
10. VISUALLY INSPECT SIZE, NUMBER, POSITIONING AND WELDING OF SHEAR CONNECTORS. SOUND TEST ALL SHEAR CONNECTORS AND BEND TEST ALL QUESTIONABLE CONNECTORS. BEND TEST 15% OF SHEAR CONNECTORS TO 15 DEGREES FROM ORIGINAL AXIS.	_	X	AWS D1.1 SECTIONS 7.7 & 7.8	AWS-CWI ASNT
11. INSPECT STEEL FRAME FOR COMPLIANCE WITH STRUCTURAL DRAWINGS, INCLUDING BRACING, MEMBER CONFIGURATION & CONNECTION DETAILS.	-	X	-	PE/SE
12. VERIFY WELDING CERTIFICATIONS. INSPECT WELDING AND SIDE—LAP FASTENING OF METAL ROOF AND FLOOR DECK.	_	X	IBC 1705.2.2, SDI-QA/QC	AWS-CWI

SOIL SPECIAL INSPECTION	SOIL SPECIAL INSPECTION TABLE				
TYPE	CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION			
1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.	ı	X			
2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.	1	X			
3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS.	X	X			
4. VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL.	-	X			
5. PRIOR TO PLACEMENT OF COMPACTED FILL, INSPECT SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY.	_	X			

CONCRETE SPECIAL INSPECTION TABLE				
TYPE	CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION	REFERENCED STANDARD	CBC REFERENCE
1. INSPECT REINFORCEMENT AND VERIFY PLACEMENT.	_	×	ACI 318: CH. 20, 25.2, 25.3, 26.6.1 – 26.6.3	1908.4
2. INSPECT ANCHORS CAST IN CONCRETE	_	X	ACI 318: 17.8.2	_
3. INSPECT AND TEST ANCHOR POST INSTALLED IN HARDENED CONCRETE MEMBERS. A. ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS. B. MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4.A	X	X	ACI 318: 17.8.2.4 ACI 318: 17.8.2	-
4. VERIFY USE OF REQUIRED DESIGN MIX.	_	X	ACI 318: CH. 19, 26.4.3, 26.4.4	1904.1, 1904.2, 1908.2, 1908.3
5. VERIFY MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES.	_	×	ACI 318: 26.5.3 -26.5.5	1908.9
6. VERIFY IN—SITU CONCRETE STRENGTH, PRIOR TO REMOVAL OF FORMS FROM STRUCTURAL SLABS.	_	Х	ACI 318: 26.11.2	_
7. INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.	_	X	ACI 318: 26.11.1.2(B)	_

	CTION T	ABLE						
	MASONRY SPECIAL INSPECTION TABLE							
CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION	TMS 402/ ACI530/ ASCE 5	TMS 602, ACI 530.1 ASCE 6					
_	×	_	ART. 1.5					
NRY CONSTRUC	CTION		•					
-	X	-	ART. 3.3					
-	X	-	ART. 3.4 3.6 A					
TO GROUTING								
_	X	-	ART. 3.2 D, 3.2 F					
-	х	SECTION 6.1	ART. 2.4 3.4					
_	×	SECTIONS 6.1, 6.2.1, 6.2.6, 6.2.7	ART. 3.2 E, 3.4, 3. A					
_	×	I	ART. 2.6 B, 2.4 G.1.B					
_	X	ı	ART. 3.3					
NG CONSTRUCT	TION							
_	×	-	ART. 3.3					
_	Х	-	ART. 1.80 1.8D					
X	-	-	ART. 3.5 3.6 C					
_	X	_	ART. 1.4 B2.A.3, 1. B.2.B.3, 1.4 B.2.C.3, 1.4 B.3, 1.4 B.4					
	SPECIAL INSPECTION - ONRY CONSTRUCT - TO GROUTING ING CONSTRUCT	SPECIAL INSPECTION - X ONRY CONSTRUCTION - X TO GROUTING - X - X - X NSTANDARY SPECIAL INSPECTION - X - X - X - X - X - X - X -	SPECIAL INSPECTION ACI530 / ASCE 5					



NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON.

ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)


Kimley»Horn DATE BY MARK DESCRIPTION /USTIN L. BRUE <u>X.C.E. 87614</u> REVISIONS



Phone: (619) 234-9411

WWW.KIMLEY-HORN.COM

8/23/2021



195284001







CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: Date: <u>11/19/2021</u> BEAUMONT CROSSROADS Date: 11/23/2021 LIFT STATION

SHEET of <u>38</u> sheets 3387

CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT 550E. 6th St Beaumont, CA 92223 GENERAL STRUCTURAL NOTES II ENGINEERING DIVISION TEL: (951) 769-8520 FAX: (951) 769-8526

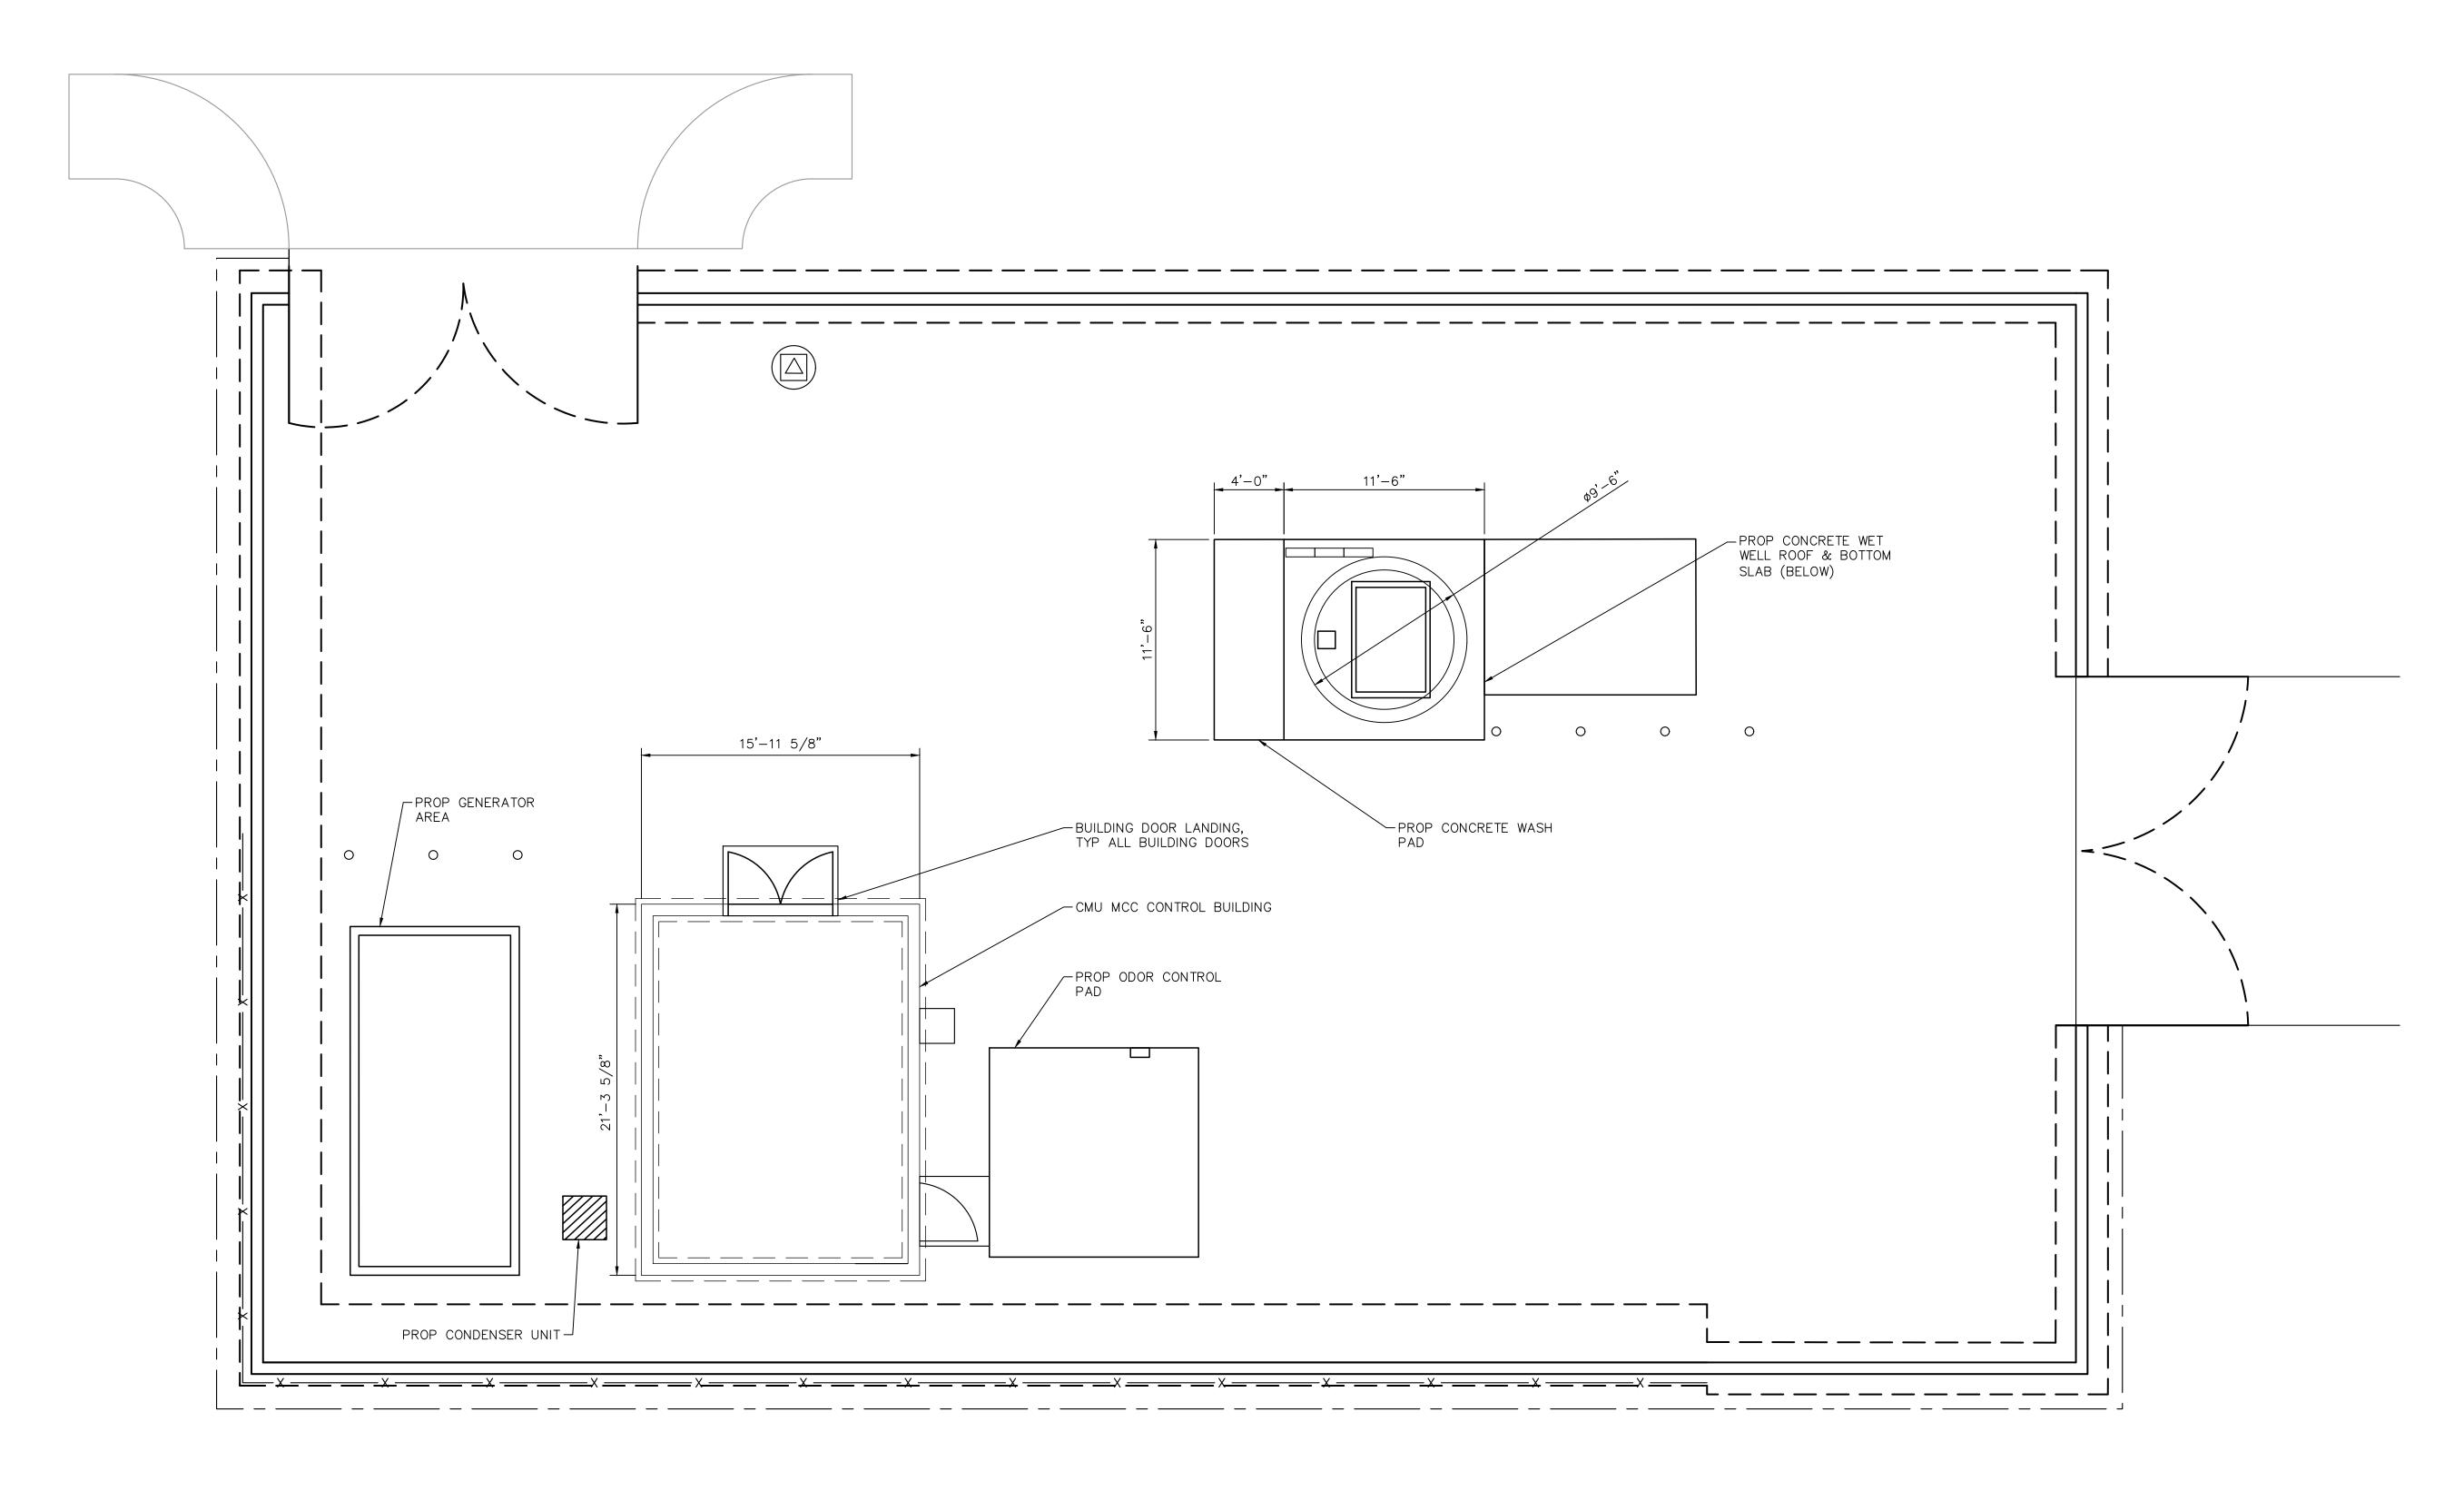







DIGALERT	I N 1. TI SI FI
Call 2 Working Days Before You Dig! 811	P R O S 2 IN A Th

BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST)						Kimley » Horn	SEAL
SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH						401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234—9411 WWW.KIMLEY—HORN.COM	
SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH	ВУ	MARK	DESCRIPTION	APPR.	DATE	Mue	\
A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)		NEER	R E V I S I O N S		ITY	// /USTIN L. BRUE 8/23/2021 R.C.E. 87614	



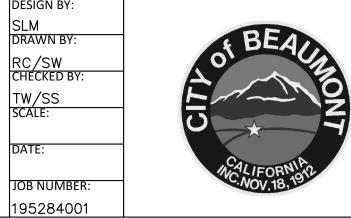


	Reviewed By: Staff Engineer	Date:	
	Recommended for Approval By: Administrative Engineer	Date: <u>11/19/2021</u>	
	Approved By: Huth City Engineer/Director of Public Works	Date: <u>11/23/2021</u>	
ENGINEERING DIVISION Beaumont, CA 92		Beaumont, CA 92223	

CITY OF BEAUMONT, CALIFORNIA
IMPROVEMENT PLANS FOR:
BEAUMONT CROSSROADS
LIFT STATION

STRUCTURAL SITE PLAN

OF <u>38</u> SHEETS
FILE NO:
3387

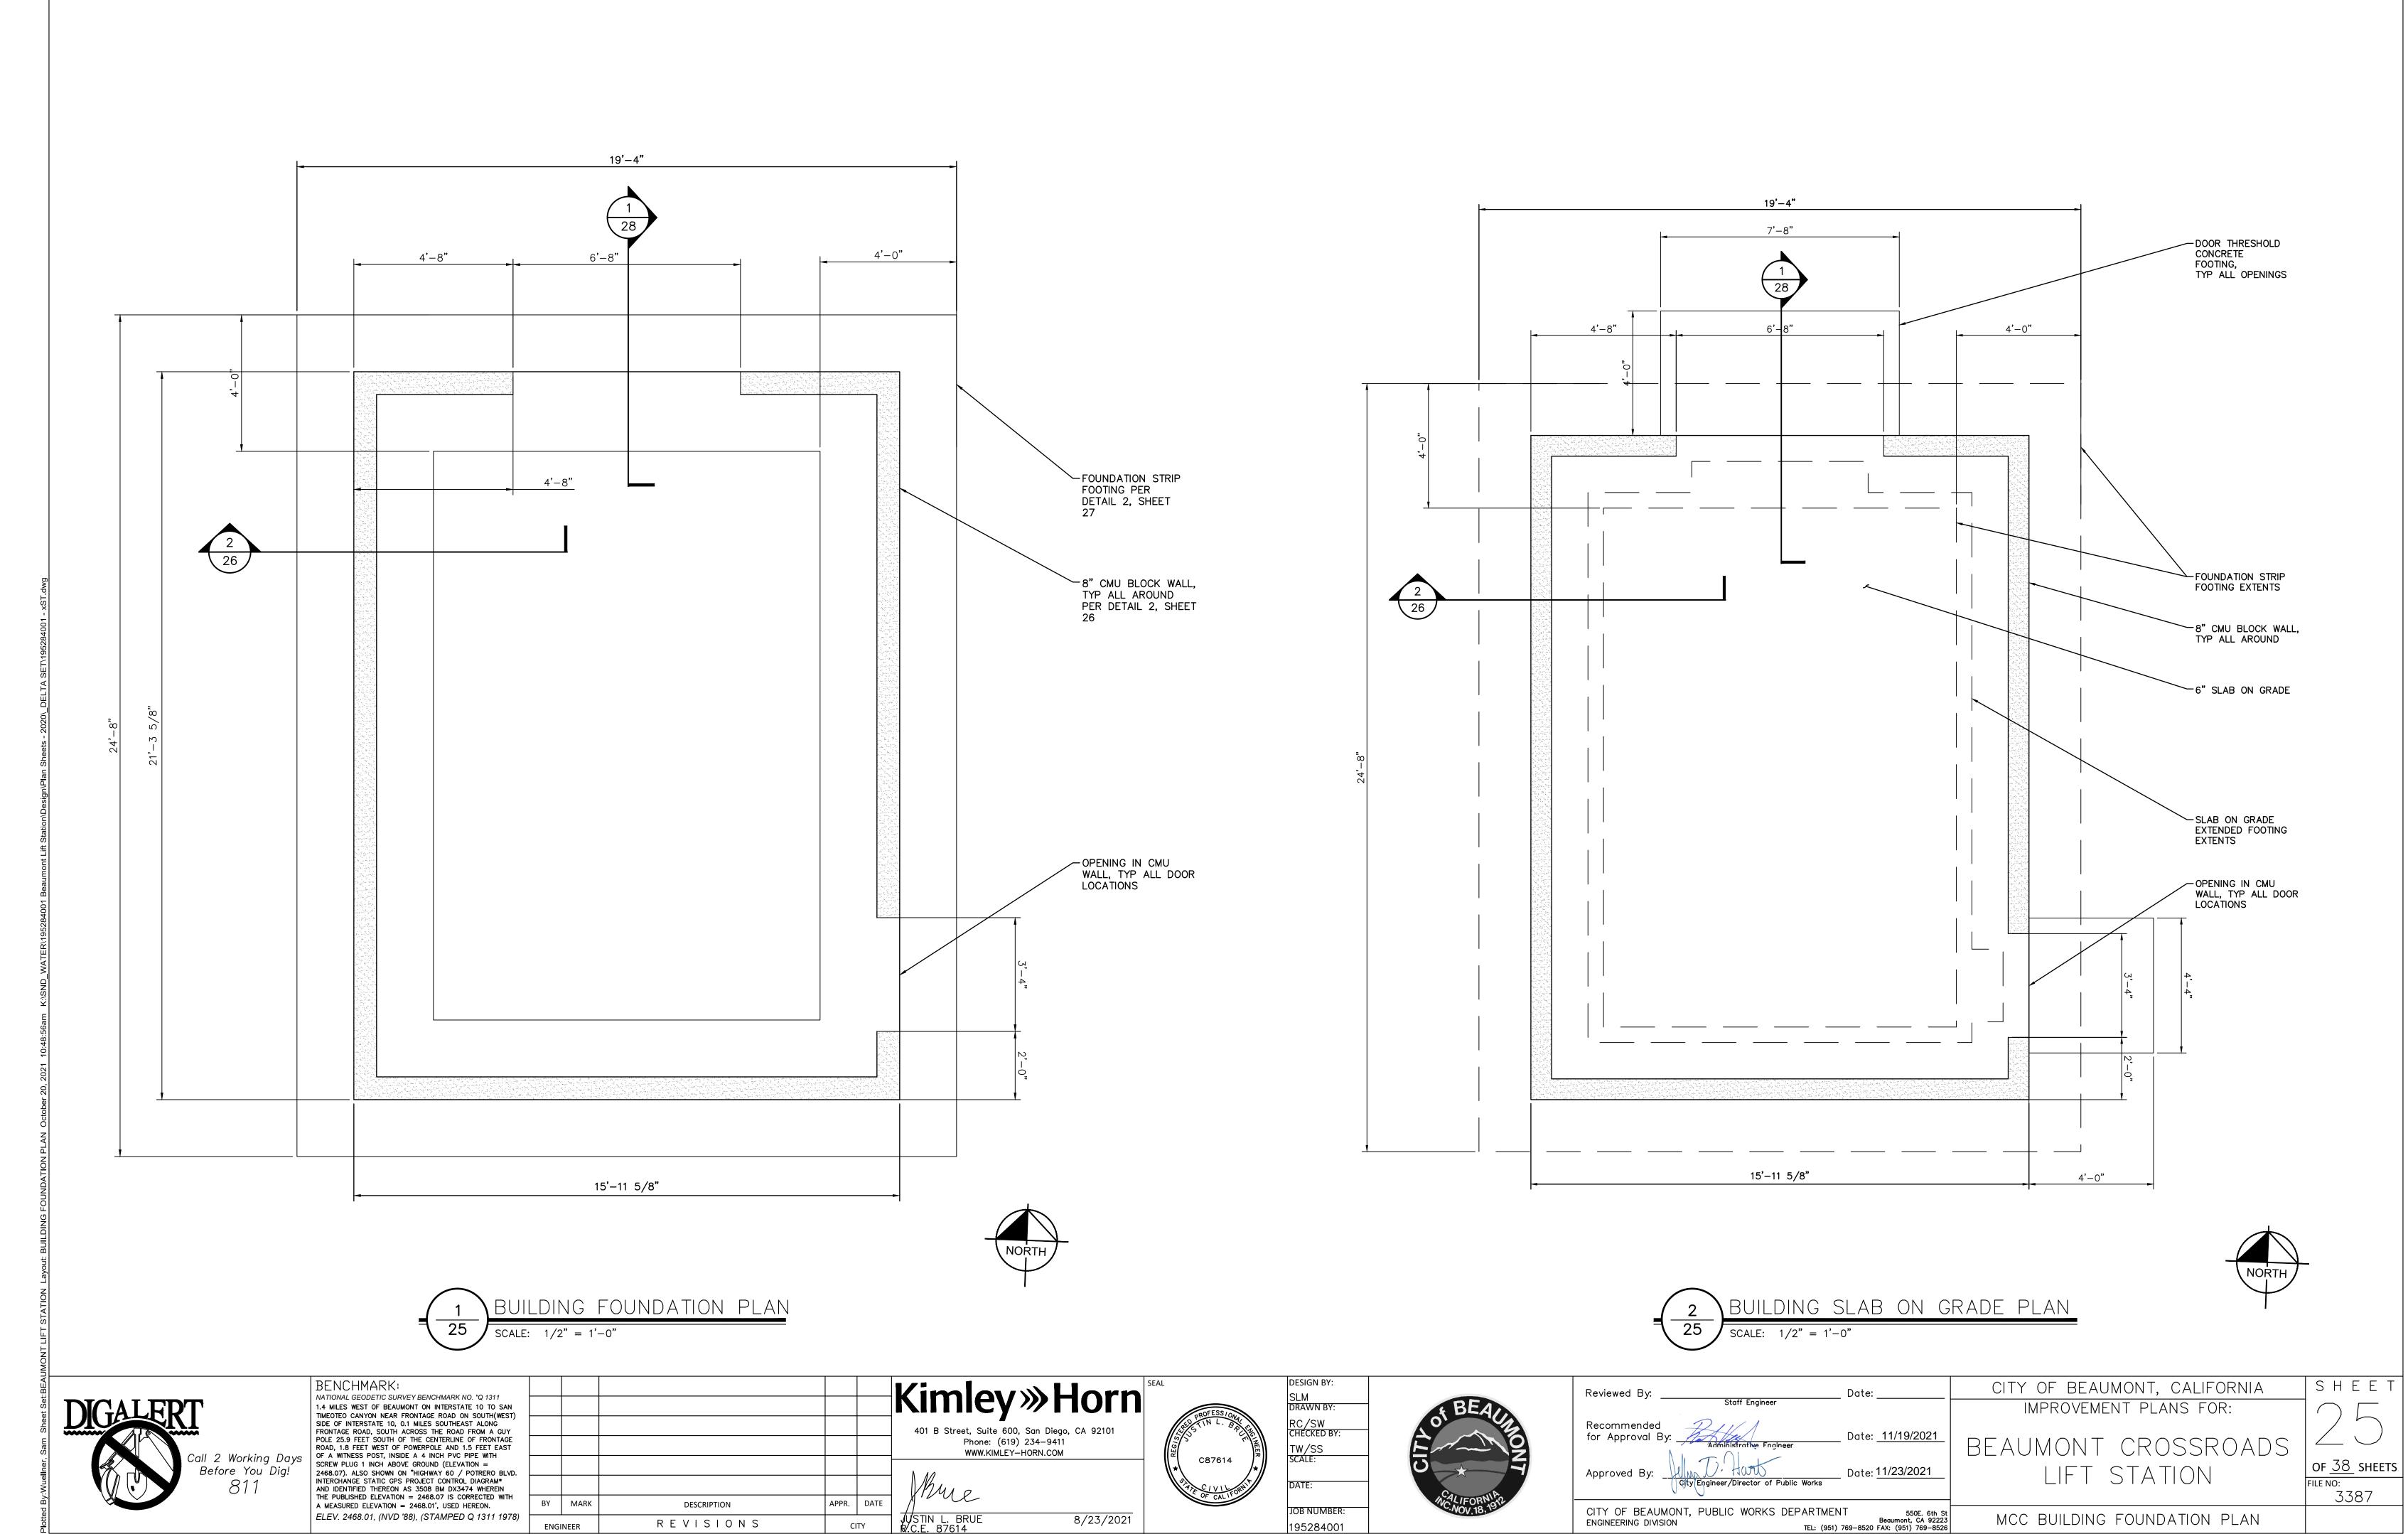


8/23/2021


195284001

ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

REVISIONS

MCC BUILDING FOUNDATION PLAN

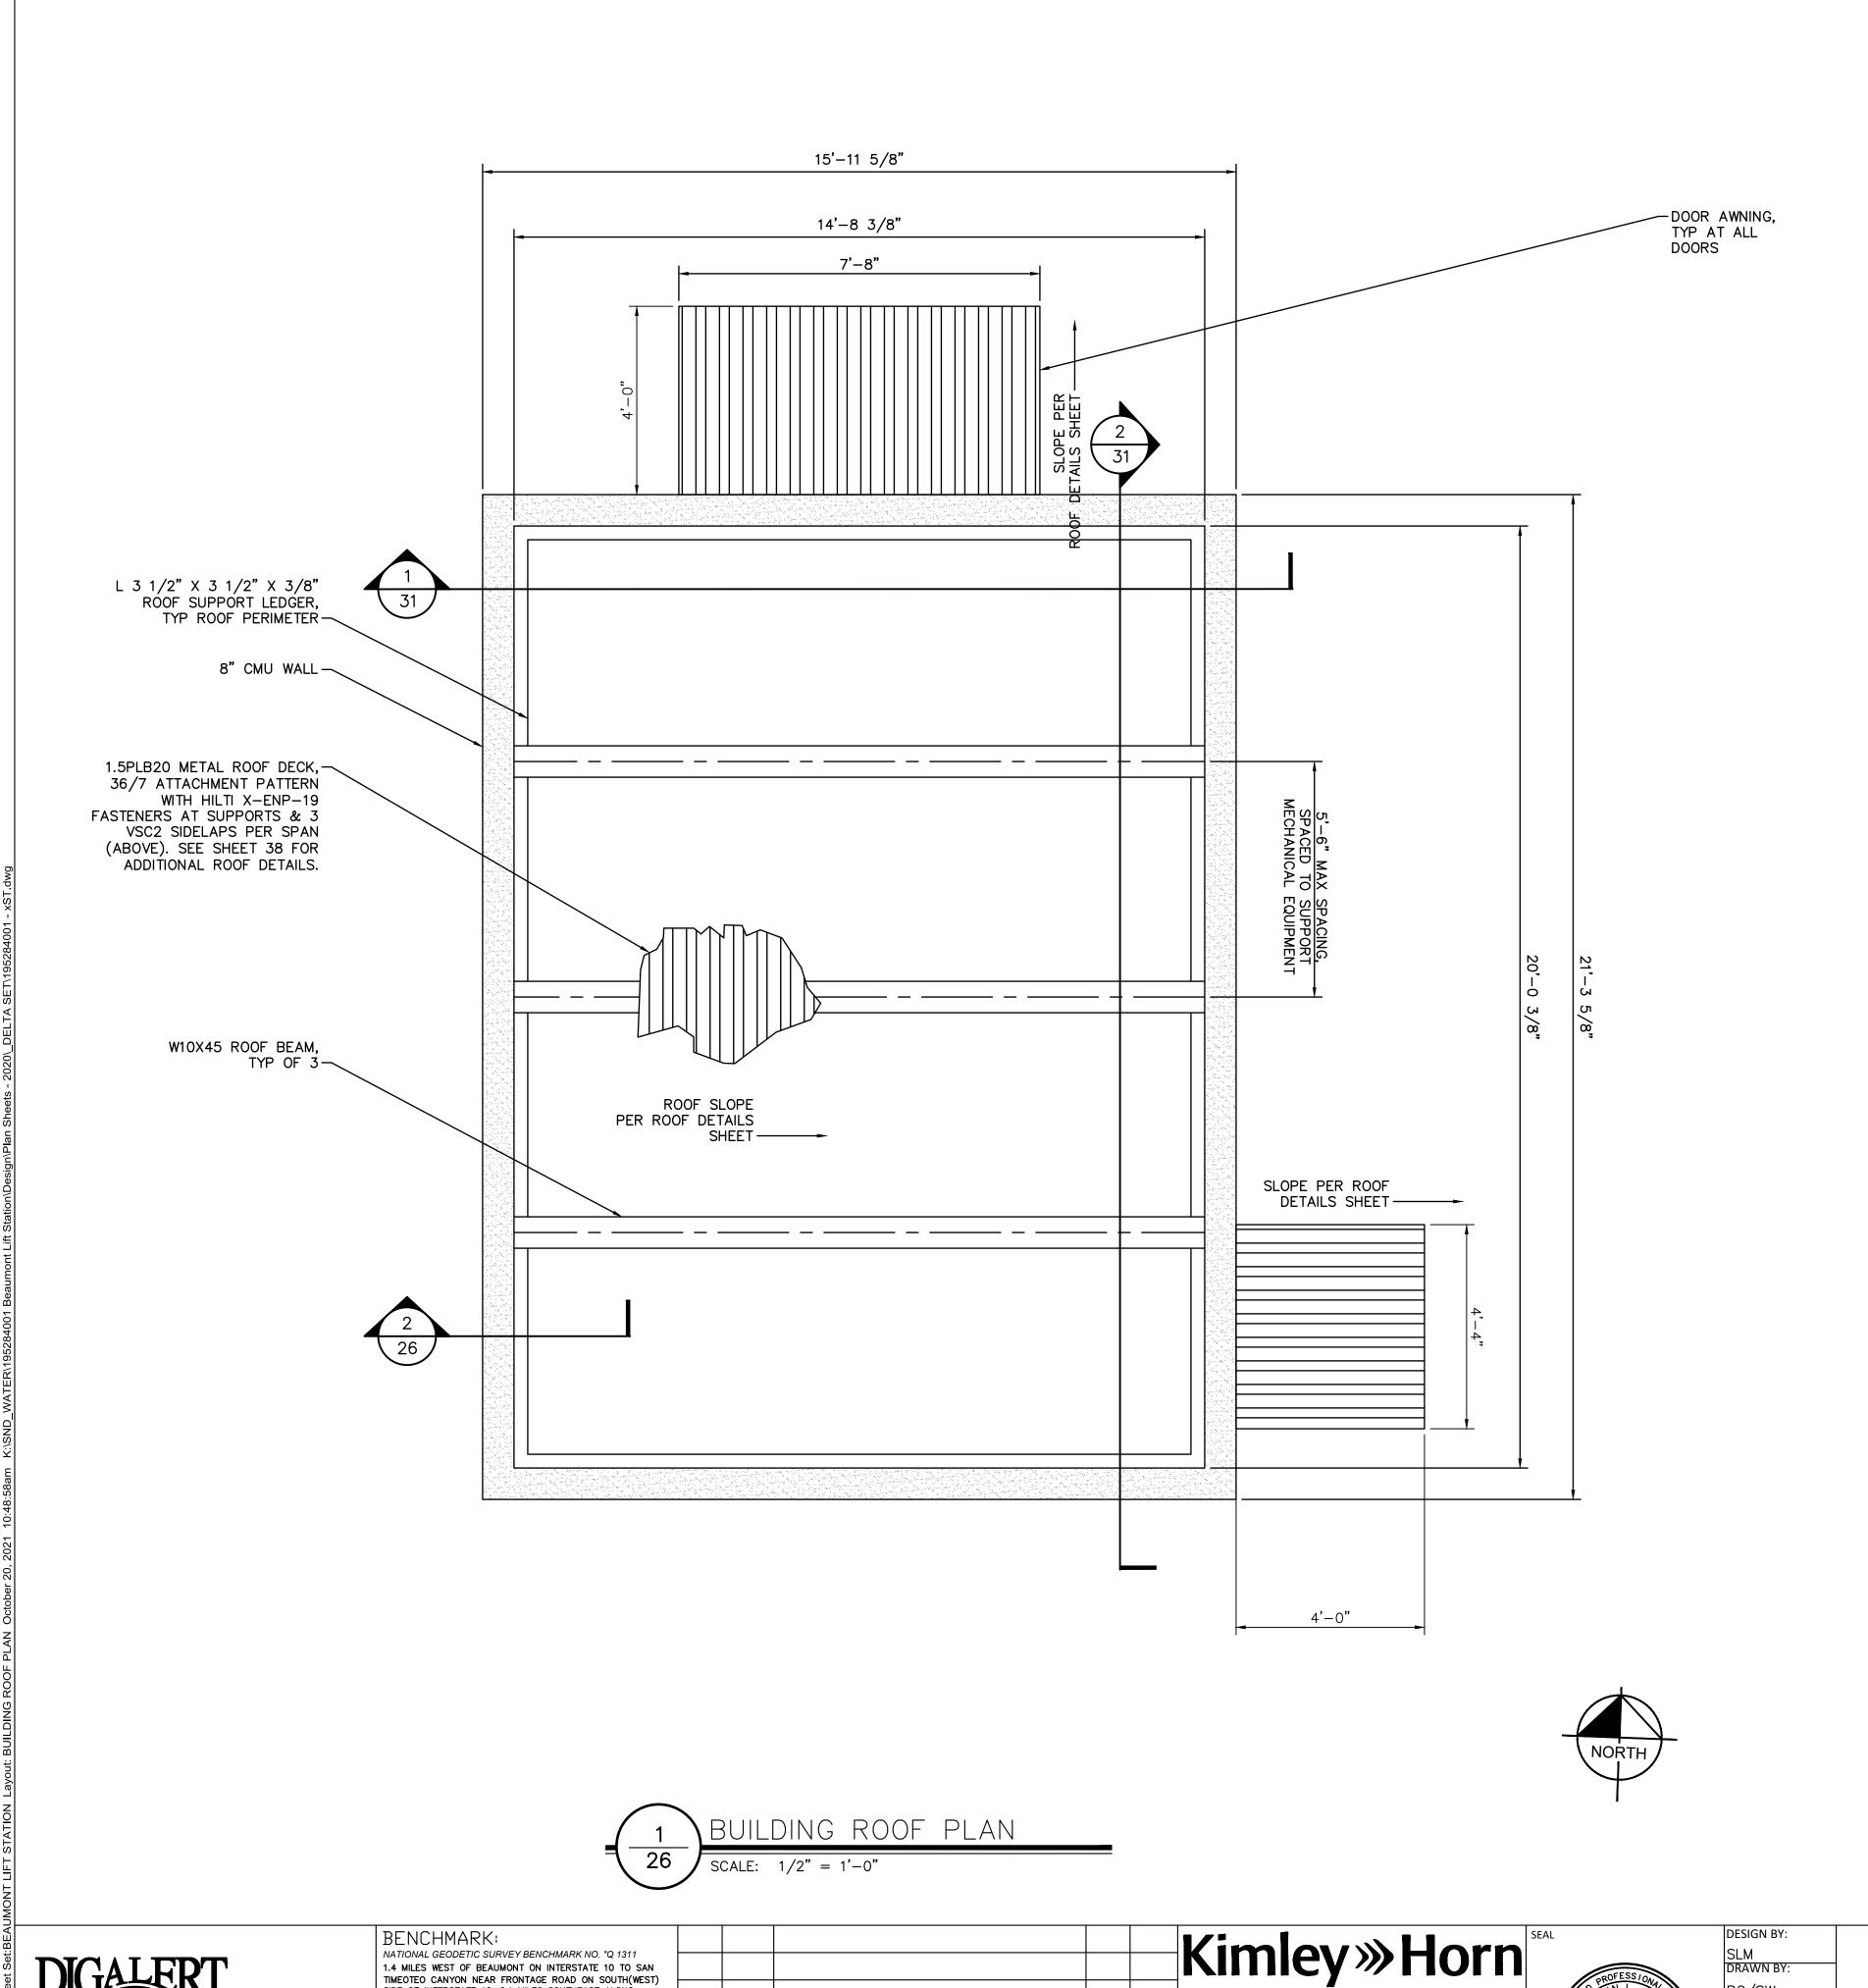

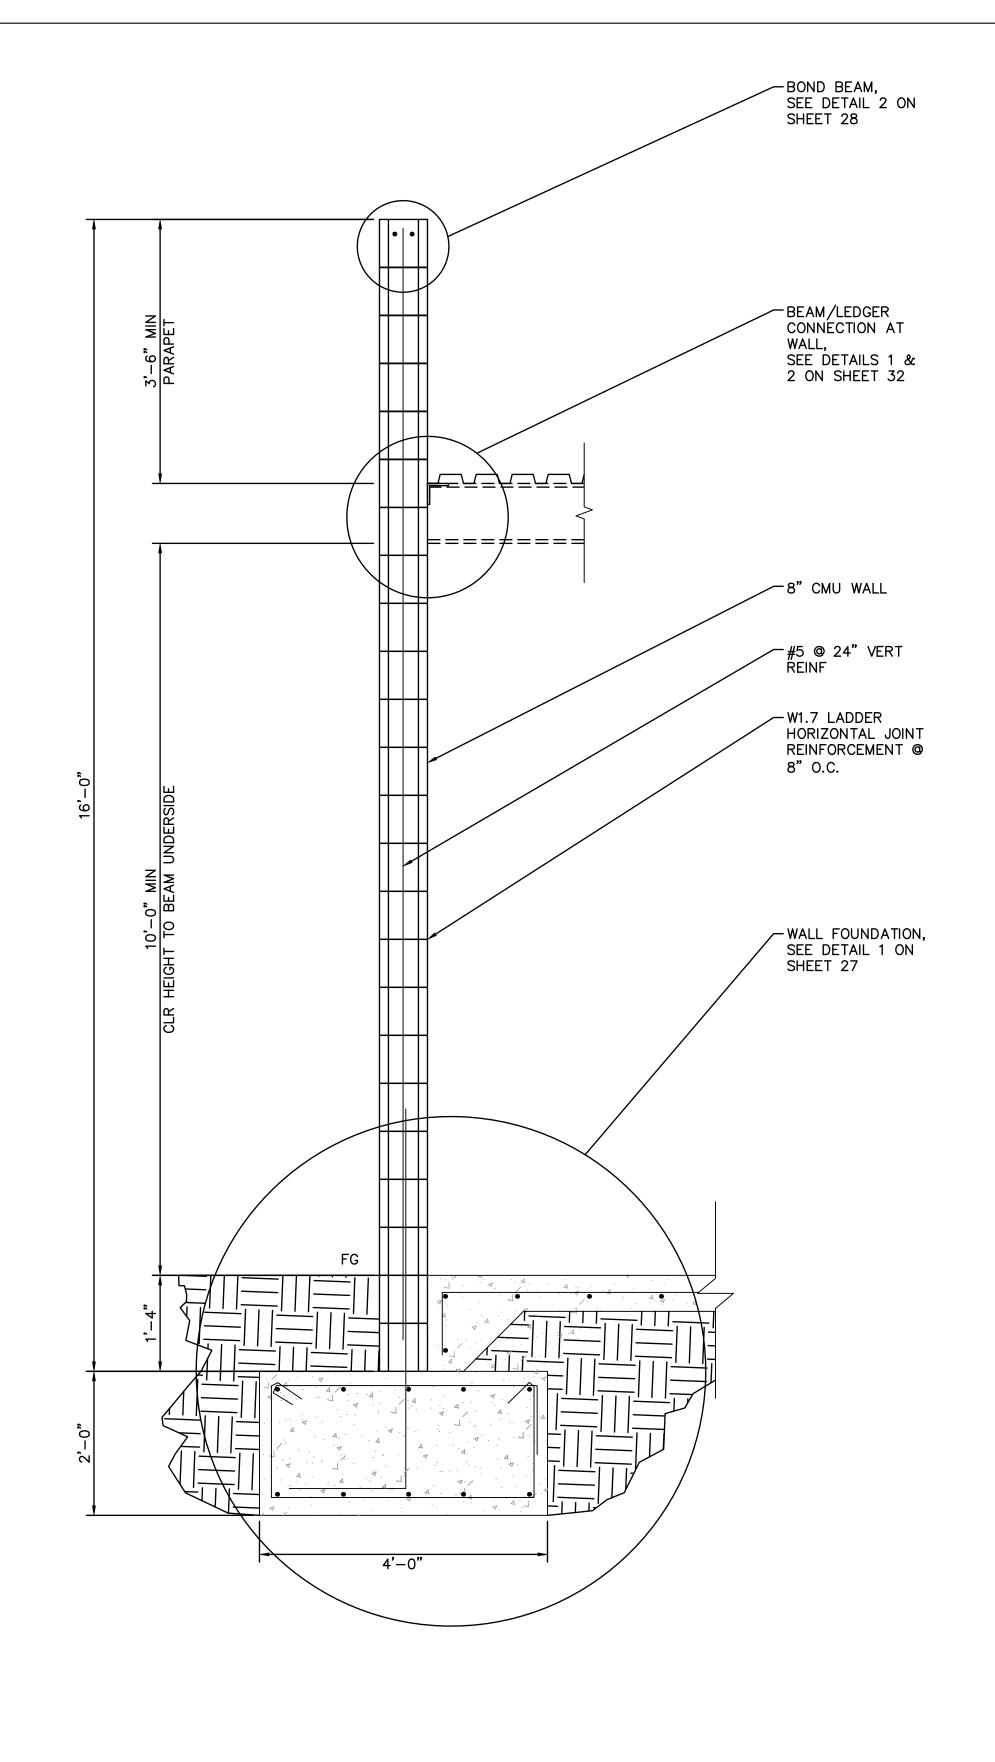






BENCHMARK:

NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311

1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON.

401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234—9411 WWW.KIMLEY—HORN.COM APPR. DATE BY MARK DESCRIPTION ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978) VSTIN L. BRUE R.C.E. 87614 8/23/2021 REVISIONS



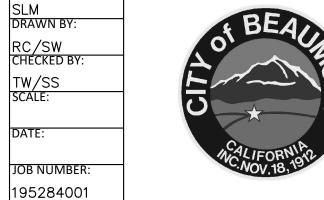


Reviewed By:Staff Engineer	Date:	
Recommended for Approval By: Administrative Engineer	Date: <u>11/19/2021</u>	
Approved By: City Engineer/Director of Public Works	Date: <u>11/23/2021</u>	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	


CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

of 38 sheets 3387


SHEET

MCC BUILDING ROOF PLAN

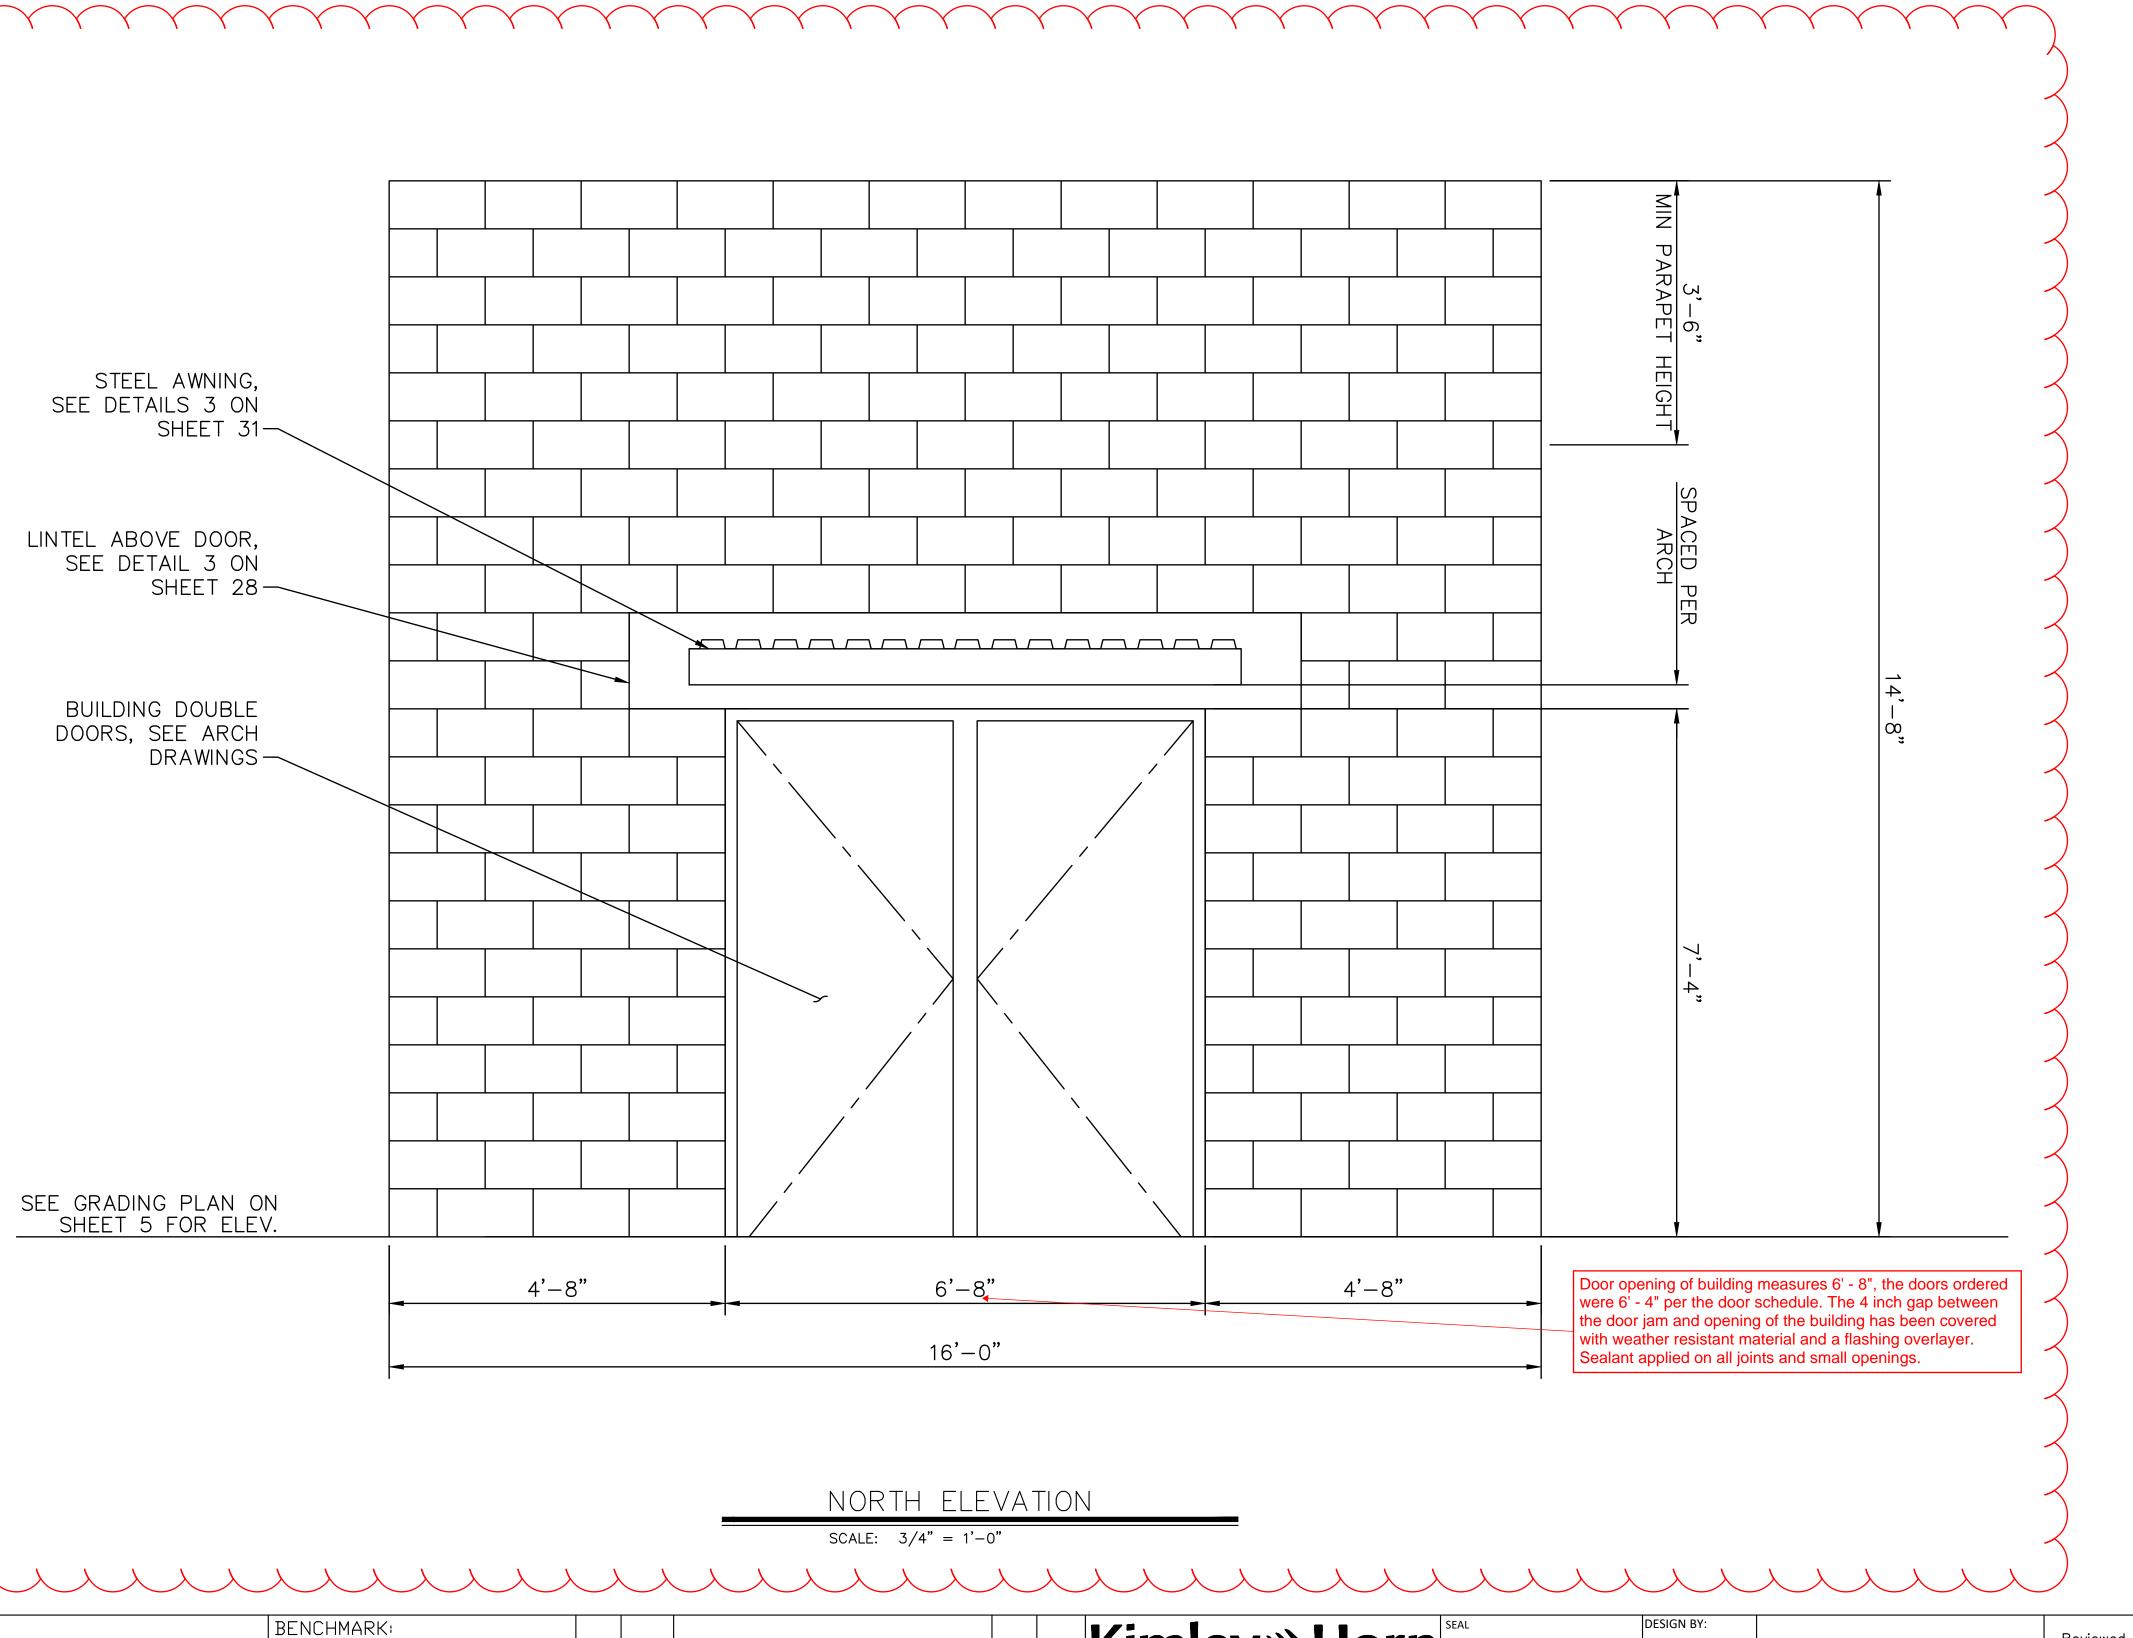

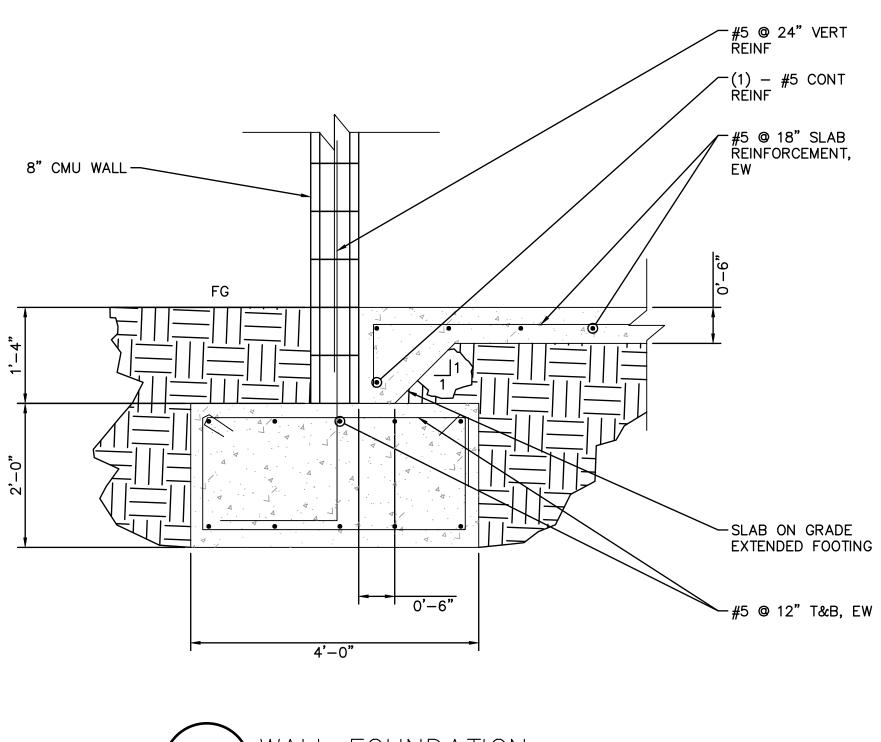



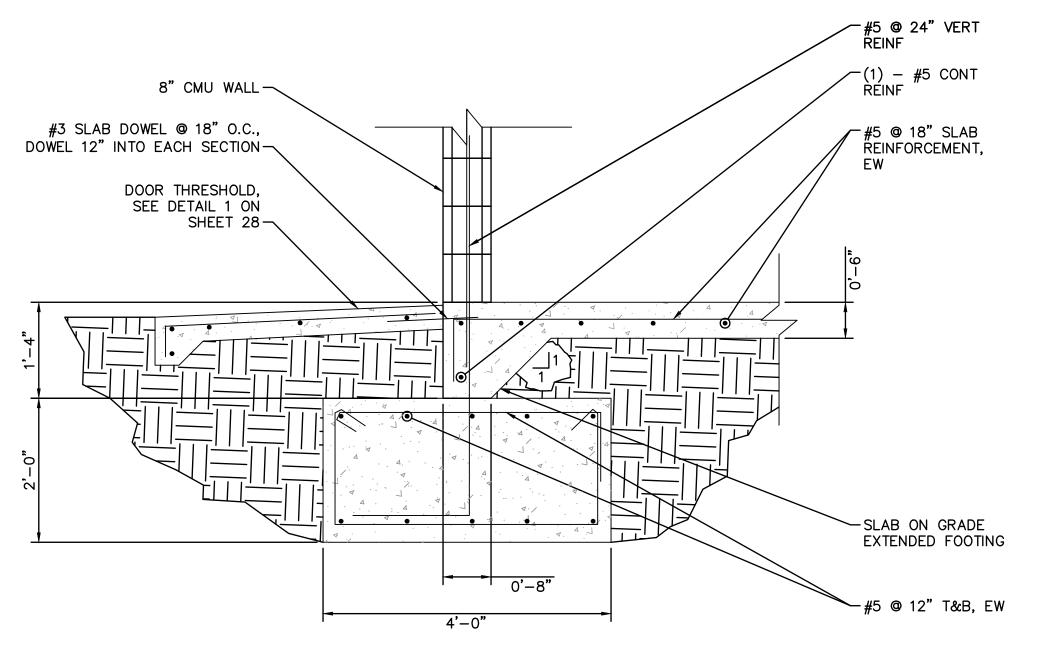

WALL FOUNDATION AT DOORWAY





BENCHMARK:

NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311

1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG Kimley» Horn FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY PRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY
POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE
ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST
OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH
SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION =
2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD.
INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH APPR. DATE BY MARK DESCRIPTION A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978) 8/23/2021

REVISIONS





195284001




Reviewed By:Staff Engineer	Date:	
Recommended for Approval By: Administrative Engineer	Date: <u>11/19/2021</u>	Г
Approved By: City Engineer/Director of Public Works	_ Date: <u>11/23/2021</u>	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	


CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS of <u>38</u> sheets LIFT STATION

MCC BUILDING ELEVATION I

15'-11 5/8"

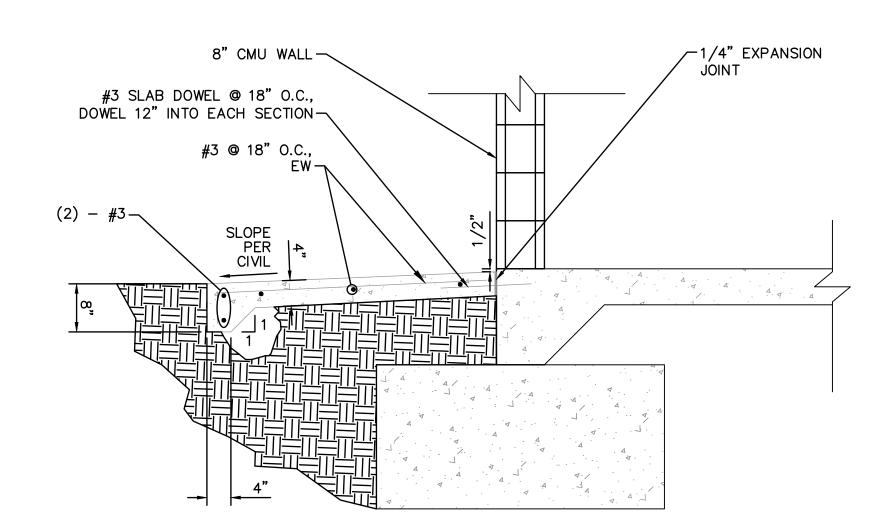




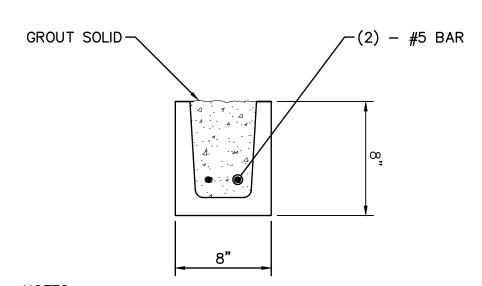

NOTES:

1. PROVIDE BOND BEAM AT THE TOP OF ALL WALLS.

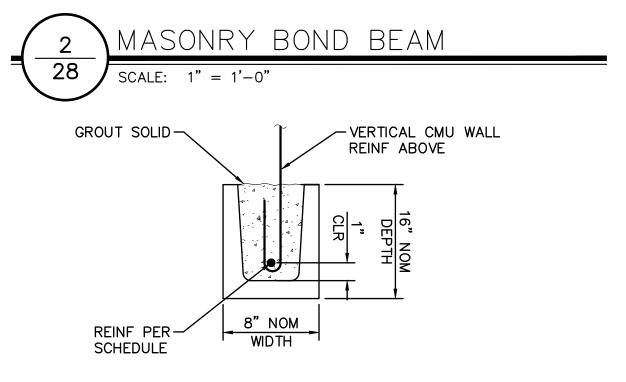

16 IN NOMINAL DEPTH LINTEL

CMU MASONRY LINTEL SCHEDULE (EXTERIOR WALLS)											
CLEAR OPENING WIDTH, W	CLEAR OPENING WIDTH, W BOND BEAM / LINTEL DEPTH REINFORCING MIN BEARING										
W ≥6'-0" 16" 2 - #5 16"											
W ≤ 6'-0"	16"	1 - #5	16"								

- NOTES:

 1. EXTEND REINFORCING TO END OF BEARING AT EACH SIDE OF OPENING.
- FILL ALL CELLS UNDER BEARING WITH GROUT AND (1) #5 VERT BARS CONT TO FOUNDATION, LOCATED DIRECTLY BELOW BEARING AT EACH SIDE OF LINTEL.
 LINTELS SHALL BE SHORED UNTIL GROUT REACHES DESIGN COMPRESSIVE STRENGTH.
- 4. LINTEL SPANS BEYOND THE MAXIMUM INDICATED IN THE SCHEDULE REQUIRES SPECIAL DESIGN.





SEE GRADING PLAN ON SHEET 5 FOR ELEV.


BENCHMARK:
NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON.

BY MARK ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

Kimley» Horn APPR. DATE DESCRIPTION VSTIN L. BRUE R.C.E. 87614 REVISIONS


SOUTH ELEVATION


SCALE: 3/4" = 1'-0"



Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM

8/23/2021

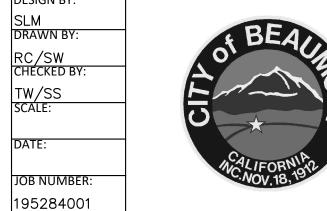

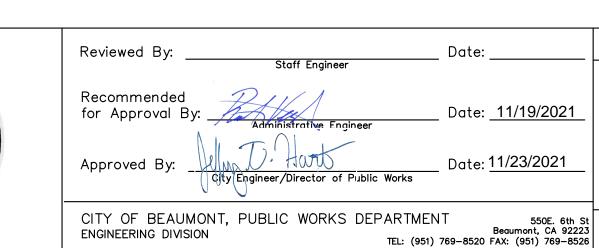


CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

MCC BUILDING ELEVATION II

SHEET

of <u>38</u> sheets

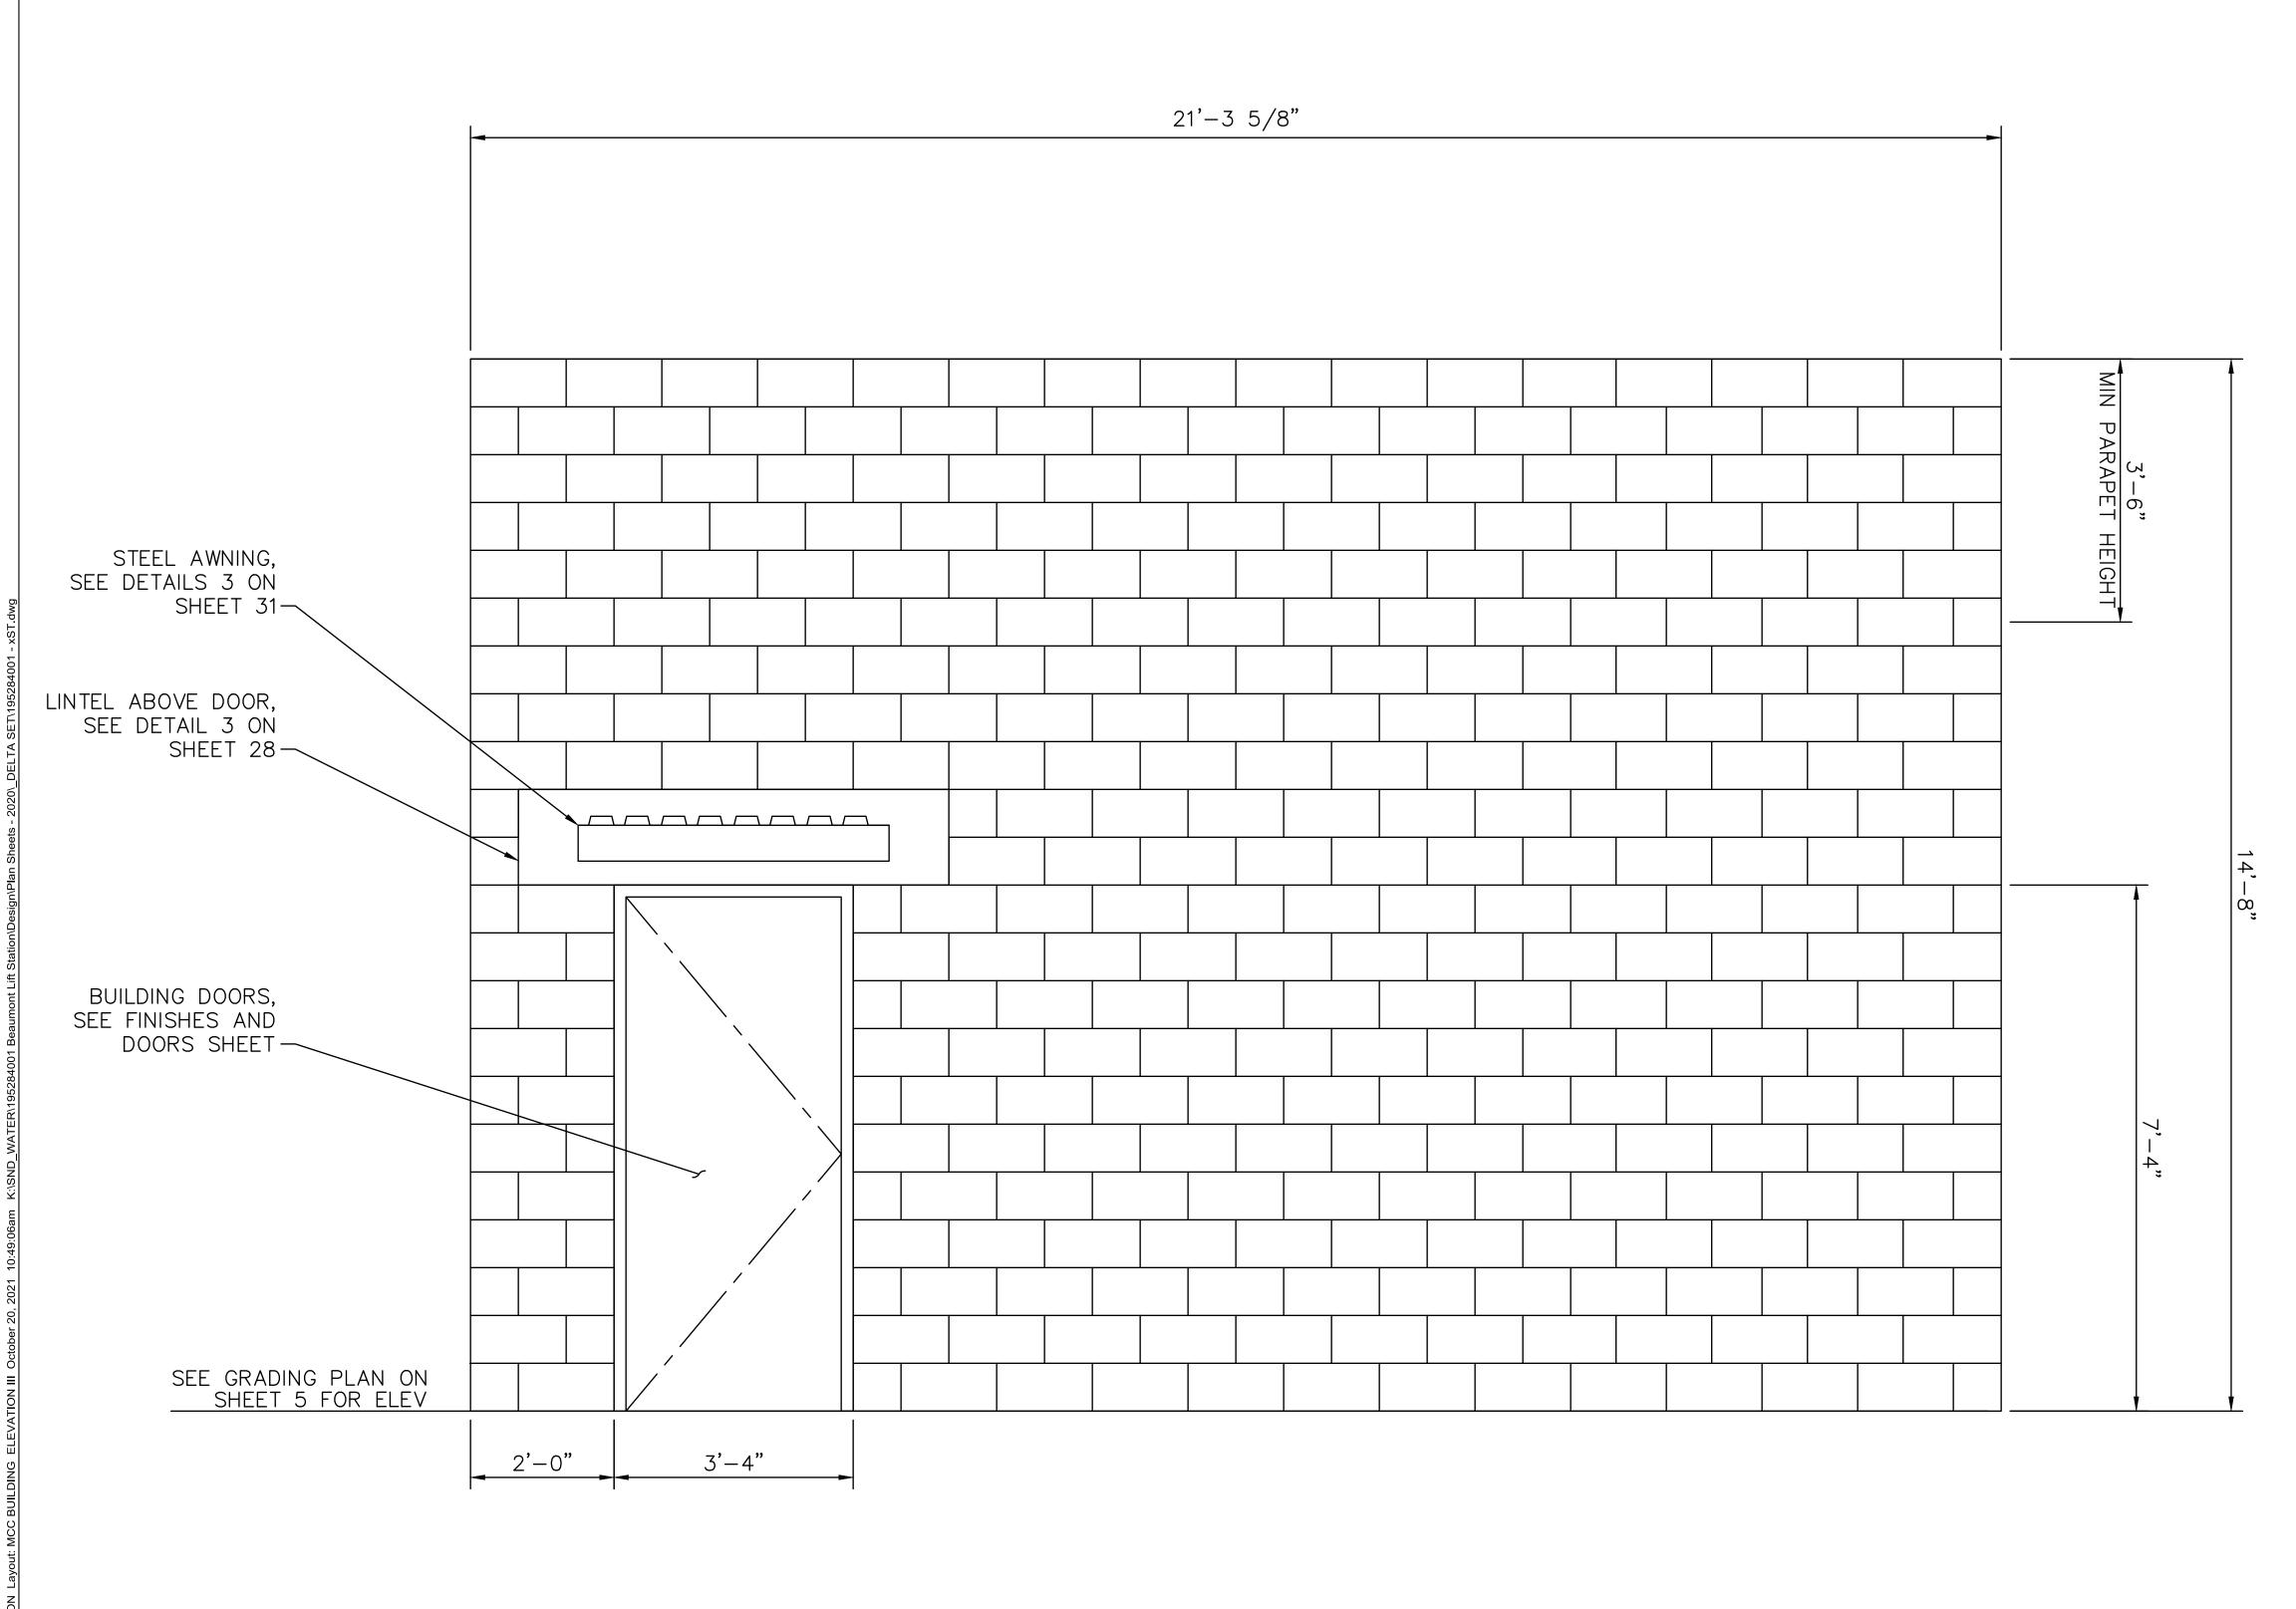

EAST ELEVATION

SCALE: 3/4" = 1'-0"

REVISIONS

DIGALERT

Call 2 Working Days
Before You Dig!

811

BENCHMARK:

NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311

1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON.

BY

ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)


Kimley Horn

401 B Street, Suite 600, San Diego, CA 92101
Phone: (619) 234–9411
WWW.KIMLEY-HORN.COM

BY MARK DESCRIPTION APPR. DATE



8/23/2021

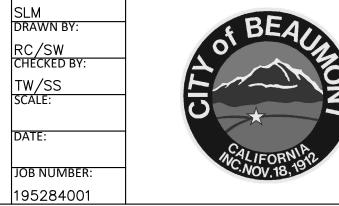





CITY OF BEAUMONT, CALIFORNIA
IMPROVEMENT PLANS FOR:
BEAUMONT CROSSROADS
LIFT STATION

OF <u>38</u> SHEETS
FILE NO:
3387

SHEET

MCC BUILDING ELEVATION III

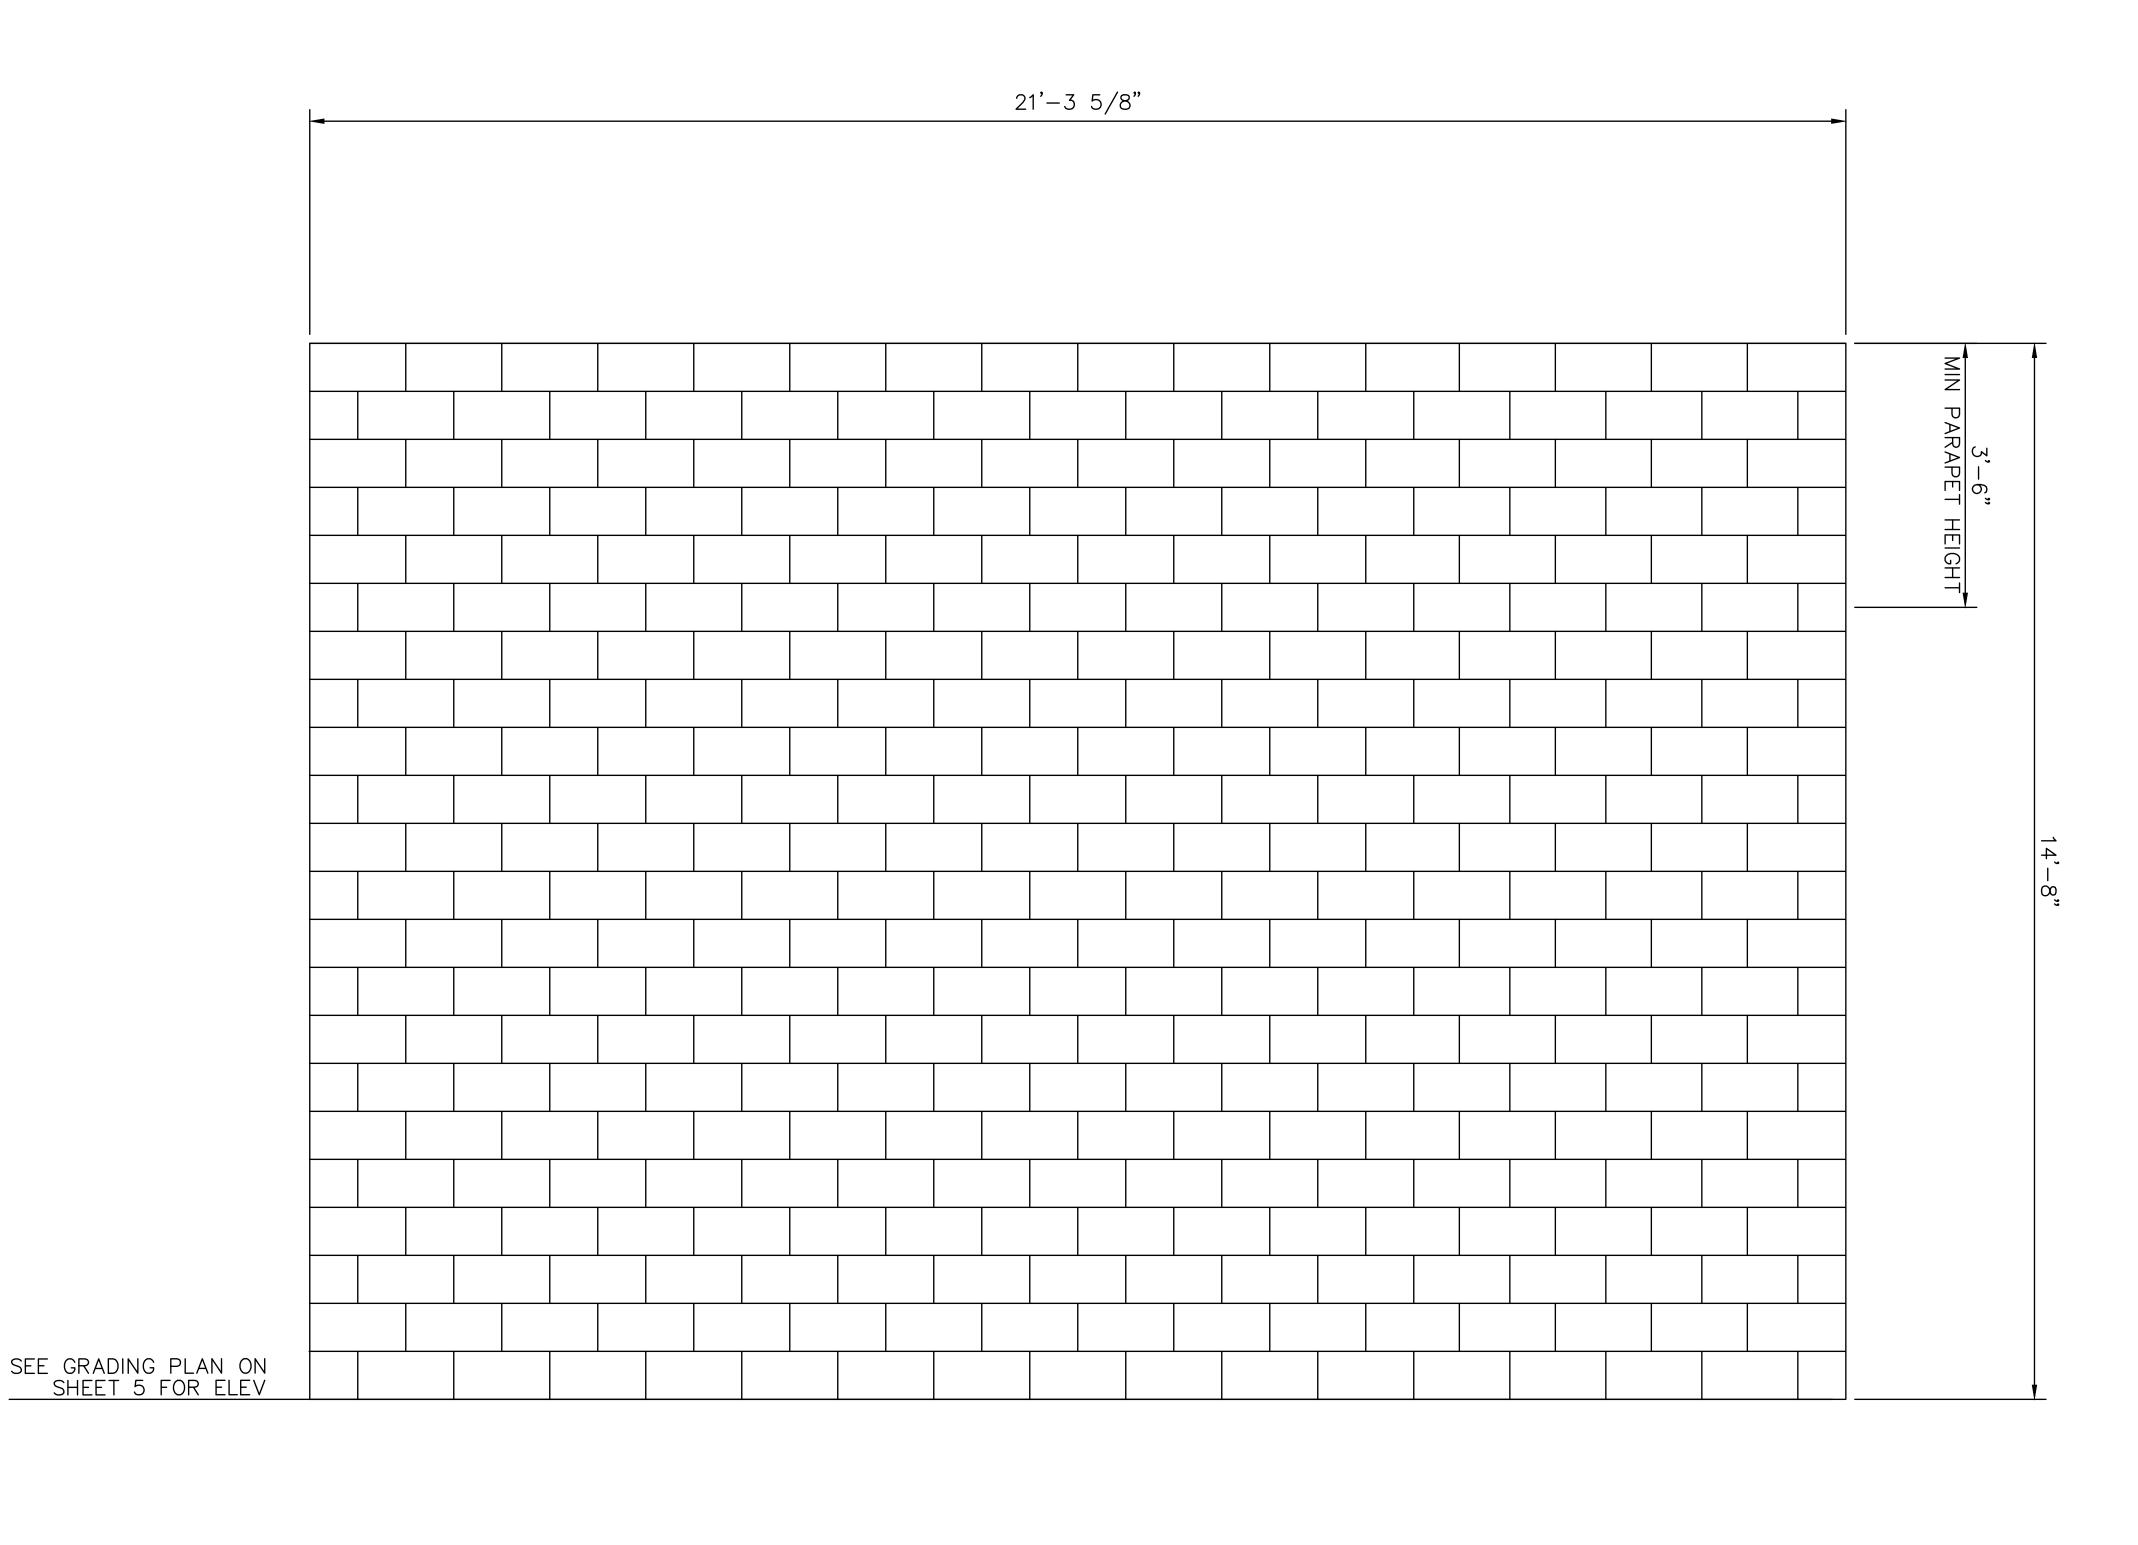

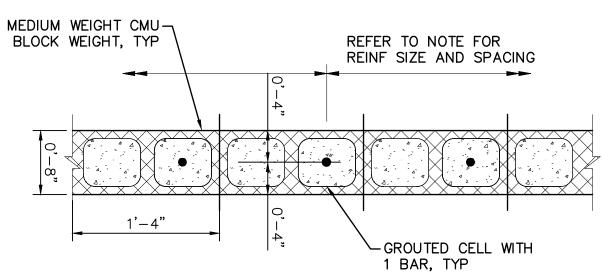


NOTES:

1. UNLESS NOTED OTHERWISE ON THE DRAWINGS, REINFORCE ALL CMU WALL WITH (1) #5 BAR @

- 2. PROVIDE VERT REINF AND GROUT PER NOTE 1 IN THE ADJACENT 2 CELLS ON BOTH SIDES OF ALL OPENINGS & ENDINGS.
- 3. VERTICAL BARS ARE TO EXTEND A MIN OF 6" INTO THE BOND BEAM AT THE TOP OF WALL. BOND BEAMS SHALL BE REINFORCED WITH CONTINUOUS BARS ALONG BEAM PER TYPICAL
- 4. ALL CMU SHALL BE FULLY GROUTED.
- PROVIDE AN OPEN BOTTOM BOND BEAM REINF WITH (1) #5 CONT BARS AT THE FOLLOWING LOCATIONS:
 a) AT THE TOP OF ALL WALL ELEVATIONS.




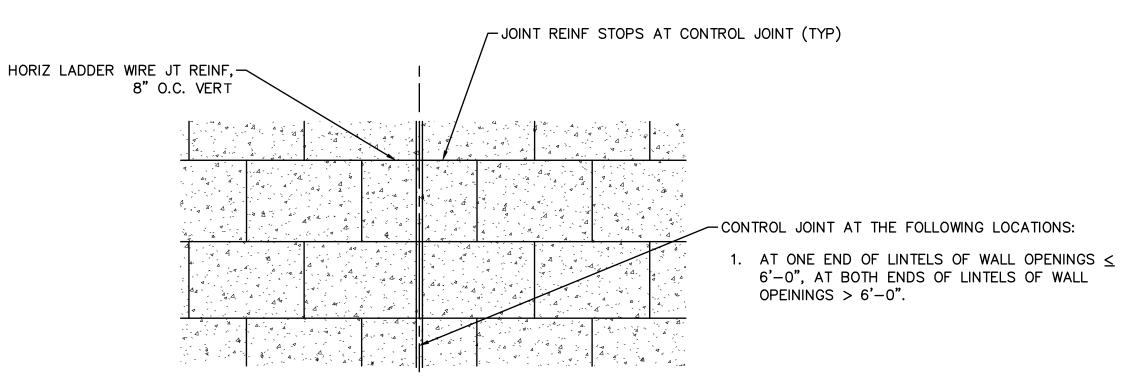

NOTES:

1. CONTROL JOINTS MAY BE OFFSET A MAXIMUM DISTANCE OF 8" CROSS WIRES WITHIN THIS OFFSET SHALL BE CUT.

ELEVATION

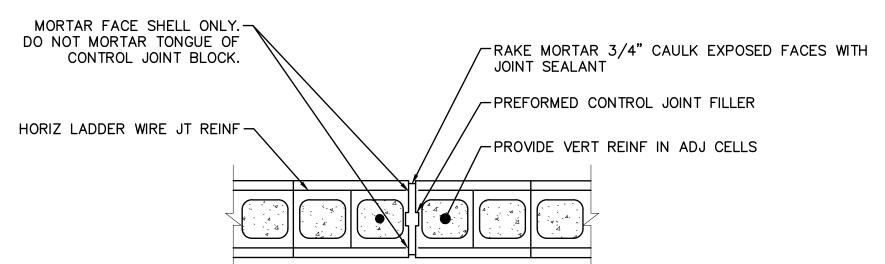


NOTES: 1. WIDE FLANGED PREFORMED CONTROL JOINT FILLER MAY BE USED IN LIEU OF DETAIL SHOWN.

PLAN


2 CMU WALL CONTROL JOINT SCALE: 1" = 1'-0"

WEST ELEVATION


SCALE: 3/4" = 1'-0"

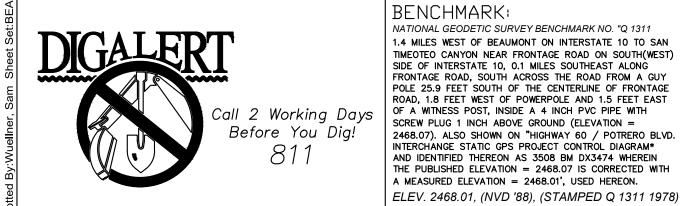

ENCHMARK:						V :-
ATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN MEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST)						
DE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG RONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY						401 E
OLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE OLD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OLD, WITHEST POST INSUES A 4 NULL DAY OF DEEP WATER						
F A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH CREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD.						1
ITERCHÁNGE STATIC GPS PROJECT CONTROL DIAGRAM* ND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN						M
HE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH MEASURED ELEVATION = 2468.01', USED HEREON.	BY	MARK	DESCRIPTION	APPR.	DATE	1 X'

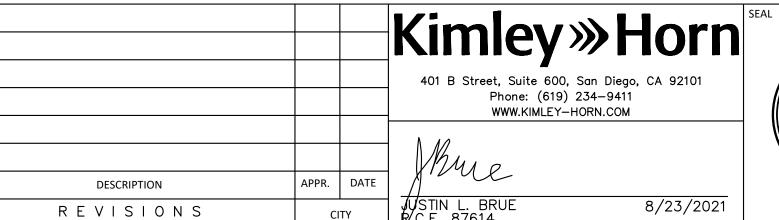



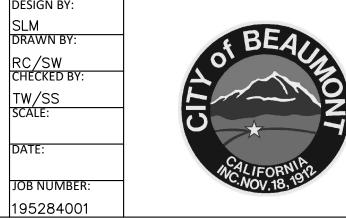


Reviewed By:Staff Engineer	Date:	
Recommended for Approval By: Administrative Engineer	Date: <u>11/19/2021</u>	
Approved By: City Engineer/Director of Public Works	Date: <u>11/23/2021</u>	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	550E. 6th St Beaumont, CA 92223 769–8520 FAX: (951) 769–8526	


CITY OF BEAUMONT, CALIFORNIA
IMPROVEMENT PLANS FOR:
BEAUMONT CROSSROADS
LIFT STATION


MCC BUILDING ELEVATION IV


SHEET


of 38 sheets

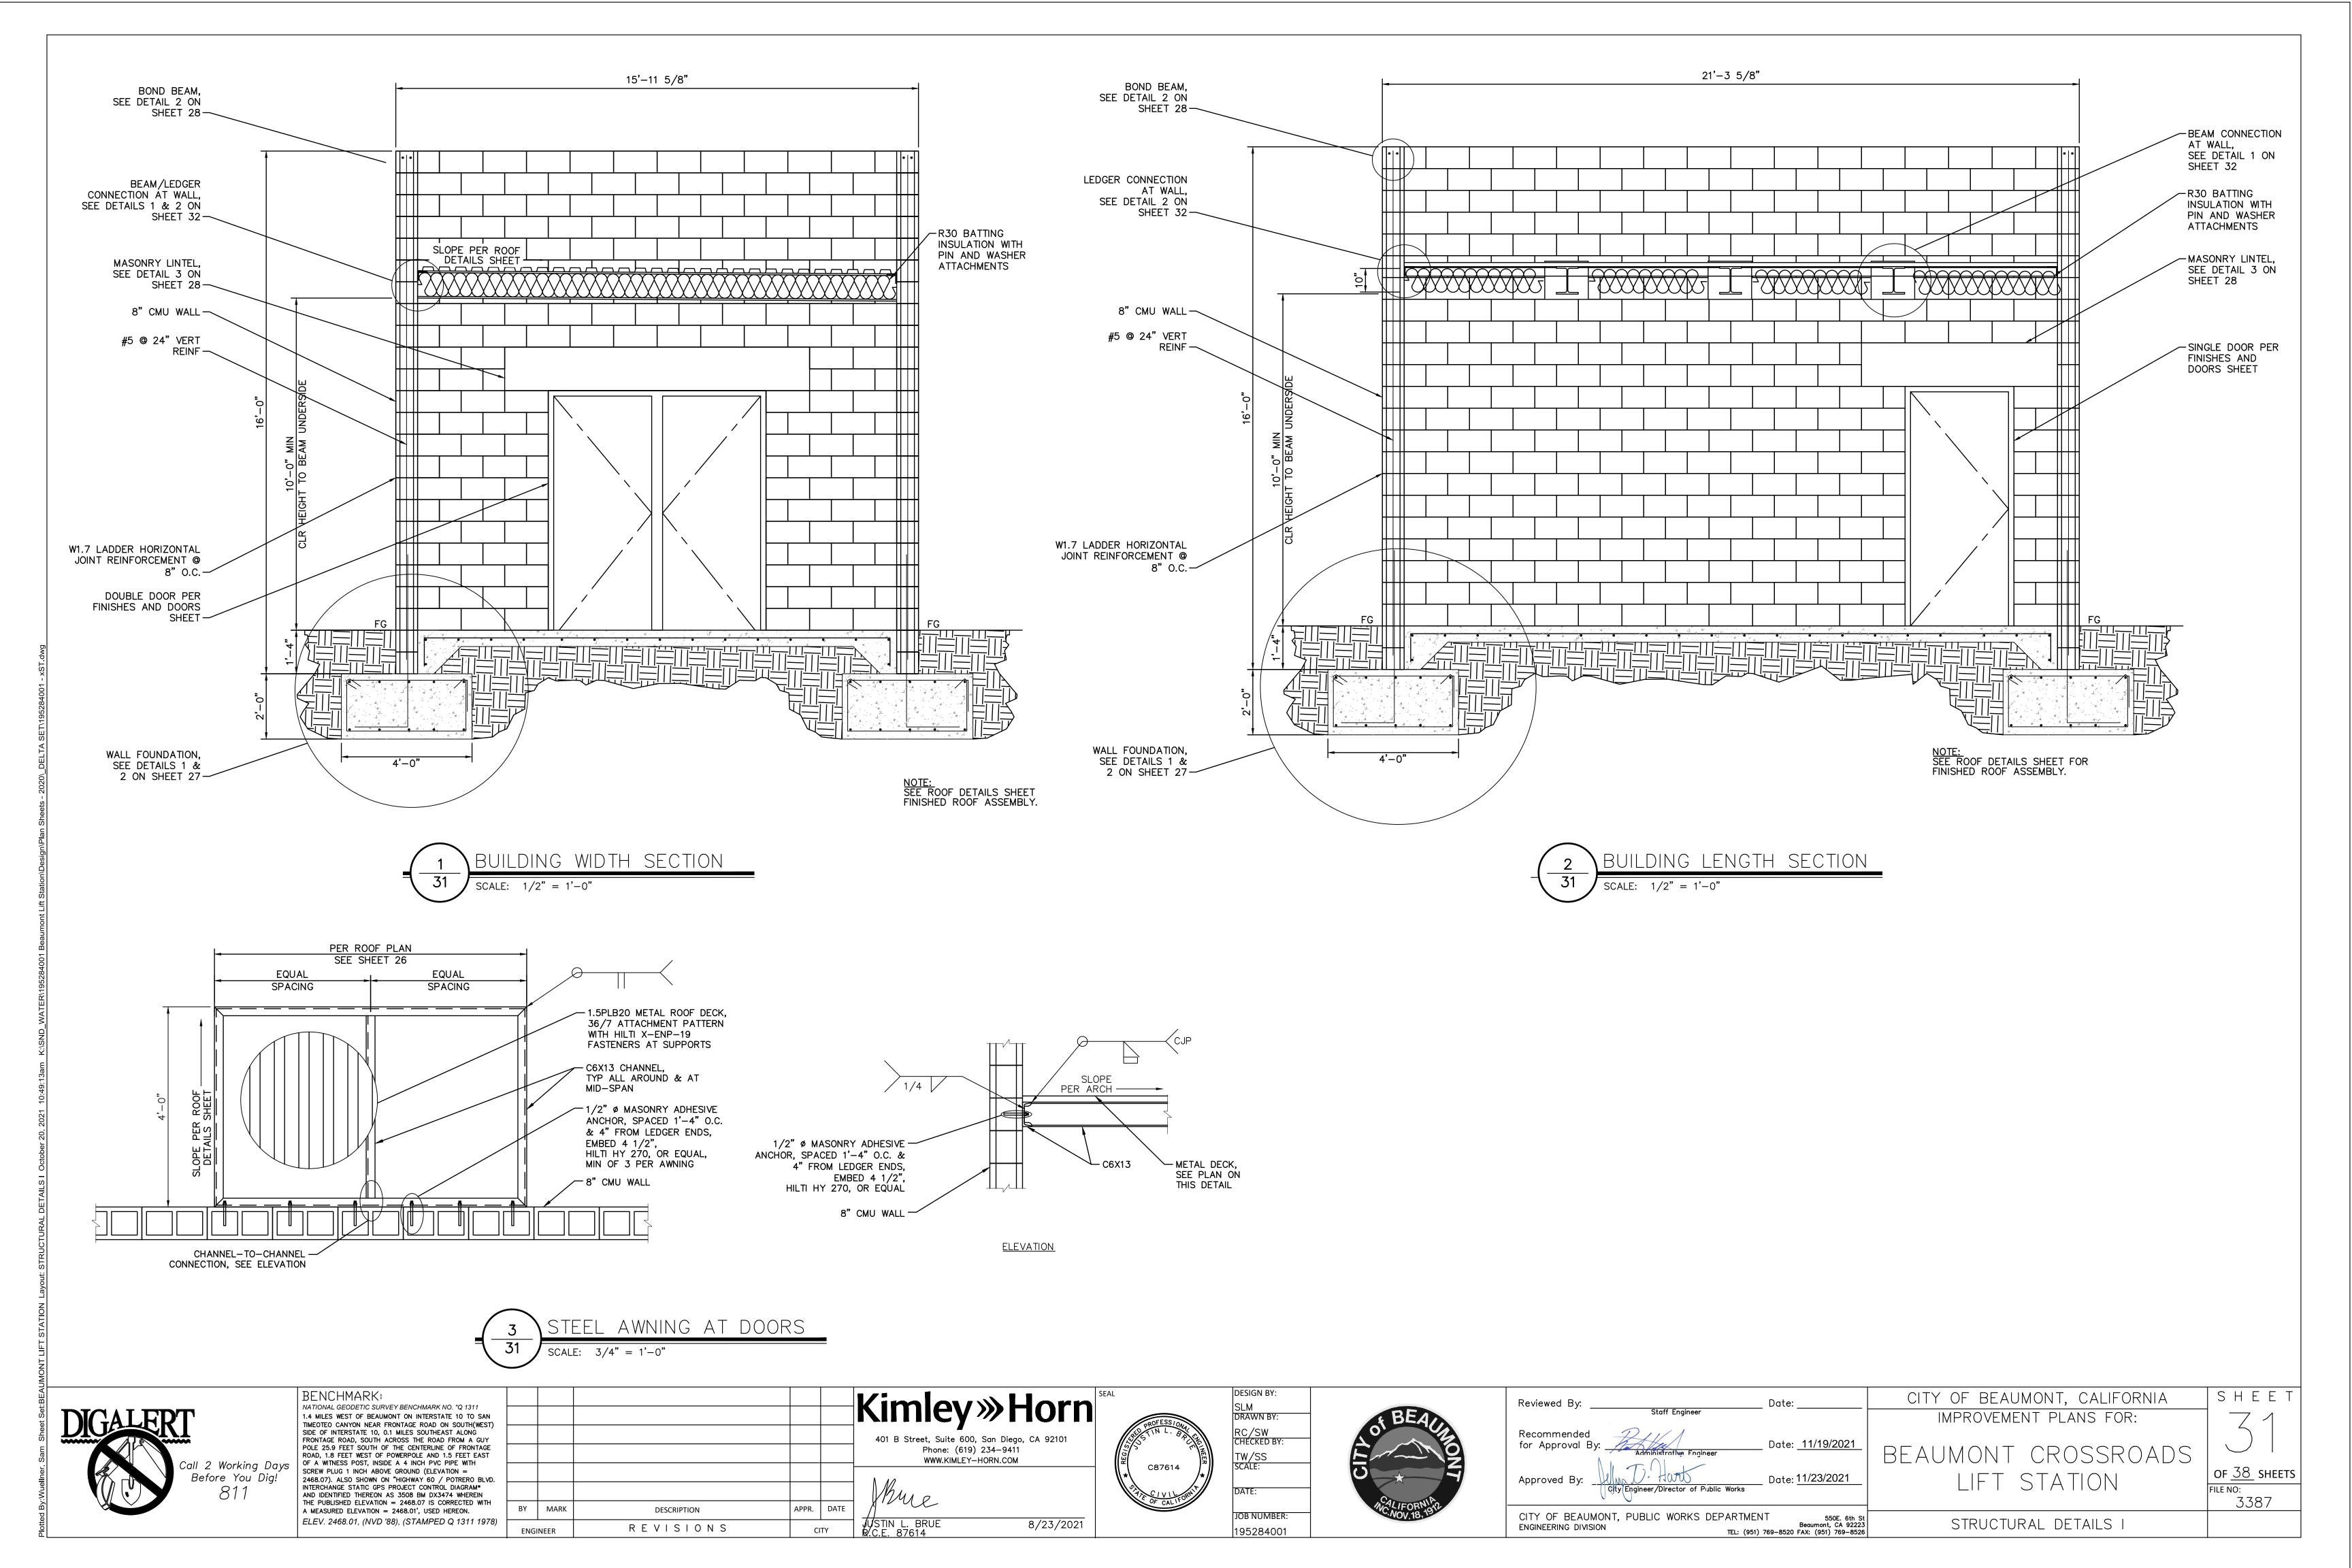


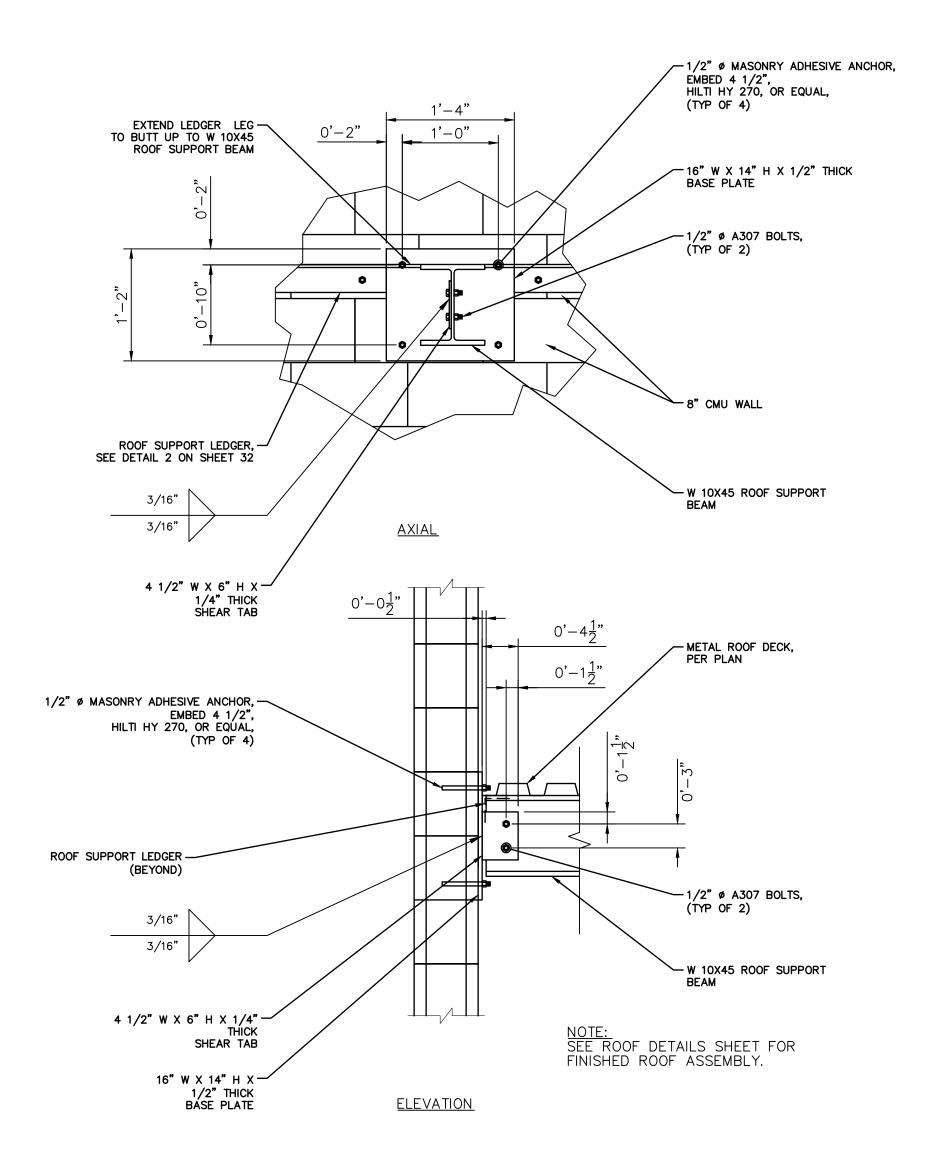



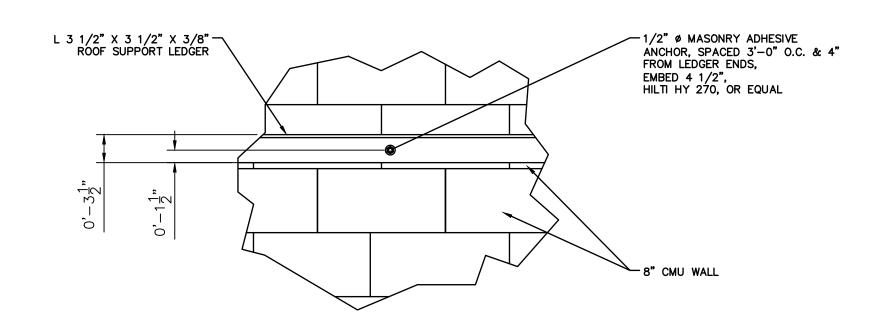

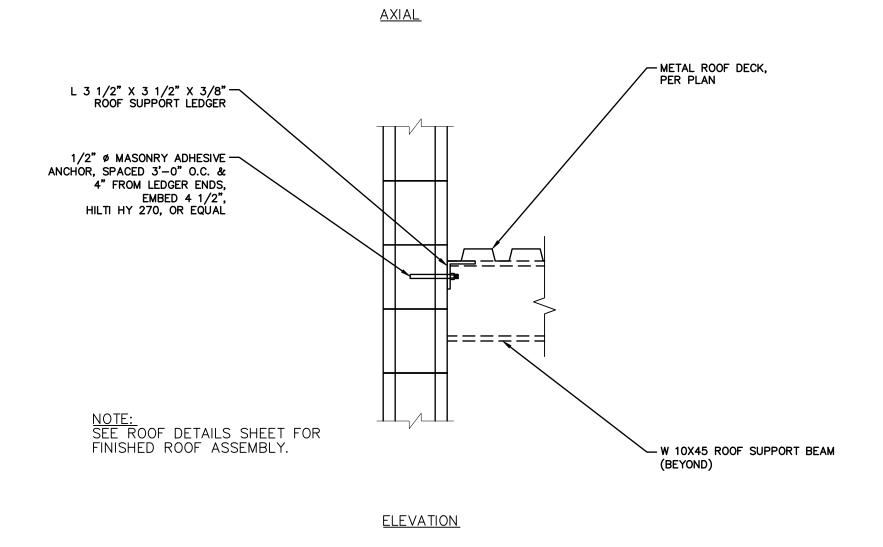








BENCHMARK:
NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST)
SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

Kimley» Horn 401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234—9411 WWW.KIMLEY-HORN.COM APPR. DATE BY MARK DESCRIPTION REVISIONS



8/23/2021

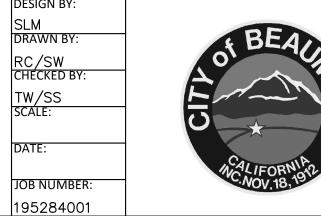


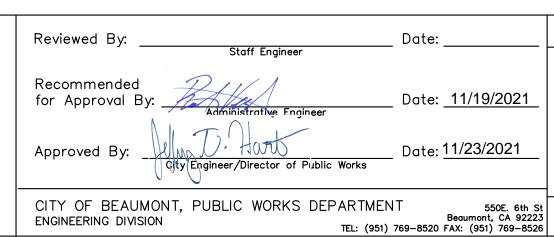



CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

STRUCTURAL DETAILS II


ог <u>38</u> sheets 3387

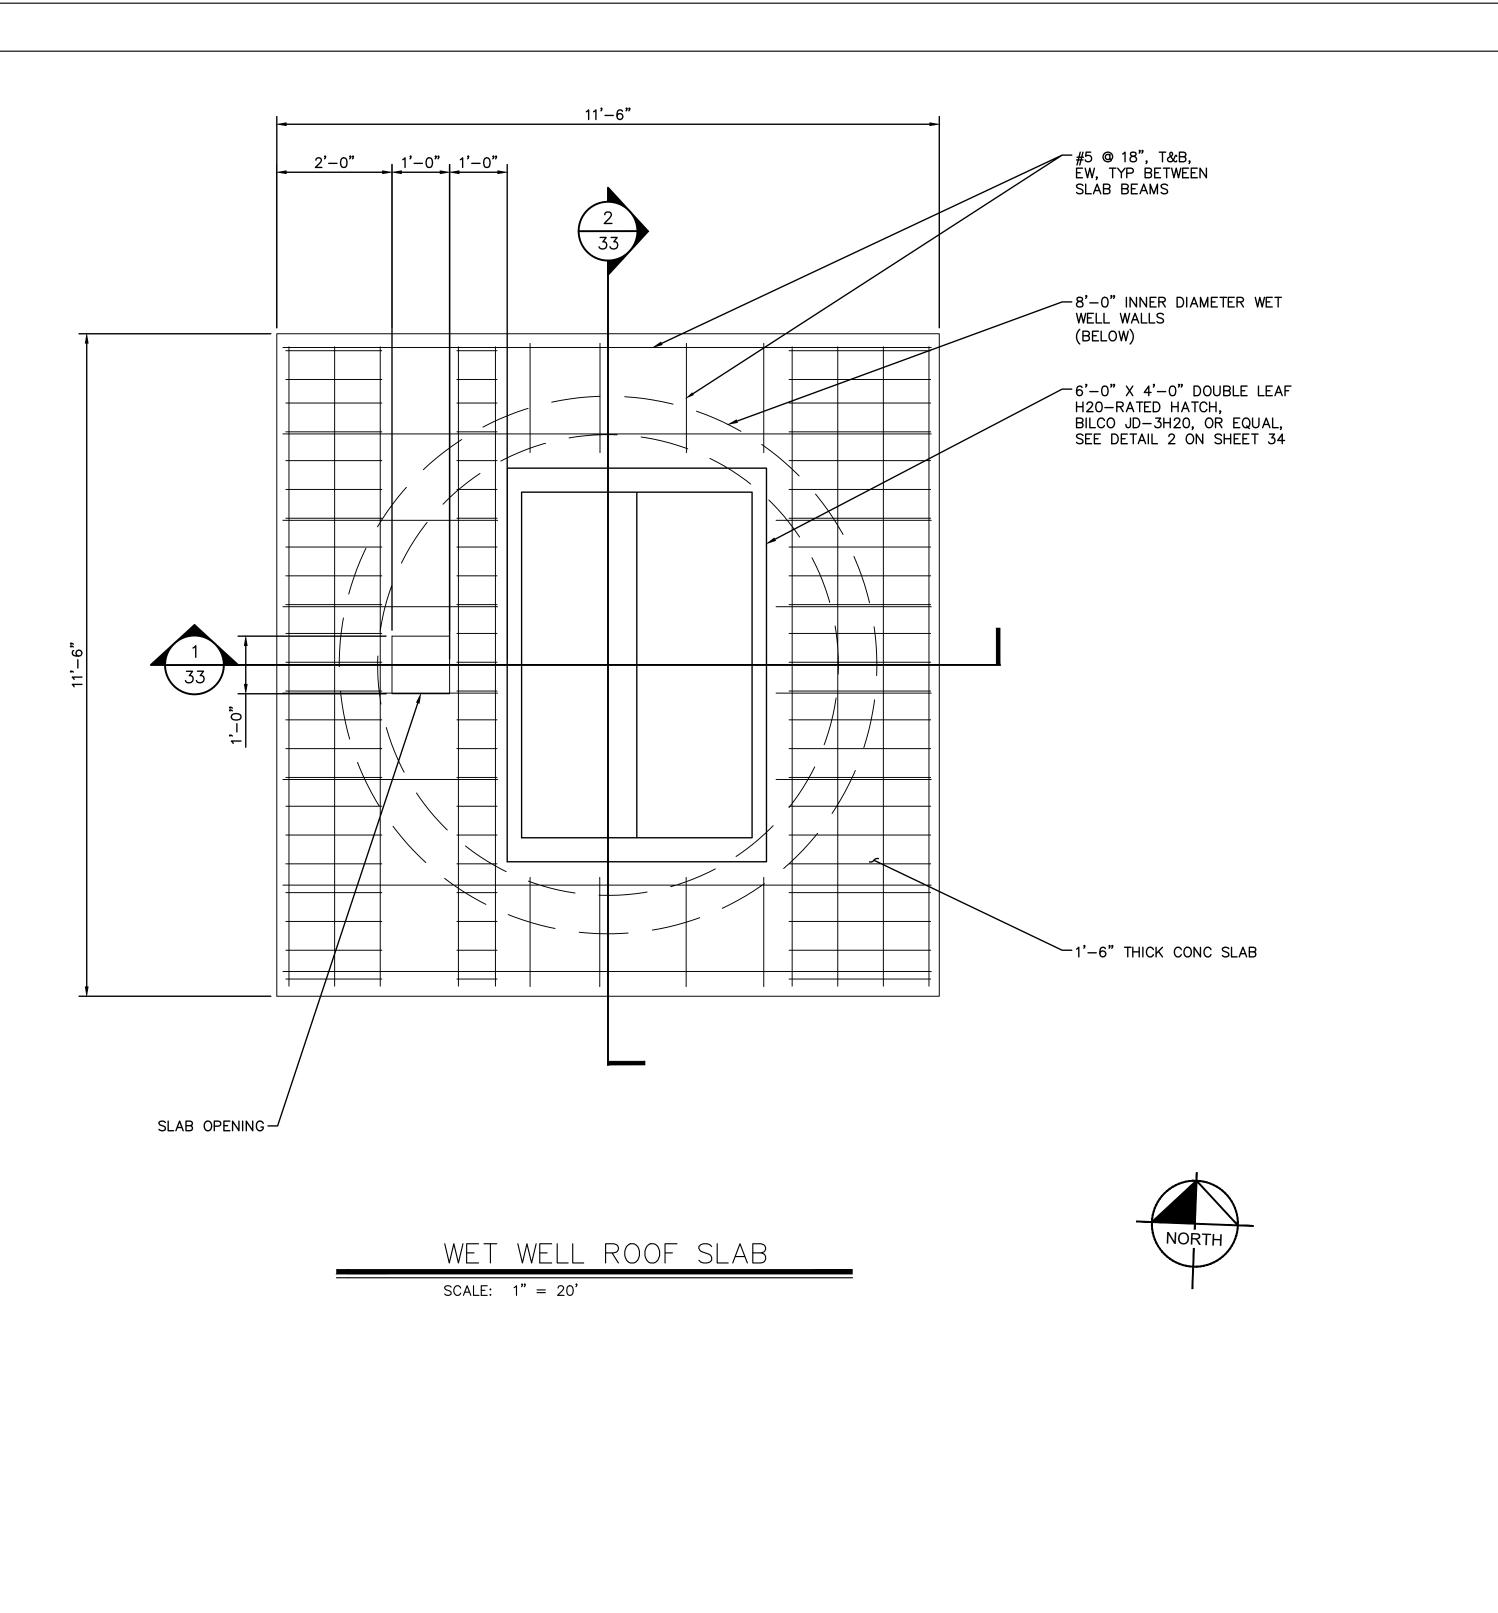

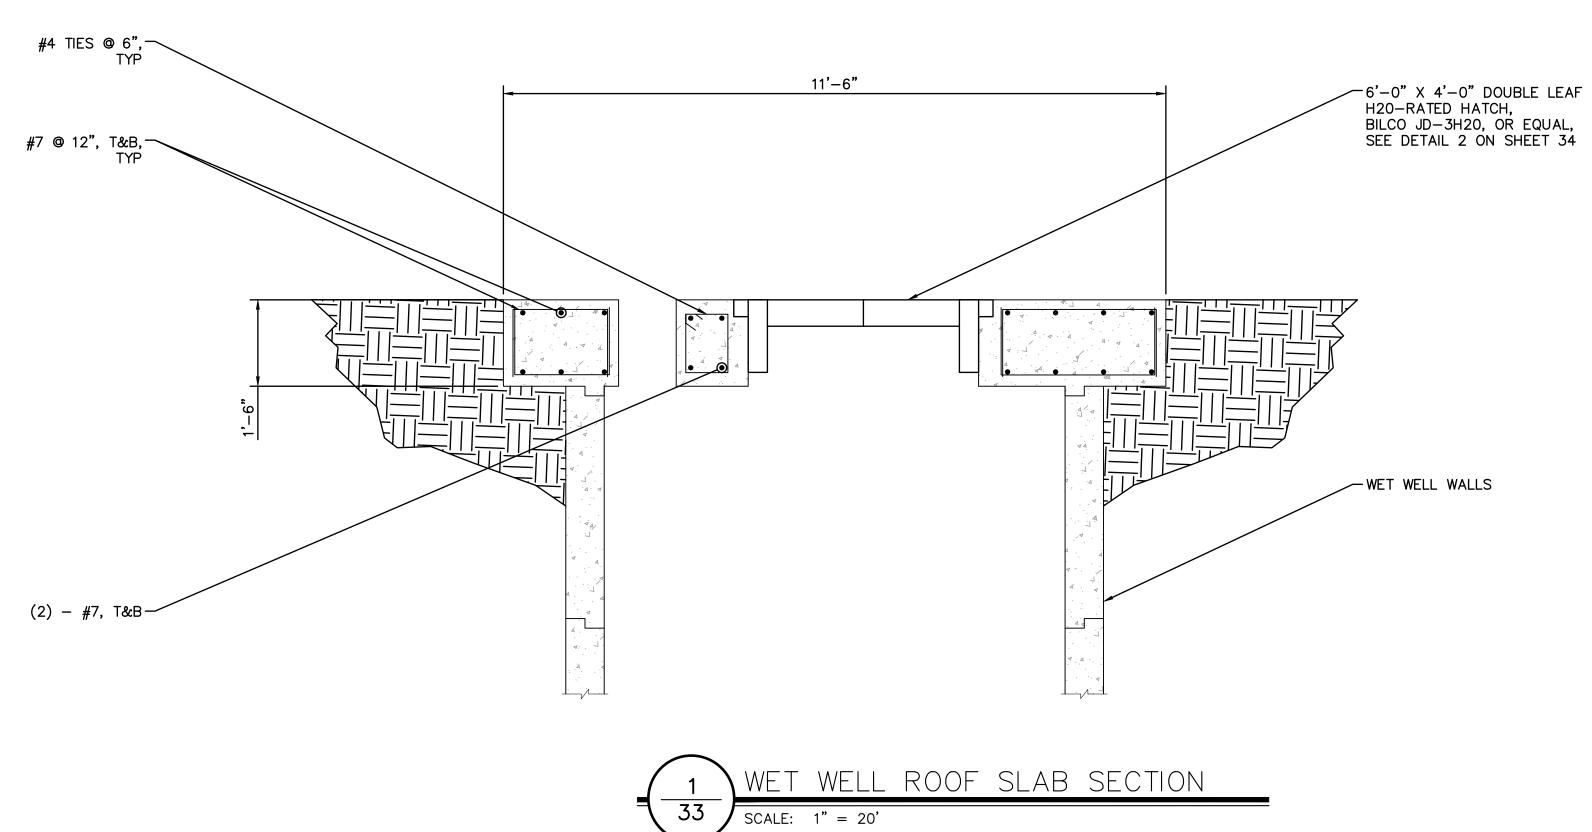

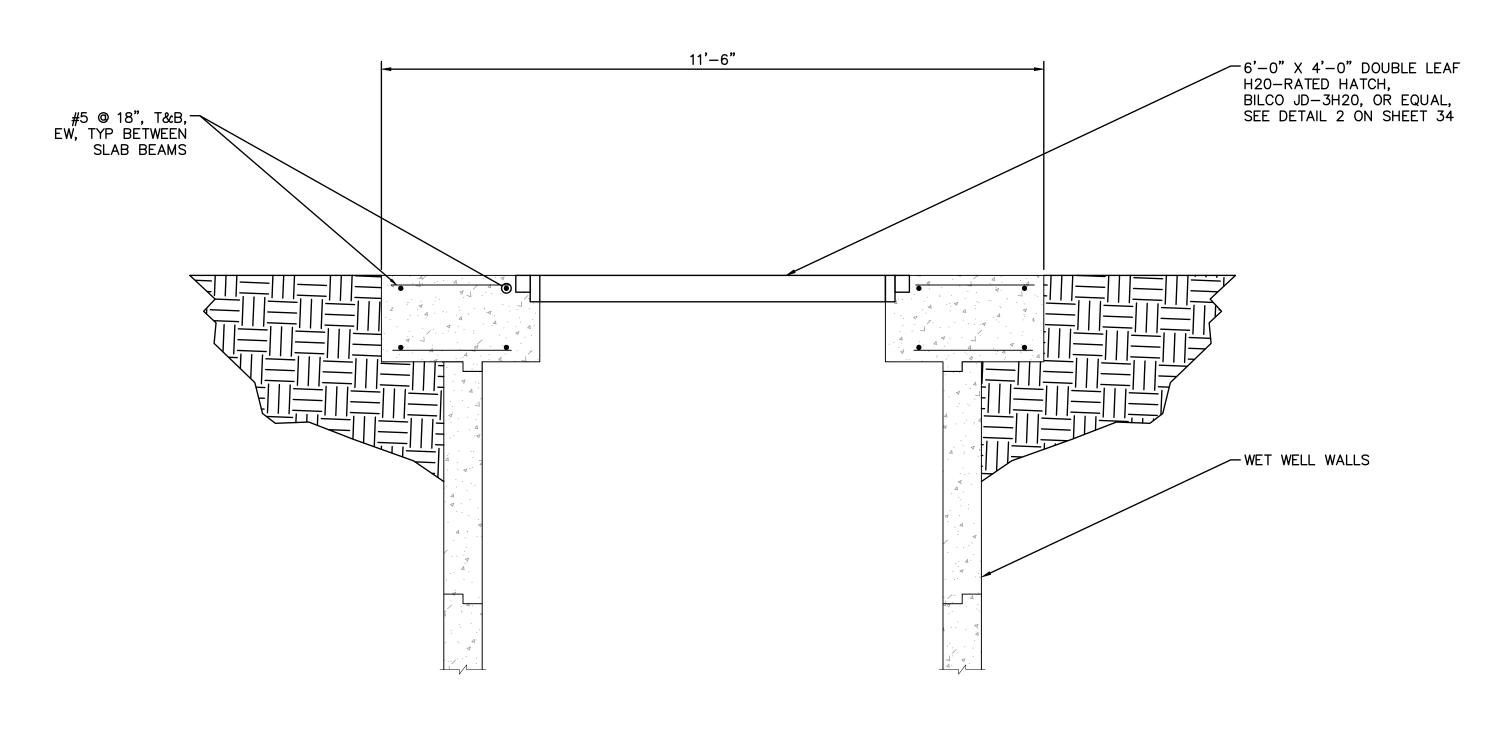


WET WELL ROOF SLAB SECTION

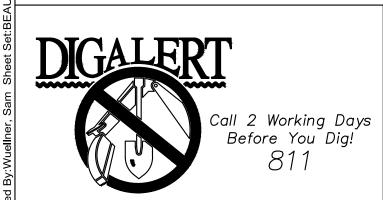


BENCHMARK:
NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

Kimley» Horn seal 401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234—9411 WWW.KIMLEY-HORN.COM APPR. DATE BY MARK DESCRIPTION REVISIONS




8/23/2021

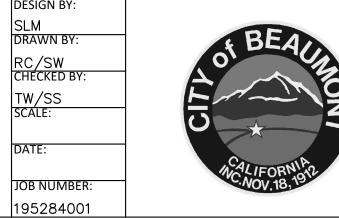


Reviewed By: Staff Engineer	_ Date:	
Stan Engineer		
Recommended for Approval By: Administrative Engineer	_ Date: <u>11/19/2021</u>	Ę
Approved By: City Engineer/Director of Public Works	Date: <u>11/23/2021</u>	L
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	550E. 6th St Beaumont, CA 92223 769–8520 FAX: (951) 769–8526	

CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS of 38 sheets LIFT STATION

WET WELL SLAB

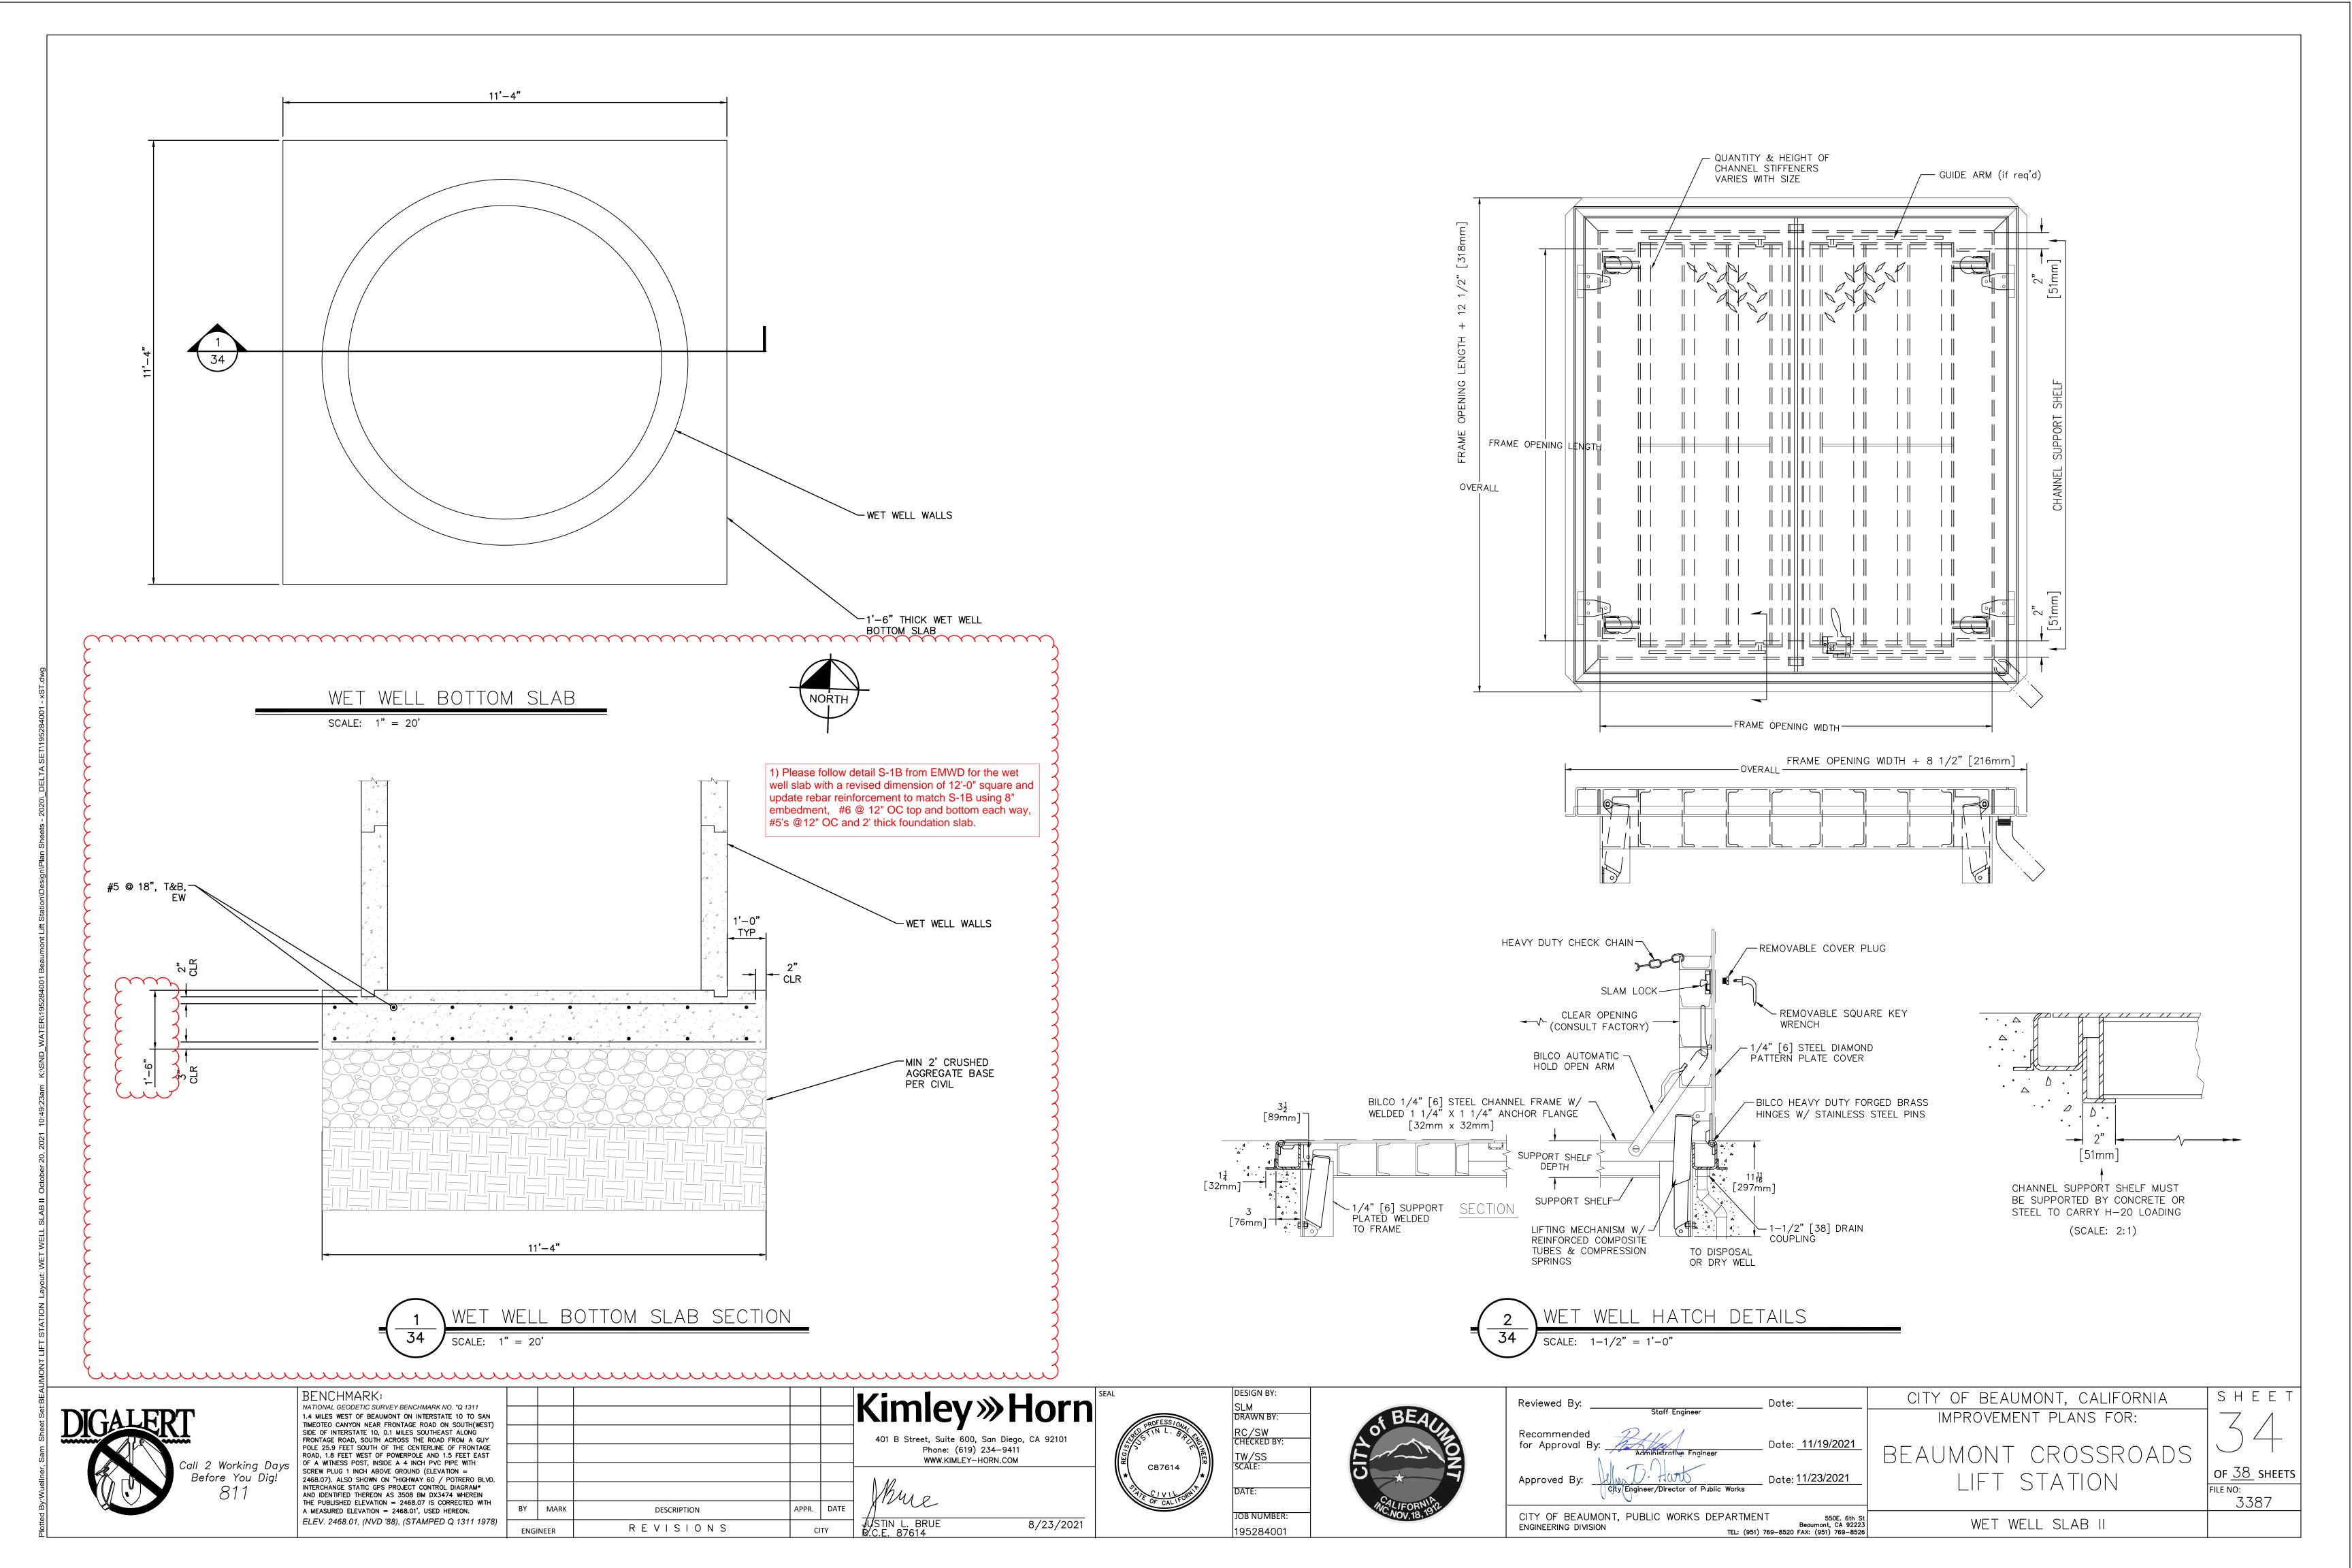

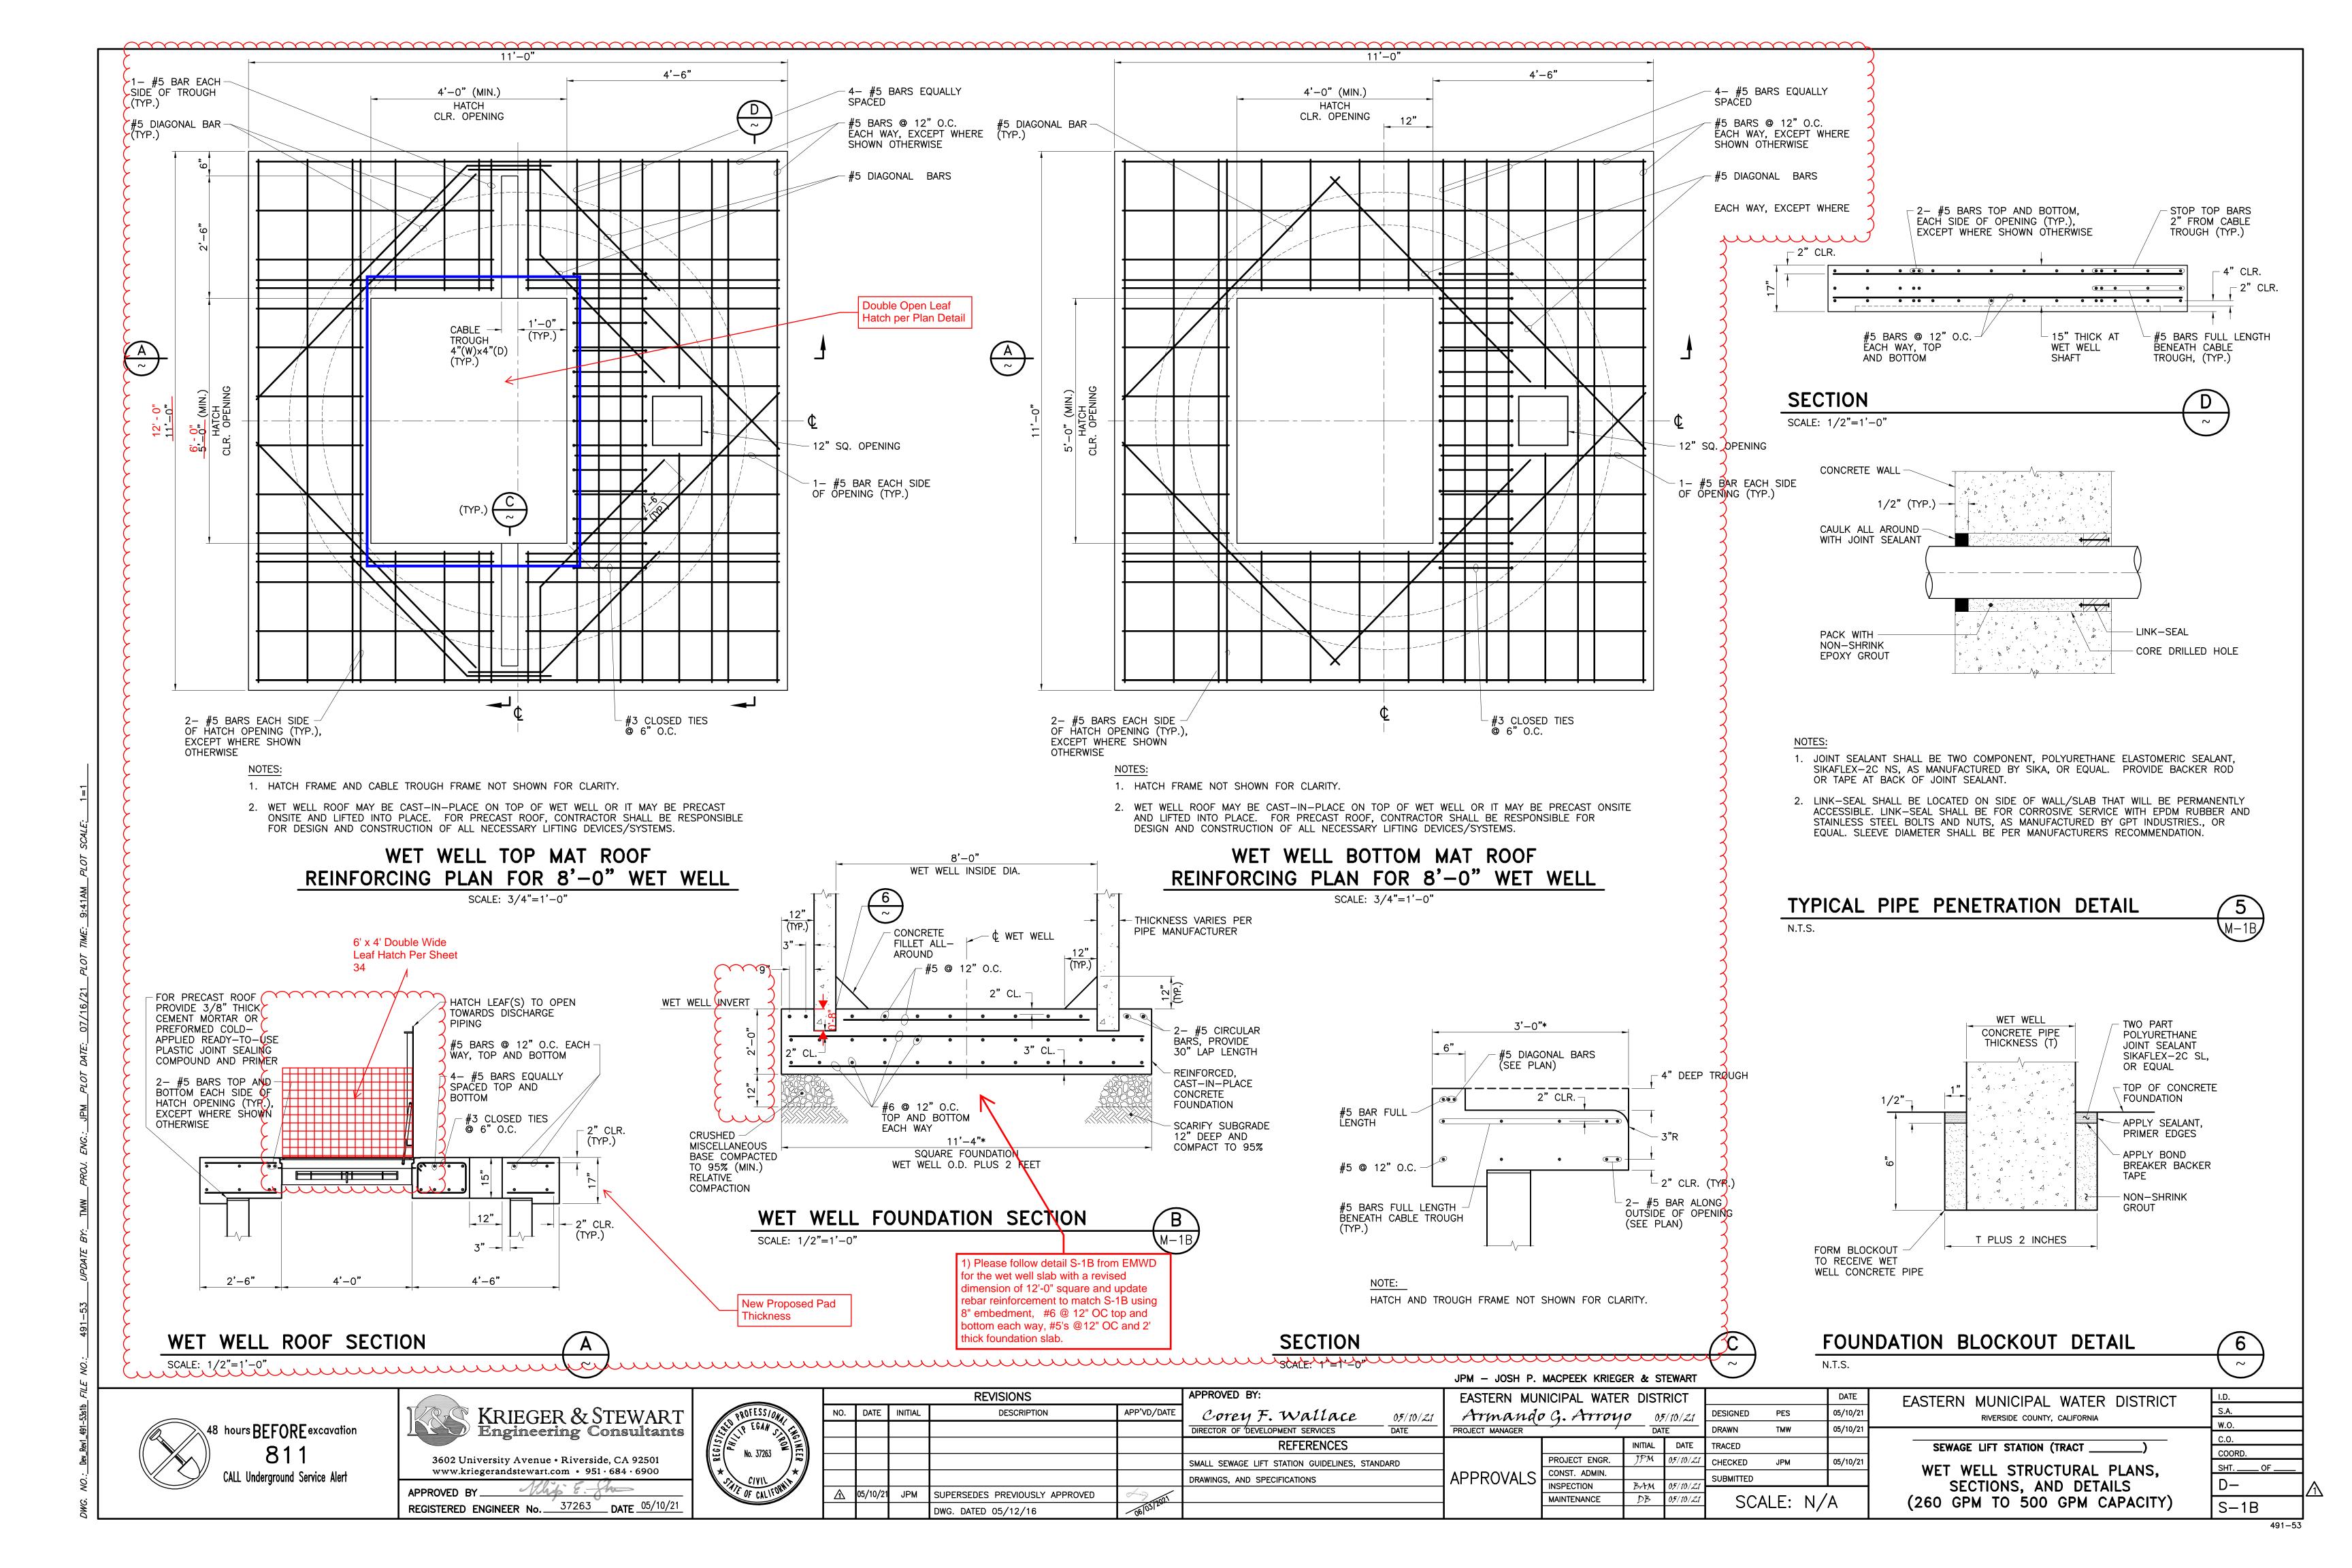

A. GENERAL

- THE INFORMATION INDICATED ON THESE DRAWINGS AS EXISTING IS BASED UPON INFORMATION TAKEN FROM AS-BUILT DRAWINGS, AND FIELD INVESTIGATION. THE PLANS DO NOT GUARANTEE ACCURACY BUT ARE ONLY AN INDICATION OF EXISTING CONDITIONS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY EXACT CONDITIONS SUCH AS EQUIPMENT PLACEMENT, DUCTWORK (SIZE, ROUTING, AND ELEVATION), PIPING (SIZE, ROUTING, AND ELEVATION), ETC. THE DRAWINGS ARE INTENDED TO PROVIDE THE CONTRACTOR AN INDICATION OF THE SYSTEM INSTALLED IN THE FACILITY TO DATE. IT WILL BE THE CONTRACTOR'S RESPONSIBILITY TO MAKE ADJUSTMENTS TO THE DRAWING INFORMATION AS REQUIRED TO MATCH EXISTING FIELD CONDITIONS.
- 2. THE CONTRACTOR SHALL INSTALL THE NEW EQUIPMENT, ROOF CURB, AND PIPING AROUND ALL EXISTING OBSTACLES INCLUDING: ELECTRICAL CONDUIT, DOMESTIC WATER PIPING, WASTE AND VENT PIPING, ACID WASTE AND VENT PIPING, AND FIRE SPRINKLER PIPING. PROVIDE OFFSETS TO AVOID RELOCATION OF OTHER UTILITIES. RELOCATE UTILITIES IF THEY ARE IN CONFLICT WITH THE MECHANICAL SYSTEM INSTALLATION, CAUSE DEVIATIONS IN THE DESIGN INTENT, UNSATISFACTORY OPERATION, NOISY CONDITIONS, OR INTERFERE WITH MAINTENANCE. IT IS THE MECHANICAL CONTRACTOR'S RESPONSIBILITY TO COORDINATE ANY UTILITY RELOCATION WITH THE APPROPRIATE SUBCONTRACTOR.
- PROVIDE ALL NECESSARY LABOR, MATERIALS, EQUIPMENT, SERVICES AND INSURANCES TO COMPLETE THE HEATING AND AIR CONDITIONING WORK WITHIN THE FULL INTENT OF THE DRAWINGS AND SPECIFICATIONS CONTAINED HEREON AND TO THE ENTIRE SATISFACTION OF THE ENGINEER.
- 4. PROVIDE ALL PERMITS AND FEES AS REQUIRED FOR THE MECHANICAL WORK.
- 5. CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH THE PROJECT BEFORE BIDDING.
- ALL WORK SHALL BE IN ACCORDANCE WITH THE 2018 INTERNATIONAL BUILDING CODE (IBC), 2018 INTERNATIONAL ENERGY CONSERVATION CODE (IECC), 2018 INTERNATIONAL FIRE CODE (IFC), 2018 UNIFORM MECHANICAL CODE (UMC), 2018 UNIFORM PLUMBING CODE (UPC), 2017 NATIONAL ELECTRICAL CODE (NEC), NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS, AND ALL OTHER APPLICABLE CODES, RULES, AND LOCAL REQUIREMENTS.
- GUARANTEE ALL WORK AND MATERIALS FOR A PERIOD OF ONE YEAR.
- ALL DIMENSIONS AND MEASUREMENTS SHALL BE VERIFIED AT THE JOBSITE BEFORE FABRICATION AND/OR INSTALLATION OF THE EQUIPMENT.
- PROVIDE AND INSTALL ALL EQUIPMENT, PIPING, AND CONTROLS AS SHOWN ON THE DRAWINGS.

B. SUBMITTALS

- ELECTRONIC SUBMITTALS IN A PDF FORMAT, IN LIEU OF PAPER COPIES, WILL BE ACCEPTABLE.
- SUBSTITUTED ITEMS SHALL BE SUBMITTED WITH MANUFACTURER'S DESCRIPTIVE DATA AND MUST SHOW EQUALITY TO EQUIPMENT SPECIFIED. INFORMATION ON SUBSTITUTED ITEMS MUST BE COMPLETE, INCLUDING, BUT NOT LIMITED TO: DESIGN, CONSTRUCTION MATERIALS, CONSTRUCTION QUALITY, AND SOUND LEVELS. ENGINEER WILL NOT RESEARCH INFORMATION REQUIRED TO COMPARE EQUIPMENT. ENGINEER RESERVES THE RIGHT TO REQUIRE SPECIFIED EQUIPMENT.
- SUBMIT MANUFACTURER'S DESCRIPTIVE DATA WITHIN TEN (10) WORKING DAYS AFTER AWARD OF THE CONTRACT. MATERIALS AND EQUIPMENT SHALL NOT BE ORDERED PRIOR TO SUBMITTAL APPROVAL. ALLOW TEN (10) WORKING DAYS AFTER RECEIPT OF SUBMITTALS IN THE ENGINEER'S OFFICE BEFORE REVIEWED SUBMITTALS WILL BE RETURNED.
- 4. UPON COMPLETION OF THE PROJECT, AND PRIOR TO FINAL ACCEPTANCE PAYMENT, SUBMIT AS-BUILT DRAWINGS AND OPERATING AND MAINTENANCE INSTRUCTIONS.

C. WORKMANSHIP

- 1. ALL WORK TO BE PERFORMED BY QUALIFIED PERSONNEL NORMALLY ENGAGED IN THE RESPECTIVE LINE OF WORK.
- 2. PERFORM ALL WORK IN A MANNER NOT TO DISTURB THE NORMAL OPERATION OF THE BUILDING.
- 3. COORDINATE ALL WORK WITH THE OWNER'S REPRESENTATIVE.
- 4. COORDINATE ALL WORK WITH THE OTHER TRADES.
- 5. THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR PERFORMING ALL WORK ACCEPTABLE TO THE OWNER'S REPRESENTATIVE.

D. DEMOLITION

1. DEMOLITION WORK SHALL NOT CREATE ANY DUST PROBLEMS IN THE WORKING SPACES.

E. CUTTING, PATCHING, AND PAINTING

- ALL CUTTING AND PATCHING TO BE PERFORMED BY THE GENERAL CONTRACTOR.
- 2. CUTTING OF ALL OPENINGS SHALL BE COORDINATED WITH THE OWNER'S ENGINEERING REPRESENTATIVE.
- 3. WALL SURFACES SHALL BE PRIMED AND PAINTED. PAINT TYPE AND COLOR SHALL BE AS SPECIFIED BY THE OWNER'S REPRESENTATIVE.

F. PRODUCT HANDLING

- 1. USE ALL MEANS NECESSARY TO PROTECT ALL MATERIALS AND EQUIPMENT BEFORE, DURING, AND AFTER INSTALLATION AND TO PROTECT THE MATERIALS AND WORK OF THE OTHER TRADES.
- 2. IN THE EVENT OF DAMAGE, IMMEDIATELY MAKE ALL REPAIRS AND REPLACEMENTS NECESSARY TO THE APPROVAL OF THE ENGINEER AND AT NO ADDITIONAL COST TO THE

G. SEISMIC RESTRAINTS

- 1. ALL EQUIPMENT, PIPING, AND CONDUIT SHALL BE SEISMICALLY RESTRAINED PER THE 2018
- REFERENCES: INTERNATIONAL BUILDING CODE (IBC) SECTION 1613.1, AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE 7) SECTION 13.6, SHEET METAL AND AIR CONDITIONING CONTRACTOR'S NATIONAL ASSOCIATION (SMACNA) SEISMIC RESTRAINT MANUAL, AND AMERICAN SOCIETY OF PLUMBING ENGINEERS (ASPE) PLUMBING ENGINEERING DESIGN HANDBOOK.

H. EQUIPMENT

- EQUIPMENT SHALL BE AS SPECIFIED IN THE EQUIPMENT SCHEDULE OR AN APPROVED EQUAL IF NOTED.
- 2. INSTALL EQUIPMENT PER MANUFACTURER'S INSTRUCTIONS.
- CONTRACTOR SHALL PROVIDE ALL PENETRATION OPENINGS IN ROOF FOR ALL PIPING AND CONDUIT REQUIREMENTS.
- 4. ALL UNITS ON ROOF SHALL BE SET ON LEVEL CURBS OR SUPPORTS AT ROOF.
- SECURELY FASTEN ALL EQUIPMENT TO PREVENT MOVEMENT DUE TO WIND OR SEISMIC FORCES.

N. PIPING

EQUIPMENT DRAIN PIPING TO BE TYPE 'M' HARD DRAWN COPPER WITH WROT COPPER FITTINGS. USE 95/5 SOLDER. SLOPE PIPING 1/8" PER FOOT TOWARDS DRAIN.

T. REFRIGERANT PIPING

- REFRIGERANT PIPING SHALL BE ACR COPPER. LINESET INSULATION TO BE INCLUDED BY MANUFACTURER.
- 2. ALL JOINTS SHALL BE BRAZED WITH SIL-FOS OR EQUAL UNDER A NITROGEN PURGE.
- CHARGING OF SYSTEM: TEST ALL REFRIGERANT PIPING WITH 150 PSI CHARGE OF NITROGEN AFTER FIRST ISOLATING ANY CONTROLS, ETC., THAT ARE NOT RATED FOR 150 PSI. TEST ALL JOINTS WITH A SOAP SOLUTION. EVACUATE SYSTEM AND CHARGE SYSTEM WITH REFRIGERANT. RETEST SYSTEM WITH AN ELECTRONIC GAS DETECTOR. MAKE ALL FINAL ADJUSTMENTS TO REFRIGERANT SYSTEM AS REQUIRED.
- AFTER SYSTEM HAS BEEN LEAK TESTED AND CHARGED, INSULATE ALL SUCTION PIPING WITH RUBATEX R-180 FS OR EQUAL 1/2" THICK CLOSED CELL FOAM INSULATION MEETING ALL NFPA REQUIREMENTS FOR SMOKE DENSITY AND FLAME SPREAD.
- 5. ALL OUTDOOR SECTIONS SHALL BE COATED WITH AN ULTRAVIOLET AND WEATHER RESISTIVE COATING.

U. OTHER MATERIAL

ALL OTHER MATERIAL, NOT SPECIFICALLY DESCRIBED BUT REQUIRED FOR A COMPLETE JOB, SHALL BE NEW AND FIRST QUALITY. FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR.

W. IDENTIFICATION

1. PLASTIC NAMEPLATES: LAMINATED THREE LAYER WITH ENGRAVED BLACK LETTERS ON A LIGHT CONTRASTING BACKGROUND COLOR. INSTALL PLASTIC NAMEPLATES WITH CORROSION RESISTANT MECHANICAL FASTENERS OR ADHESIVE.

Y. RELATED WORK

ELECTRICAL CONTRACTOR TO PROVIDE AND INSTALL ALL POWER WIRING AND EQUIPMENT DISCONNECTS, UNLESS INCLUDED WITH EQUIPMENT, TO MAKE SYSTEM OPERATIONAL.

Z. CONTROLS

1. THERMOSTATS TO BE FURNISHED AND INSTALLED BY HVAC CONTRACTOR.

MECHANICAL SYMBOL LIST

(NOTE: ALL OF THE SYMBOLS INDICATED BELOW MAY NOT APPEAR ON THIS PROJECT)

	RL	REFRIGERANT LIQUID PIPING	CLG	CEILING
	RS	REFRIGERANT SUCTION PIPING	DB	DRY BULB TEMPERATURE
——————————————————————————————————————	U	UNION	DDC	DIRECT DIGITAL CONTROL
	P.D.	PIPING TEE DOWN	DL	DOOR LOUVER
	P.U.	PIPING TEE UP	DN	DOWN
	P.U.	PIPING ELBOW UP	(E)	EXISTING
	P.D.	PIPING ELBOW DOWN	EAT	ENTERING AIR TEMPERATURE
<u> </u>		BRANCH - TOP CONNECTION	EDB	ENTERING DRY BULB
<u></u>		BRANCH - BOTTOM CONNECTION	°F	DEGREES FARENHEIT
OR		ARROW INDICATES DIRECTION OF FLOW	F.A.	FROM ABOVE
	P.O.C.	POINT OF CONNECTION - NEW ITEMS TO EXISTING ITEMS	F.B.	FROM BELOW
	S.A.	SUPPLY AIR DUCT DOWN	FT.	FEET
	S.A.	SUPPLY AIR DUCT UP	LAT	LEAVING AIR TEMPERATURE
	R.A.	RETURN AIR DUCT DOWN	HVAC	HEATING, VENTILATION, AND AIR CONDITIONING
	R.A.	RETURN AIR DUCT UP	MAX	MAXIMUM
	E.A.	EXHAUST AIR DUCT DOWN	MBH	BRITISH THERMAL UNITS PER HOUR (THOUSANDS)
	E.A.	EXHAUST AIR DUCT UP	MIN	MINIMUM
	S.A.D.	SUPPLY AIR DIFFUSER WITH FLEX CONNECTION	(N)	NEW
	R.A.G.	RETURN AIR GRILLE OPEN TO CEILING SPACE	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
EQ #		MECHANICAL EQUIPMENT INDICATED (SEE SCHEDULE)	RL/RS	REFRIGERANT LIQUID LINE / REFRIGERANT SUCTION
(T)	T.	THERMOSTAT	S.E.E.R.	SEASONAL ENERGY EFFICIENCY RATIO
R	R.	ROOM TEMPERATURE SENSOR	SP	STATIC PRESSURE
	ACR	AIR CONDITIONING AND REFRIGERATION	STD	STANDARD
	AFF	ABOVE FINISHED FLOOR	Т	TEMPERATURE
	AFG	ABOVE FINISHED GRADE	T.A.	TO ABOVE
	BDD	BACKDRAFT DAMPER	T.B.	TO BELOW
	BTUH	BRITISH THERMAL UNITS PER HOUR	TYP	TYPICAL
	CFM	CUBIC FEET PER MINUTE	WB	WET BULB TEMPERATURE

SPLIT SYSTEM SCHEDULE																				
		OL	JTDOOR UNIT						/F 0\		INDOOR UNI	Т		COOLING CAPACITY	HEATING CAPACITY					
MANUFACTURER	MODEL		MODEL	AMBIENT DESIGN	OPERATING	SEER	HSPF	ELECTRICAL -			-	MANUFACTURER	MODEL	AIRFLOW	OPERATING	TOTAL CAPACITY	TOTAL CAPACITY	ELEC	TRICAL	
		(°F DB/WB)	WEIGHT (LBS)			VOLTS/Ø/Hz	MCA	MOCP				(CFM)	WEIGHT (LDS)	(MAX MBH)	(MAX MBH)	VOLTS/Ø/Hz	MCA	MOCP		
TRANE	4TWA4	104/70	248	15	-	208/3/60	21	35	1	TRANE	TAM9A	1925	163	50.8	42	208/1/60	8	15		
	MANUFACTURER TRANE		MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB)	MANUFACTURER MODEL DESIGN WEIGHT (LBS)	MANUFACTURER MODEL AMBIENT OPERATING WEIGHT (LBS) SEER	MANUFACTURER MODEL AMBIENT OPERATING WEIGHT (LBS) SEER HSPF	MANUFACTURER MODEL AMBIENT OPERATING WEIGHT (LBS) SEER HSPF VOLTS/Ø/Hz	OUTDOOR UNIT MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) SEER HSPF VOLTS/Ø/Hz MCA	MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) SEER HSPF VOLTS/Ø/Hz MCA MOCP	OUTDOOR UNIT MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) SEER HSPF ELECTRICAL VOLTS/Ø/Hz MCA MOCP	OUTDOOR UNIT MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) SEER HSPF VOLTS/Ø/Hz MCA MOCP FC MANUFACTURER	MANUFACTURER MODEL SEER HSPF SEER HSPF SEER SEER	OUTDOOR UNIT MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) SEER HSPF VOLTS/Ø/Hz MCA MOCP INDOOR UNIT FC MANUFACTURER MODEL INDOOR UNIT AIRFLOW (CFM)	$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	OUTDOOR UNIT MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) SEER HSPF ELECTRICAL VOLTS/Ø/Hz MCA MOCP TOTAL CAPACITY WOLTS/Ø/Hz MODEL INDOOR UNIT AIRFLOW OPERATING WEIGHT (LBS) OPERATING WEIGHT (LBS) WEIGHT (LBS) TOTAL CAPACITY (MAX MBH)	OUTDOOR UNIT MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) SEER HSPF OPERATING WEIGHT (LBS) SEER HSPF OVERATION WORD OPERATING WEIGHT (LBS) NOOE MANUFACTURER MODEL INDOOR UNIT FC MANUFACTURER MODEL AIRFLOW (CFM) OPERATING WEIGHT (LBS) TOTAL CAPACITY (MAX MBH) TOTAL CAPACITY (MAX MBH)	OUTDOOR UNIT MANUFACTURER MODEL SEER HSPF WEIGHT (LBS) OPERATING WEIGHT (LBS) VOLTS/Ø/Hz MCA MCA MCA MCA MCA MCA MCA MC	OUTDOOR UNIT MANUFACTURER MODEL AMBIENT DESIGN (°F DB/WB) OPERATING WEIGHT (LBS) OPERATING WEIGHT (LBS) SEER HSPF MCA MCA MCA MCA MCA MCA MCA MC		

GENERAL NOTES:

- ALL CAPACITIES LISTED ARE AT 0 FEET ELEVATION
- PROVIDE AND INSTALL MANUFACTURER'S REFRIGERANT LINESET SET FAN SPEED TO MEDIUM

STANDARD FEATURES:


- 1. REFRIGERANT SHALL BE R-410A INVERTER VARIABLE SPEED COMPRESSOR
- 3. MINIMUM LINE LENGTH OF 9.8 FEET, MAX LINE LENGTH OF 49.2 FEET WITH NO ADDITIONAL REFRIGERANT REQUIRED, AND MAX ELEVATION OF 23 FEET

PROVIDE AND INSTALL MANUFACTURER'S PROGRAMMABLE T-STAT

Kimley» Horn


BY MARK

33152 Exp. 6/30/23



195284001



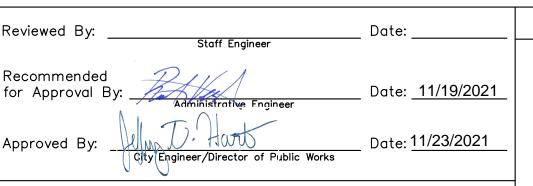

IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

CITY OF BEAUMONT, CALIFORNIA

SHEE of <u>38</u> sheets 3387

Call 2 Working Days Before You Dig!

|BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN HE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON.

ELEV. 2468.01. (NVD '88). (STAMPED Q 1311 1978


HILLY DATE DESCRIPTION REVISIONS

Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM 8/23/2021

ENGINEERING DIVISION


CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT 550E. 6th St Beaumont, CA 92223 TEL: (951) 769-8520 FAX: (951) 769-8526

MECHANICAL NOTES AND SCHEDULES

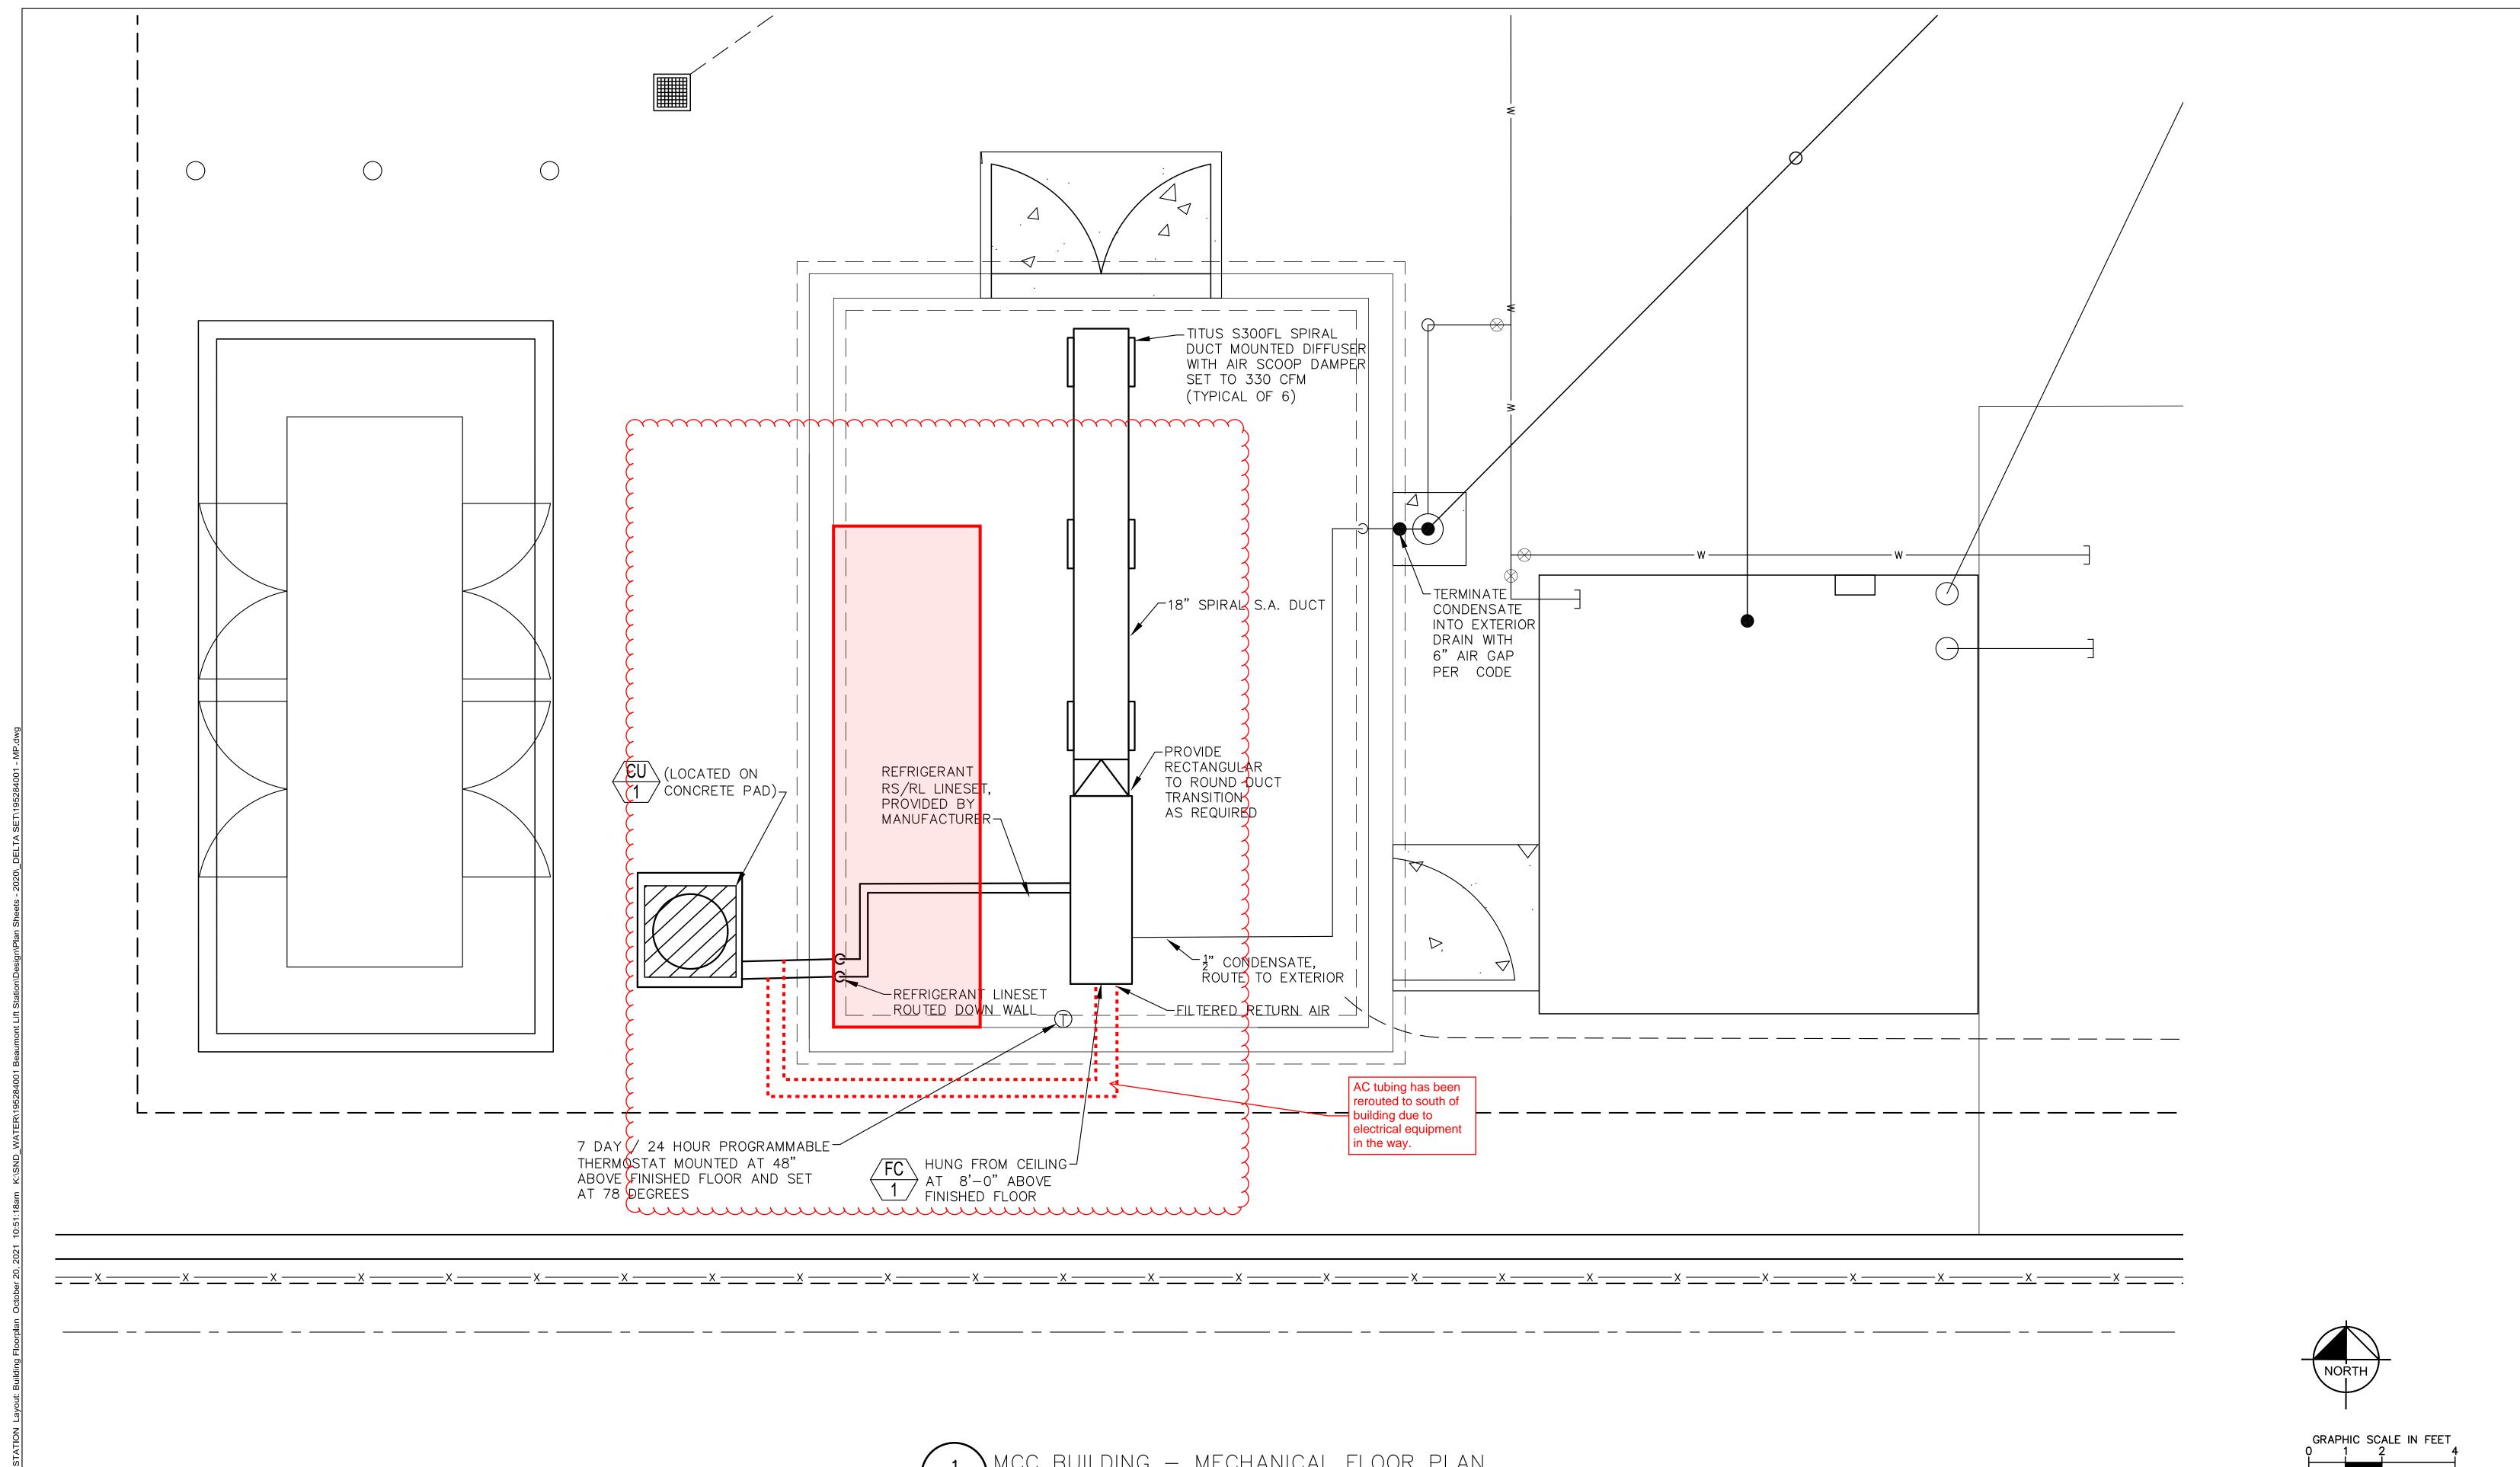



8/23/2021




Olecel Oct.DE	DIGALERT
Dy.VVdellici, Caiii	Call 2 Working Days Before You Dig! 811


ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)

Kimley» Horn BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311

1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD. INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM*
AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN
THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH BY MARK APPR. DATE DESCRIPTION A MEASURED ELEVATION = 2468.01', USED HEREON.

REVISIONS



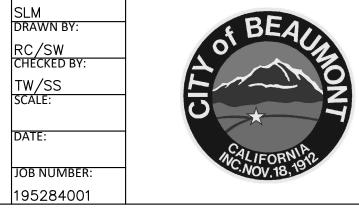

Reviewed By: Staff Engineer	_ Date:	
Recommended for Approval By: Administrative Engineer	_ Date: <u>11/19/2021</u>	F
Approved By:	_ Date: <u>11/23/2021</u>	_
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT ENGINEERING DIVISION TEL: (951)	550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	


IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

CITY OF BEAUMONT, CALIFORNIA

of <u>38</u> sheets 3387

SHEET


MECHANICAL FLOORPLAN

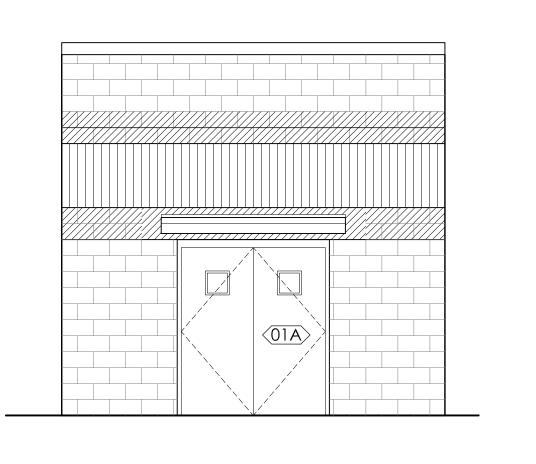

SOUTH ELEVATION

HM PAIR WITH 1/2" CLEAR HM PAIR WITH 1/2" CLEAR INSULATED LITE INSULATED LITE

DOOR HARDWARE SET 1 - EXTERIOR PAIR

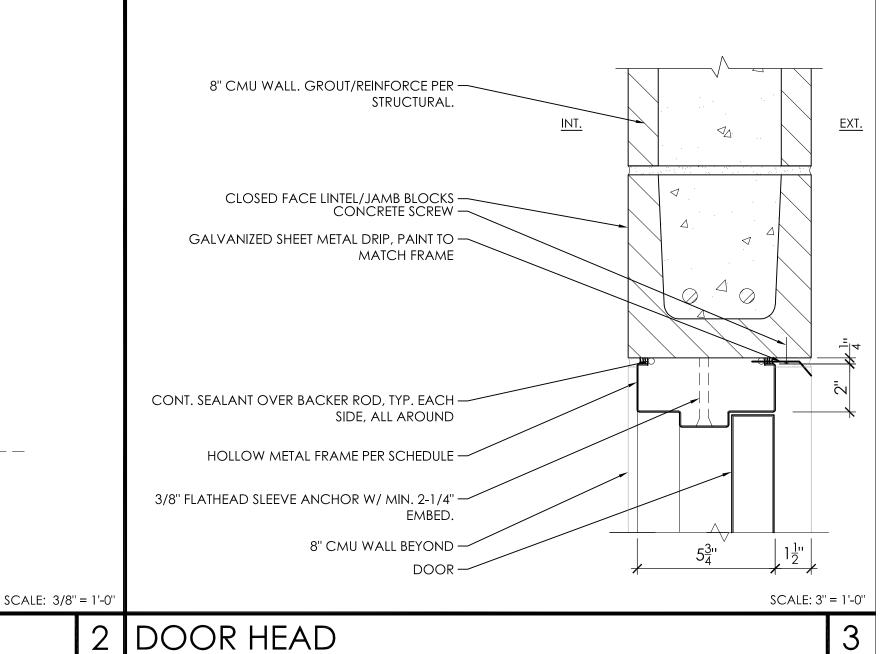

NORTH ELEVATION

PAINT

PT-1

CMU-2

SHERWIN WILLIAMS

EXTERIOR FINISH ELEVATIONS

	COLOR/MATERIAL LEGEND												
CODE	MATERIAL NAME	MANUFACTURER	PRODUCT	COLOR	SIZE	NOTES							
CMU-1	SPLIT FACE CMU	ANGELUS BLOCK CO, INC.	-	SANDSTONE	8X8X16	PROVIDE ANTI-GRAFFITI COATING							
CMU-2	PRECISION CMU	ANGELUS BLOCK CO, INC.	-	Sandstone	8X8X16	PROVIDE ANTI-GRAFFITI COATING							
CMU-3	SPLIT RIBBED CMU - 4 RIB	ANGELUS BLOCK CO, INC.	-	Sandstone	8X8X16	PROVIDE ANTI-GRAFFITI COATING							

SW 7548 PORTICO

	DOOR SCHEDULE																					
	DOOR FRAME																					
MARK	TYPE	SIZE (FT-IN)		SIZE (FT-IN)		SIZE (FT-IN)		SIZE (FT-IN)		SIZE (FT-IN)		SIZE (FT-IN) MAT.		FIN.	MAT.	FIN.		DETAIL		FIRE RATING	HARDWRE	COMMENTS
		WIDTH HEIGHT THICKNESS	1017 (1.	1777	1417 (1.		HEAD	JAMB	SILL	LABEL	SET#	#										
01A	1	6'-0"PR	7'-0''	1-3/4"	НМ	PT-1	НМ	PT-1	3/THIS SHEET	5/THIS SHEET	4/THIS SHEET		1									
01B	2	3'-0''	7'-0''	1-3/4"	НМ	PT-1	НМ	PT-1	3/THIS SHEET	5/THIS SHEET	4/THIS SHEET		2									

DOOR HARDWARE NOTES:

- Provide hardware for all openings, whether specified or not, in compliance with NFPA Standard No. 80, proper operation and local building code requirements. Where required, provide only hardware which has been tested and listed by UL or FM for types and sizes of doors required and complies with requirements of door and door frame labels. Label hardware, as required, for compliance with pressure testing criteria as dictated in IBC.
- Provide hardware which meets or exceeds handicap accessibility per local building code requirements. Conform to the Americans with Disabilities Act (ADA) of 1990 as amended by the D.O.J. September 15, 2010, as adopted by the Authority Having Jurisdiction (AHJ).
- Base Metals: Produce hardware units of basic metal and forming method indicated, using manufacturer's standard metal alloy, composition, temper and hardness, but in no case of lesser (commercially recognized) quality than specified for applicable hardware units by applicable ANSI A156 series standard for each type hardware item and with ANSI A156.18 for finish designations indicated. Do not furnish "optional" materials or forming methods for those indicated, except as otherwise specified.
- 4. Fasteners: Provide hardware manufactured to conform to published templates, generally prepared for machine screw installation. Do not provide hardware which has been prepared for self tapping sheet metal screws, except as specifically indicated.
- Screws: Furnish screws for installation, with each hardware item. Provide Phillips flat head screws except as otherwise indicated. Finish exposed (exposed under any condition) screws to match hardware finish or, if exposed in surfaces of other work, to match finishes of such other work as closely as possible, including "prepared for paint" in surfaces to receive painted finish.
- Concealed Fasteners: Provide concealed fasteners for hardware units which are exposed when door is closed, except to extent no standard units of type specified are available with concealed fasteners. Do not use thru-bolts for installation where bolt head or nut on opposite face is exposed in other work, except where it is not feasible to adequately reinforce the work. In such cases, provide sleeves for each thru-bolt or use sex screw
- Hinges: Manufacturer Stanley; Substitutions Hager, McKinney. Provide only template produced units. Furnish Phillips flat head or machine screws for installation of units, Finish screw heads to match surface of hinges.
- Lock cylinders: Manufacturer Best Cormax Patented; Approved Substitutions Match existing system coordinate with the City of Beaumont.All lock cylinders shall be equipped with 7-pin tumbler small format interchangeable core lock cylinders. The interchangeable core shall be removable by a special control key. The control key shall have no cuts in common with grandmaster keys which operate with a shear line completely independent from the shear line of the grandmaster, master, and operating keys. All cores shall have a special limited keyway and shall be removable without removing the cylinder, knob, or core housing of any type lock or lockset. The removable core shall be instantly interchangeable without modification for use in any lock throughout the system. Provide brass construction cores for the construction period. Plastic construction cores are not acceptable. Construction cores shall remain the property of the hardware supplier and will be returned upon incorporation of the permanent key system. Cylinders shall utilize the manufacturer's patented Cormax keyway. Construct lock cylinder parts from brass/bronze, stainless steel, or nickel silver.
- Keys, keying, and key control: Provide keys of nickel silver only. Deliver keys to the Owner's representative: Send masterkeys to Owner via U.S. registered mail direct from hardware supplier. Comply with Owner's written instructions for masterkeying and, except as otherwise indicated, provide individual change keys for each lock which is not designated to be keyed alike with a group of related locks. Grandmaster key all cylinder items to coordinate with the Owner's new patented masterkey system. Permanently inscribe each key with the notation "DO NOT DUPLICATE". Provide cylinder units with concealed key control and keys with visual key control.

ENGINEER

MANUFACTURER'S ABBREVIATIONS

BE BEST ACCESS SYSTEMSLOCKS, CYLINDERS NA NATIONAL GUARD GASKETS, THRESHOLDS

ST STANLEY HINGES TR TRIMCO FLUSH BOLTS, FLAT GOODS

SCALE: 1/4" = 1'-0

DOOR TYPES

FINISH LIST

DOORS, FRAMES, FLASHING, OVERHANG FRAME

SATIN CHROME SATIN STAINLESS STEEL 689 PAINTED ALUMINUM

OPTION LIST

BEVELED FOUR EDGES - KICK PLATES (TRIMCO) COUNTER SINKING - KICK PLATES (TRIMCO) SSMS/EA STAINLESS MACHINE SCREWS/EXPANSION


ANCHORS (NGP) SMS-TEKSSELF-DRILLING MACHINE SCREWS (NGP)

2 FLUSH BOLTS 3917-12 1 LOCKSET 45H-7D15H PATD 2 CLOSER/STOP HD7016 SDS 2 KICK PLATE K0050 10" X 2" LDW B4E CS 1 DRIP CAP 16 A FHW SMS-TEKS 1 GASKETING 700 NA SMS-TEKS 1 ASTRAGAL GASKET 2 DOOR SWEEP 200 NA SMS-TEKS 1 SADDLE THRESHOLD 426 SSMS/EA DO NOT CUT WEATHERSTRIP - TEMPLATE HARDWARE ACCORDINGLY. ASTRAGAL ON INACTIVE LEAF BY DOOR MANUFACTURER. VERIFY THRESHOLD APPLICATION. DOOR HARDWARE SET 2 - EXTERIOR SINGLE 630 3 HINGES FBB199 4 1/2 X 4 1/2 NRP 1 LOCKSET 45H-7D15H PATD 626 1 CLOSER/STOP HD7016 SDS K0050 10" X 2" LDW B4E CS 1 KICK PLATE 16 A FHW SMS-TEKS 1 DRIP CAP 1 GASKETING 700 NA SMS-TEKS 1 DOOR SWEEP 200 NA SMS-TEKS 1 SADDLE THRESHOLD 426 SSMS/EA DO NOT CUT WEATHERSTRIP - TEMPLATE HARDWARE ACCORDINGLY. VERIFY THRESHOLD APPLICATION


FBB199 4 1/2 X 4 1/2 NRP

Locksets, latchsets, and privacy sets: Manufacturer - Best 45H; Substitutions - Dorma M9000. Provide manufacturer's standard wrought box strike for each latch or lock bolt. Provide dust-proof strikes for foot bolts, except where not available. At these locations, provide manufacturer's standard recessed strike. Provide roller type strikes where recommended by lock, latch or bolt manufacturer. Provide 3/4" minimum throw of mortise type latches and deadbolts used. Cylindrical latches will be 1/2" minimum. Comply with UL requirements for throw of bolts and latch bolts on rated fire openings. Locks and latches shall be warranted for a period of five years.

- Closers: Manufacturer Best HD7016; Substitutions Stanley QDC100. Except as otherwise specifically indicated, comply with the manufacturer's recommendations for size of door control unit, depending on the size of the door, exposure to weather and anticipated frequency of use. Provide manufacturer's standard through bolt attachment at all applications. Provide parallel arms for all overhead closers, except as otherwise indicated. Provide drop plates as needed to prevent glazing interference. Mount all closers to the maximum allowable degree of opening by the closer manufacturer's template. Where closer arms incorporate dead stop features, mount closers to the maximum degree of opening available before conflict with adjacent structures. If not apparent on the contract documents, verify the use of open space with the Architect or Owner's Representative to determine the maximum allowable degree of opening. Door closers and related hardware shall be warranted for a period of twenty-five years.
- 10. Protection plates: Manufacturers Trimco; Substitutions Hager, Tice. Provide manufacturer's standard exposed and countersunk Phillips head fasteners for door trim units; either machine screws or self tapping sheet metal type screws per manufacturer's recommendations for application to the specified door construction. Fabricate protection plates (armor, kick or mop) not more than 2" less than door width on stop side and not more than 1" less than door width on pull side, by the height indicated. Stainless Steel, 18 gauge (0.050) thick. Satin finish, US32D (630), beveled four edges (B4E).
- Gaskets and sweeps: Manufacturer National Guard; Substitutions Pemko, Reese. Except as otherwise indicated, provide continuous weatherstripping at each edge of every exterior door leaf. Provide non-corrosive fasteners as recommended by the manufacturer for applications indicated. Replaceable seal strips: Provide only those units where resilient or flexible seal strip is easily replaceable and readily available from stocks maintained by the manufacturer. Perimeter weatherstripping: Flexible, hollow neoprene bulb or loop insert, conforming to MIL R 6055, Class II, Grade 40. Where two types of perimeter gaskets are specified, apply them not to conflict and per gasket manufacturer's recommendations. Weatherstripping at Door Bottoms: Provide door bottoms consisting of contact type resilient insert and metal housing of design and size indicated. Gaskets and sweeps shall be warranted for a period of three years.
- Thresholds: Manufacturer National Guard; Substitutions- Pemko, Reese. Except as otherwise indicated provide standard metal threshold unit of type, size and profile as detailed or scheduled. All thresholds will be supplied with the SIA abrasive finish unless noted otherwise. Where there is conflict between scheduled thresholds and details, details shall have precedence. Revise details only if necessary to comply with handicap accessibility requirements. Notify the Architect of such required modifications. Verify threshold details or conditions at all openings to ensure that the openings receive proper applications for weather seal or floor transition whether specified or not. Thresholds and related items shall be warranted for a period of three years, abrasive coatings shall be warranted for a period of ten years.

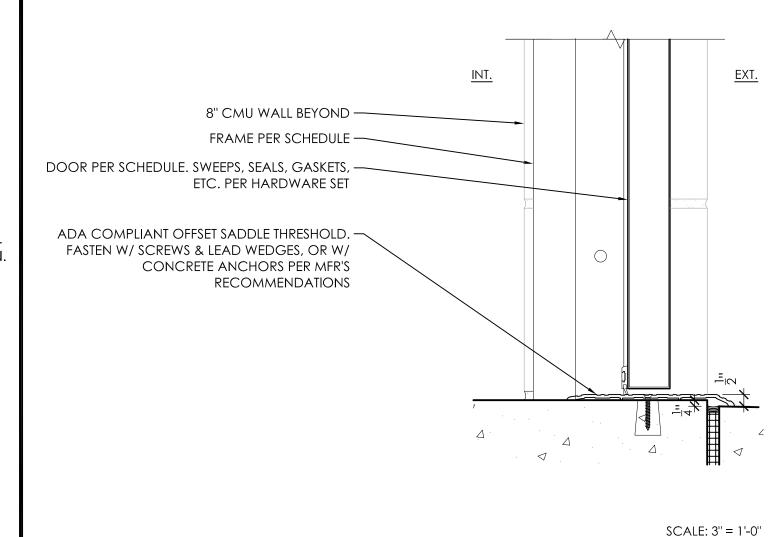



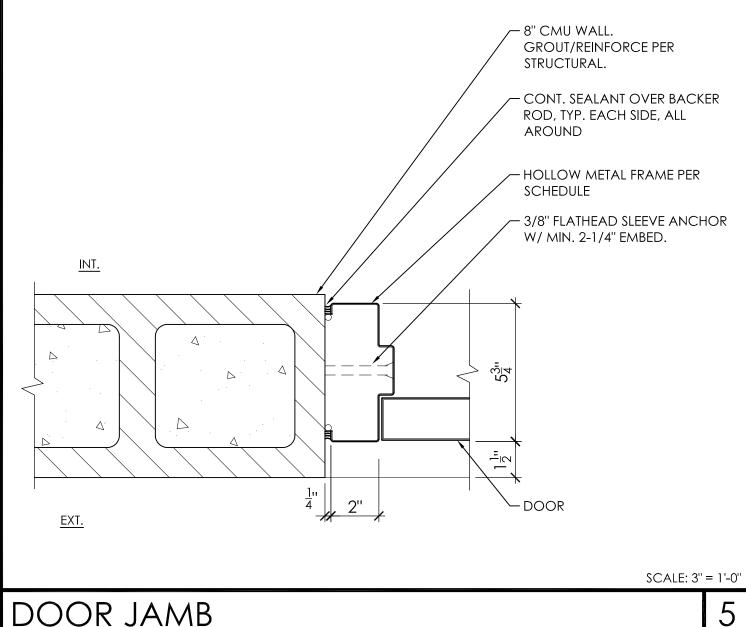


NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311 1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (FLEVATION = 2468 07) ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVE INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WIT A MEASURED ELEVATION = 2468.01', USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)


92104 BY MARK DESCRIPTION

REVISIONS





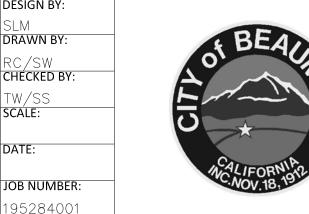

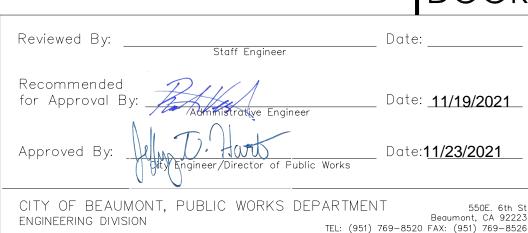

SHEE CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: LIFT STATION 3387

FINISHES AND DOORS

